



## DesignLights Consortium Test Report

### Reference Standards

UL1598-2008

ANSI C82.77-10-2014

IES LM-79-2008

### Prepared For

**P.Q.L., Inc.**

2285 Ward Avenue  
Simi Valley, CA 93065

### Test Laboratory:

UL-CCIC Company Limited

### Test Laboratory Address:

No.2, Chengwan Road, Suzhou Industrial Park, Suzhou 21522, China

### Catalog Number

55452

### Project Number

4789992810

### Report Number

4789992810\_5

### Test Date

2021-07-15~2021-07-19

### Issue Date

2021-07-27

### Revision Date

N/A

### Prepared By

*Duff Yang*

Yang, Duff

### Approved By

*Susie Shao*

Susie Shao

The results contained in this report pertain only to the tested sample.

This report shall not be reproduced, except in full, without written approval of Underwriters Laboratories.

This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the U.S. Government. The laboratory is not responsible for the information which provided by customer, its authenticity can affect the validity of the result in the test report.



## Test Summary

### DLC Technical Requirements V5.1- issued 2020-02-14

| Requirement Category                                   | Test Method                      | Requirements | Tolerance | Test Result |
|--|----------------------------------|--------------|-----------|-------------|
| Minimum Light Output (lm/ft)-Luminaires                | IES LM-79-2008                   | ≥375         | -10%      | 1078        |
| Zonal Lumen Requirement 1(0°-60°)                      | IES LM-79-2008                   | ≥40%         | -3%       | 63.00%      |
| Minimum Luminaire Efficacy (lm/W)-Luminaires           | IES LM-79-2008                   | ≥115         | -3%       | 128.28      |
| Allowable CCT (3500K)                                  | IES LM-79-2008/ANSI C78.377-2015 | 3465±245     | N/A       | 3477        |
| Allowable CCT (4000K)                                  | IES LM-79-2008/ANSI C78.377-2015 | 3985±275     | N/A       | 3487        |
| Allowable CCT (5000K)                                  | IES LM-79-2008/ANSI C78.377-2015 | 5029±283     | N/A       | 3497        |
| Minimum CRI  | IES LM-79-2008/CIE 13.3-1995     | ≥80          | -1        | 82          |
| Minimum R9   | IES LM-79-2008                   | ≥0           | -1        | 5.0         |
| Minimum Rf   | IES LM-79-2008                   | ≥70          | -1        | 83          |
| Minimum Rg   | IES LM-79-2008                   | ≥89          | -1        | 94          |
| Rcs,h1   | IES LM-79-2008                   | -12%-23%     | -1%       | -12%        |
| L70 Lumen maintenance (Hours)                          | N/A                              | ≥50000       | N/A       | ≥50000      |
| L90 Lumen maintenance (Hours)                          | N/A                              | ≥36000       | N/A       | ≥36000      |
| Power Factor   | ANSI C82.77-10-2014              | ≥0.9         | -0.03     | 0.9045      |
| Total Harmonic Distortion (A%)                         | ANSI C82.77-10-2014              | ≤20%         | 5%        | 9.85%       |
| In-Situ Temperature Measurement Test for LED 1 (°C)    | UL1598-2008                      | ≤105         | N/A       | 67.6        |
| In-Situ Temperature Measurement Test for Driver 1 (°C) | UL1598-2008                      | ≤90          | N/A       | 55.8        |
| Max Chromaticity Shift (1000-6000h)                    | N/A                              | ≤0.004       | 0.0004    | 0.0024      |
| Minimum Luminaire Warranty (Years)                     | N/A                              | ≥5           | N/A       | ≥5          |



## Test List

Sample Received Date: 2021-07-14

| Test Item                            | Test Date  | Model Number     | Tests Conducted By |
|--------------------------------------|------------|------------------|--------------------|
| Integrating Sphere Test              | 2021-07-16 | 55452<br>15W-35K | Yang, Gavin X      |
| Integrating Sphere Test              | 2021-07-16 | 55452<br>20W-35K | Yang, Gavin X      |
| Integrating Sphere Test              | 2021-07-16 | 55452<br>25W-35K | Yang, Gavin X      |
| Integrating Sphere Test              | 2021-07-16 | 55452<br>25W-40K | Yang, Gavin X      |
| Integrating Sphere Test              | 2021-07-15 | 55452<br>25W-50K | Yang, Gavin X      |
| Goniophotometer Test                 | 2021-07-15 | 55452<br>25W-35K | Yang, Gavin X      |
| Goniophotometer Test                 | 2021-07-15 | 55452<br>25W-50K | Yang, Gavin X      |
| THD and PF Test                      | 2021-07-15 | 55452<br>15W-35K | Yang, Gavin X      |
| THD and PF Test                      | 2021-07-15 | 55452<br>20W-35K | Yang, Gavin X      |
| THD and PF Test                      | 2021-07-15 | 55452<br>25W-35K | Yang, Gavin X      |
| THD and PF Test                      | 2021-07-15 | 55452<br>25W-40K | Yang, Gavin X      |
| THD and PF Test                      | 2021-07-15 | 55452<br>25W-50K | Yang, Gavin X      |
| In-Situ Temperature Measurement Test | 2021-07-19 | 55452<br>25W-35K | Yang, Gavin X      |

### Remark (if any)

1. UL test equipment information is recorded on Meter Use in UL's Aurora database.
2. The accuracy method decision rule is applied when the compliance or verdict is made to the results of this report.



### Product Description

**Lamp/Luminaire Description:** Direct Linear Ambient Luminaires

**Model Number:** 55452 - 35K

**Electrical Parameter:** 120-277V, 50/60Hz

**Optical Parameter:** White-Tunable products (3500K, 4000K, 5000K)

**LED Package:** STW8A2PD-XX


**Family Model and Variation:** 55452 - 40K, 55452 - 50K

**Dimming Information:** Continuous dimming capability

Products Scaled Value

| Model Number | CCT   | Luminous Flux | Power | Luminous Efficacy |
|--------------|-------|---------------|-------|-------------------|
| 55452        | 3500K | 3250          | 25    | 130               |
|              | 4000K | 3275          | 25    | 131               |
|              | 5000K | 3300          | 25    | 132               |

55452

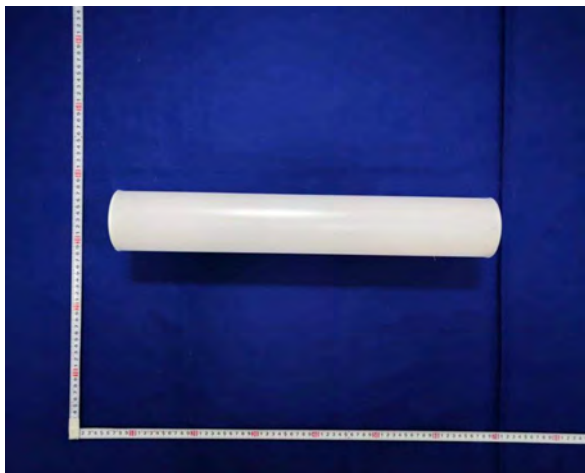



## Integrating Sphere Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>15W-35K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

### Test Method

1. The sample was tested according to the IES LM-79-2008, and the product is assumed to be brand new without seasoning.

2. Photometric parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at  $25\text{ }^{\circ}\text{C} \pm 1\text{ }^{\circ}\text{C}$ . The reference standard lamp is rated current 2.679A omni-directional Incandescent lamp and was calibrated by National Institute of Metrology P.R.China.



3. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. Coating reflectance of the integrating sphere was 90% to 98%. Photometric measurement conditions was using  $4\pi$  geometry. The self-absorption factor is applied in the final test result. The sample was operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

### Integrating Sphere Test Conditions

| Temperature ( $^{\circ}\text{C}$ ) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Orientation |
|------------------------------------|---------------|----------------|-------------|-----------|--------------|-------------|
| 25.0                               | 120.13        | 60             | 0.1350      | 16.044    | 0.9897       | Horizontal  |

### Test Results

| CCT (K) | CRI (Ra) | R9  | Duv     | Flux (lm) | Luminous Efficacy (lm/W) | Efficacy(lm/ft) |
|---------|----------|-----|---------|-----------|--------------------------|-----------------|
| 3477    | 82       | 6.0 | -0.0004 | 2155.61   | 134.36                   | 1078            |

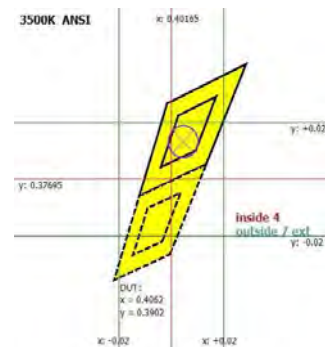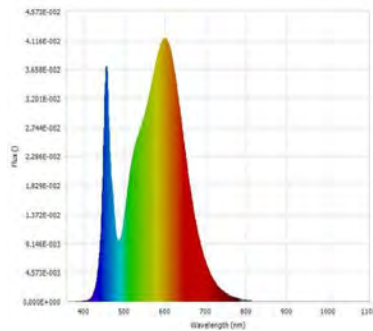


|                    |         |                          |         |
|--------------------|---------|--------------------------|---------|
| Luminous Flux (lm) | 2155.61 | Chrom x                  | 0.4062  |
| Chrom y            | 0.3902  | Chrom u                  | 0.2365  |
| Chrom v            | 0.3408  | Duv                      | -0.0004 |
| Chrom u'           | 0.2365  | Chrom v'                 | 0.5112  |
| CCT (K)            | 3477    | Luminous Efficacy (lm/W) | 134.36  |
| Ra                 | 82      | R1                       | 80.4    |
| R2                 | 90.0    | R3                       | 95.7    |
| R4                 | 78.9    | R5                       | 79.8    |
| R6                 | 85.8    | R7                       | 83.9    |
| R8                 | 60.8    | R9                       | 6.0     |
| R10                | 75.5    | R11                      | 76.8    |
| R12                | 60.3    | R13                      | 82.9    |
| R14                | 98.0    | R15                      | 74.2    |
| Rf                 | 83      | Rg                       | 94      |
| Rcs,h1             | -12%    |                          |         |



Integrating Sphere Test (Cont'd)

TM-30 Report

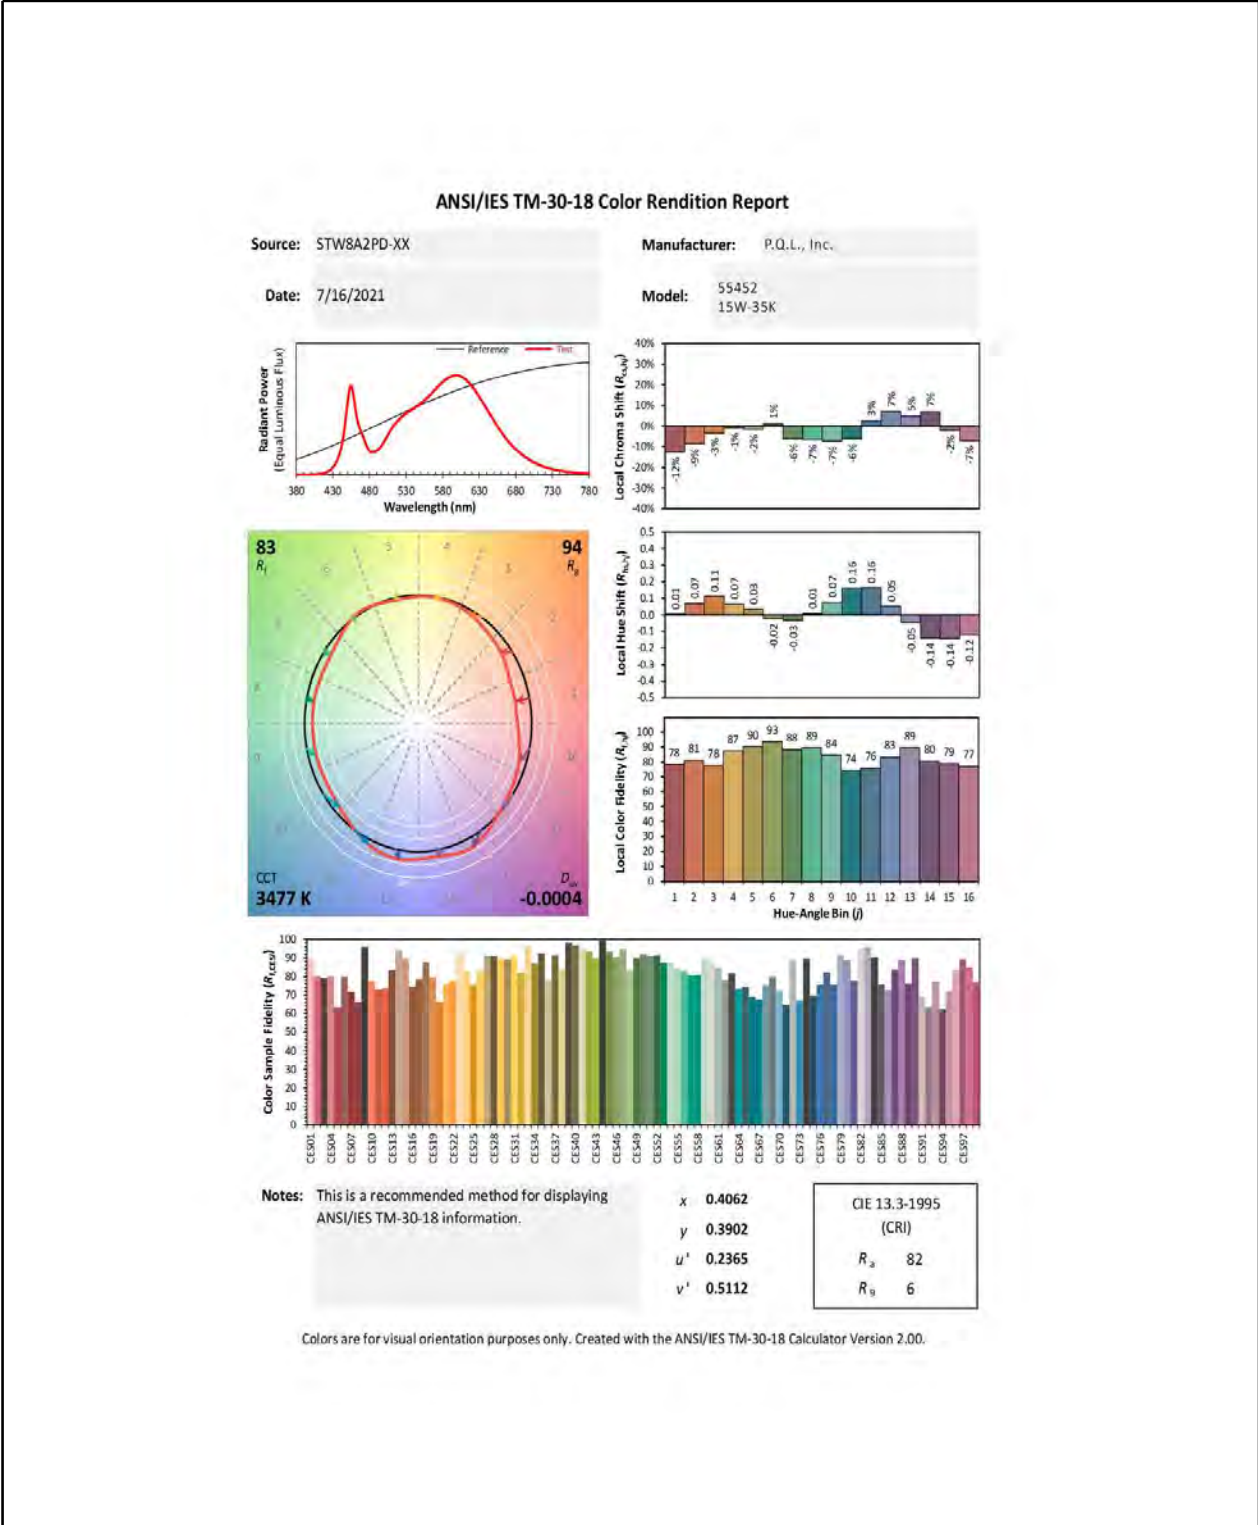



## Integrating Sphere Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>20W-35K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

### Test Method

1. The sample was tested according to the IES LM-79-2008, and the product is assumed to be brand new without seasoning.

2. Photometric parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at  $25\text{ }^{\circ}\text{C} \pm 1\text{ }^{\circ}\text{C}$ . The reference standard lamp is rated current 2.679A omni-directional Incandescent lamp and was calibrated by National Institute of Metrology P.R.China.



3. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. Coating reflectance of the integrating sphere was 90% to 98%. Photometric measurement conditions was using  $4\pi$  geometry. The self-absorption factor is applied in the final test result. The sample was operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

### Integrating Sphere Test Conditions

| Temperature ( $^{\circ}\text{C}$ ) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Orientation |
|------------------------------------|---------------|----------------|-------------|-----------|--------------|-------------|
| 25.0                               | 120.08        | 60             | 0.1718      | 20.505    | 0.9941       | Horizontal  |

### Test Results

| CCT (K) | CRI (Ra) | R9  | Duv     | Flux (lm) | Luminous Efficacy (lm/W) | Efficacy(lm/ft) |
|---------|----------|-----|---------|-----------|--------------------------|-----------------|
| 3487    | 82       | 6.0 | -0.0006 | 2717.66   | 132.54                   | 1359            |

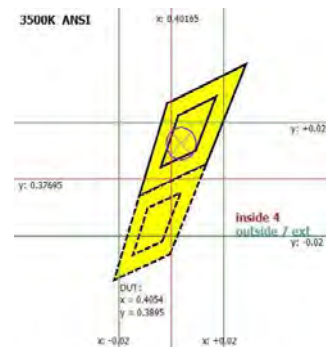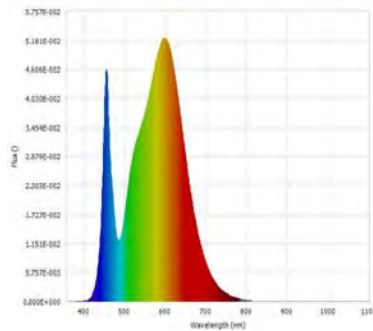


|                    |         |                          |         |
|--------------------|---------|--------------------------|---------|
| Luminous Flux (lm) | 2717.66 | Chrom x                  | 0.4054  |
| Chrom y            | 0.3895  | Chrom u                  | 0.2363  |
| Chrom v            | 0.3405  | Duv                      | -0.0006 |
| Chrom u'           | 0.2363  | Chrom v'                 | 0.5108  |
| CCT (K)            | 3485.0  | Luminous Efficacy (lm/W) | 132.54  |
| Ra                 | 82      | R1                       | 80.2    |
| R2                 | 89.9    | R3                       | 95.6    |
| R4                 | 78.7    | R5                       | 79.6    |
| R6                 | 85.6    | R7                       | 83.8    |
| R8                 | 60.7    | R9                       | 6.0     |
| R10                | 75.2    | R11                      | 76.5    |
| R12                | 60.5    | R13                      | 82.7    |
| R14                | 97.9    | R15                      | 74.0    |
| Rf                 | 83      | Rg                       | 94      |
| Rcs,h1             | -13%    |                          |         |



## Integrating Sphere Test (Cont'd)

### TM-30 Report

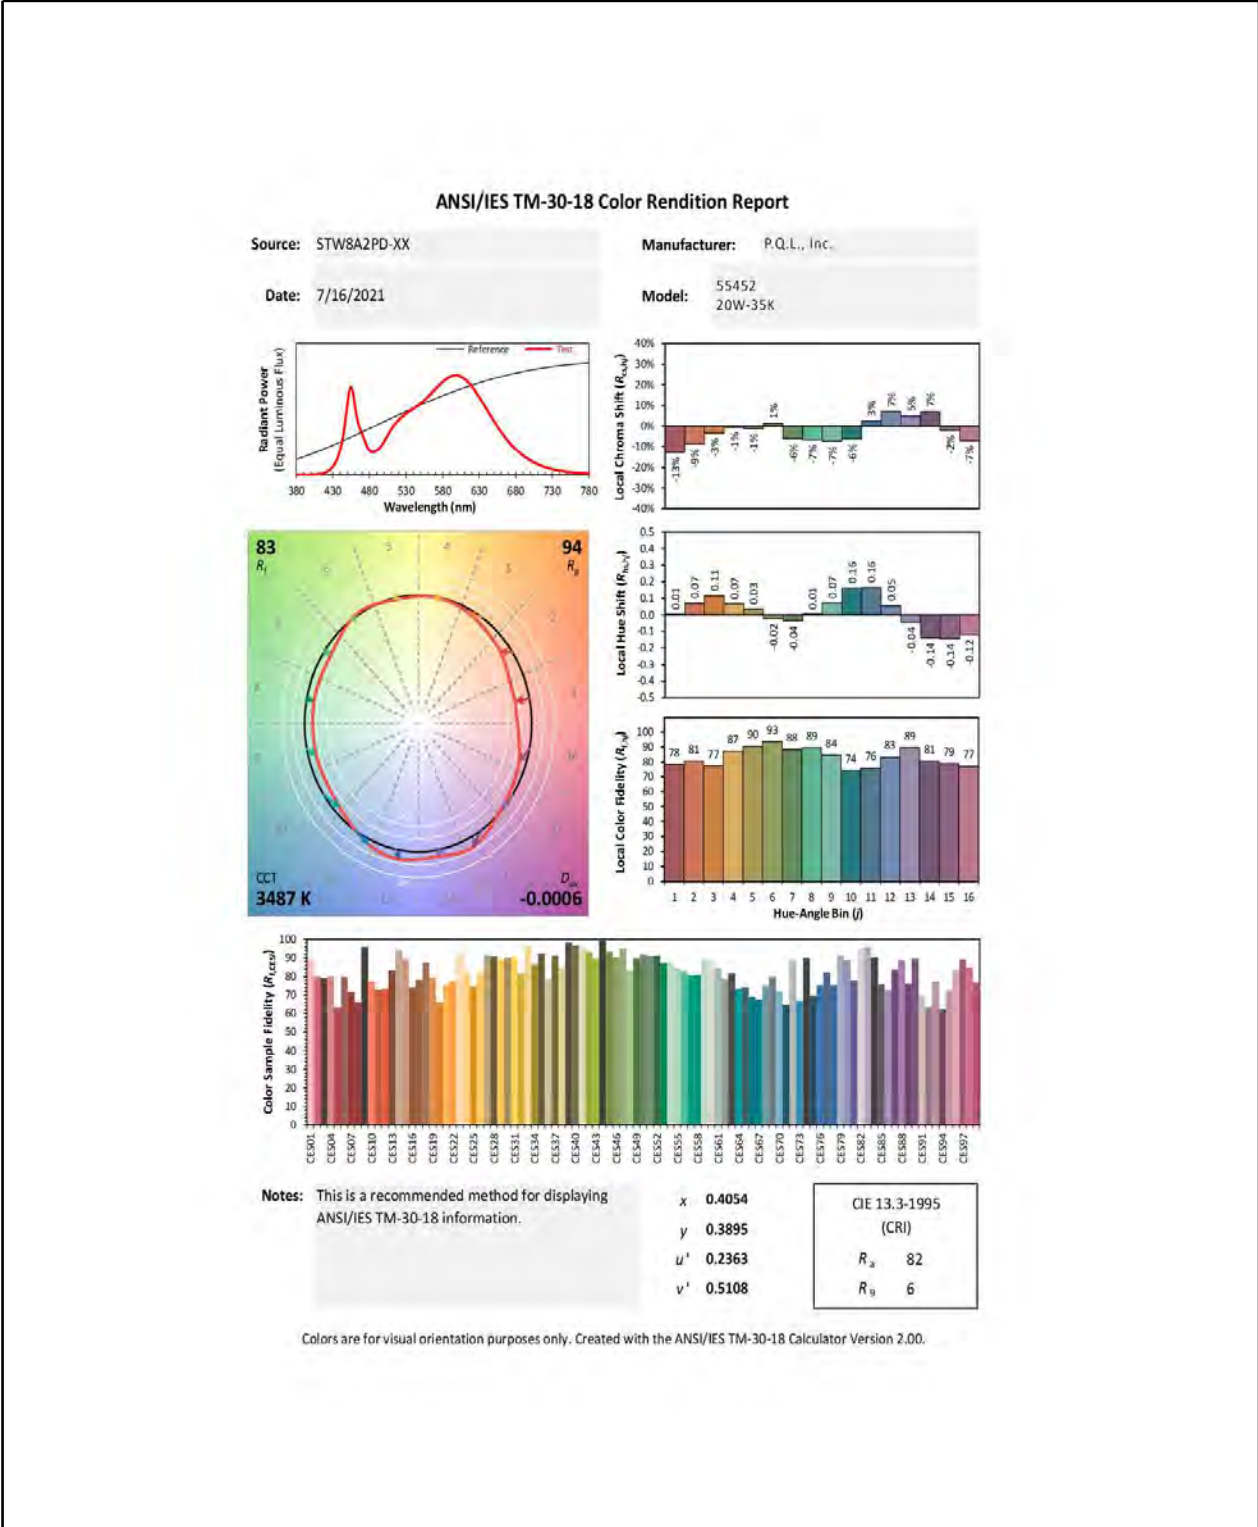





## Integrating Sphere Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>25W-35K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

### Test Method

1. The sample was tested according to the IES LM-79-2008, and the product is assumed to be brand new without seasoning.

2. Photometric parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at  $25\text{ }^{\circ}\text{C} \pm 1\text{ }^{\circ}\text{C}$ . The reference standard lamp is rated current 2.679A omni-directional Incandescent lamp and was calibrated by National Institute of Metrology P.R.China.



3. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. Coating reflectance of the integrating sphere was 90% to 98%. Photometric measurement conditions using  $4\pi$  geometry. The self-absorption factor is applied in the final test result. The sample was operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

### Integrating Sphere Test Conditions

| Temperature ( $^{\circ}\text{C}$ ) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Orientation |
|------------------------------------|---------------|----------------|-------------|-----------|--------------|-------------|
| 25.0                               | 120.05        | 60             | 0.2060      | 24.597    | 0.9952       | Horizontal  |

### Test Results

| CCT (K) | CRI (Ra) | R9  | Duv     | Flux (lm) | Luminous Efficacy (lm/W) | Efficacy(lm/ft) |
|---------|----------|-----|---------|-----------|--------------------------|-----------------|
| 3497    | 82       | 5.0 | -0.0007 | 3191.94   | 129.77                   | 1596            |

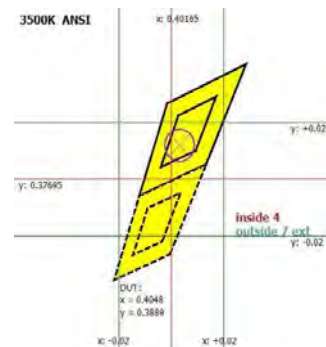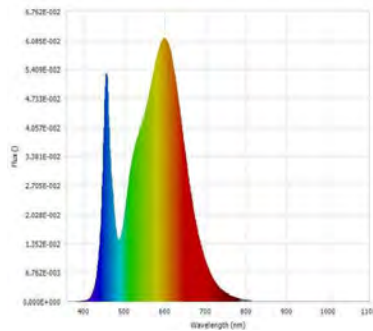


|                    |         |                          |         |
|--------------------|---------|--------------------------|---------|
| Luminous Flux (lm) | 3191.94 | Chrom x                  | 0.4048  |
| Chrom y            | 0.3889  | Chrom u                  | 0.2361  |
| Chrom v            | 0.3403  | Duv                      | -0.0007 |
| Chrom u'           | 0.2361  | Chrom v'                 | 0.5104  |
| CCT (K)            | 3494.0  | Luminous Efficacy (lm/W) | 129.77  |
| Ra                 | 82      | R1                       | 80.1    |
| R2                 | 89.8    | R3                       | 95.6    |
| R4                 | 78.5    | R5                       | 79.5    |
| R6                 | 85.5    | R7                       | 83.7    |
| R8                 | 60.5    | R9                       | 5.0     |
| R10                | 75.1    | R11                      | 76.3    |
| R12                | 60.8    | R13                      | 82.6    |
| R14                | 97.9    | R15                      | 73.9    |
| Rf                 | 83      | Rg                       | 94      |
| Rcs,h1             | -13%    |                          |         |



## Integrating Sphere Test (Cont'd)

### TM-30 Report

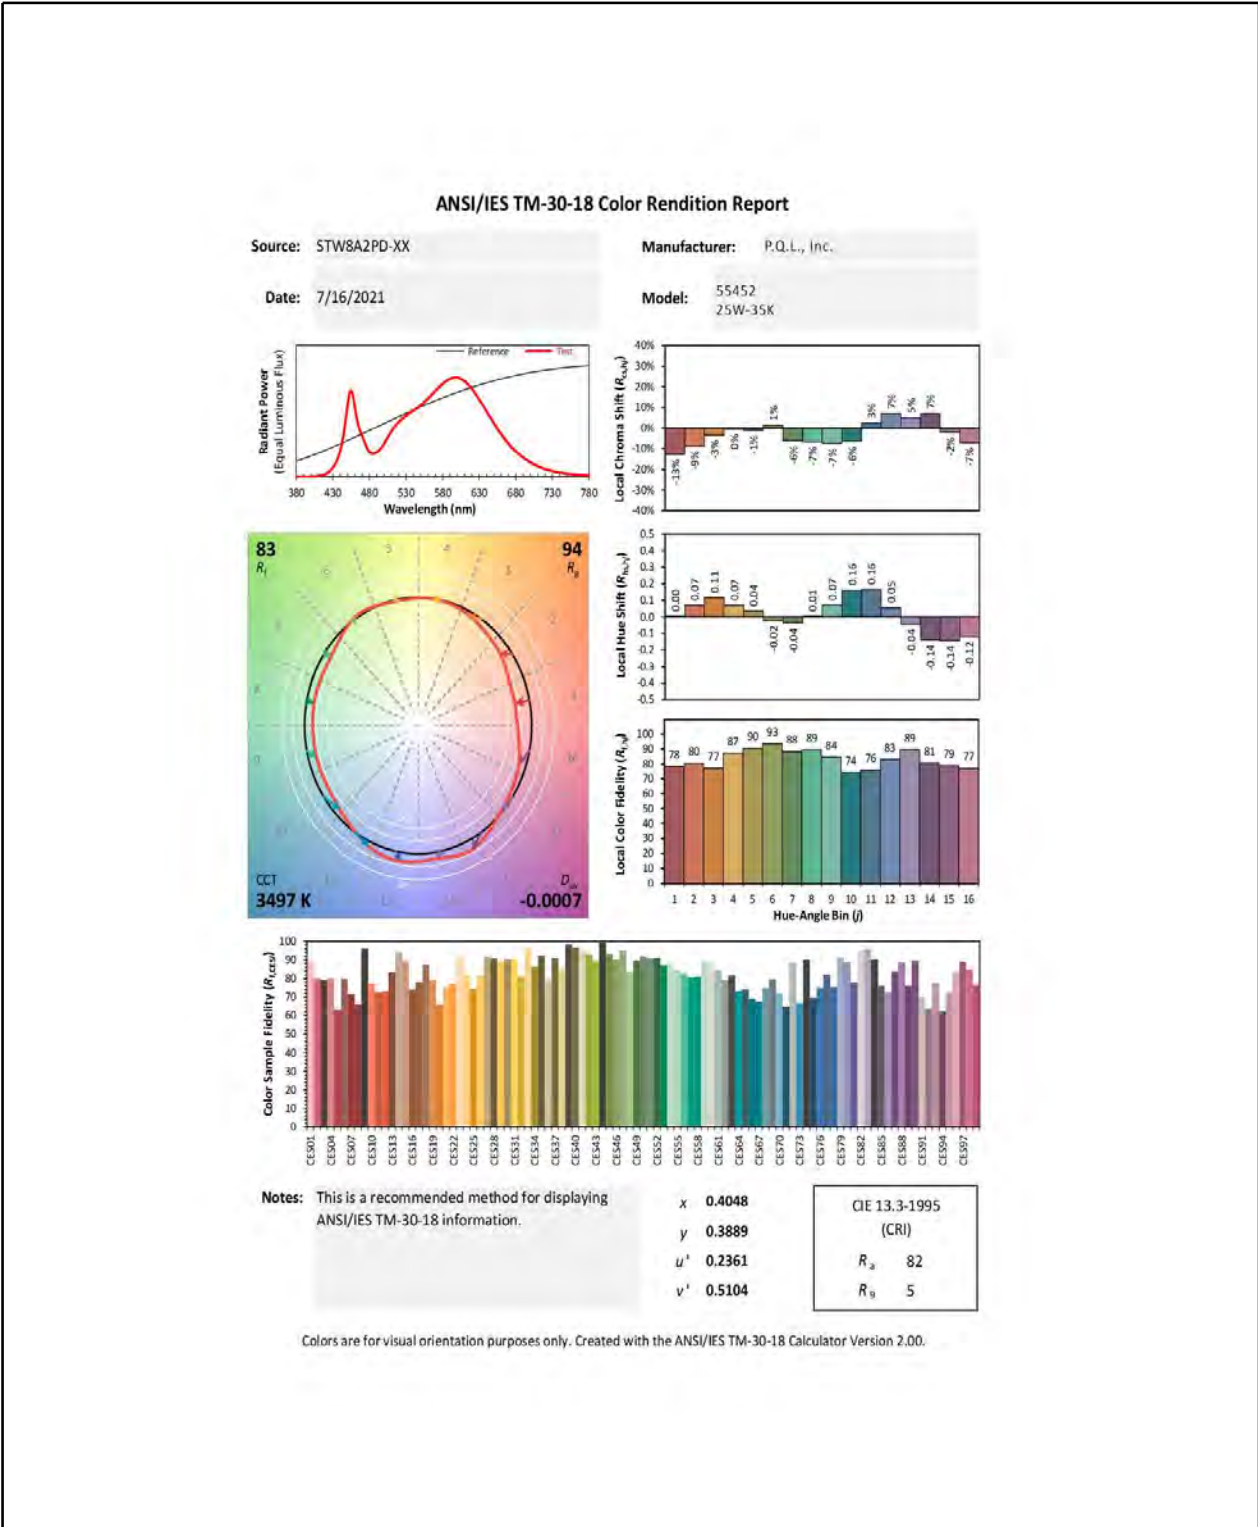



## Integrating Sphere Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>25W-40K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

### Test Method

1. The sample was tested according to the IES LM-79-2008, and the product is assumed to be brand new without seasoning.

2. Photometric parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at  $25\text{ }^{\circ}\text{C} \pm 1\text{ }^{\circ}\text{C}$ . The reference standard lamp is rated current 2.679A omni-directional Incandescent lamp and was calibrated by National Institute of Metrology P.R.China.



3. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. Coating reflectance of the integrating sphere was 90% to 98%. Photometric measurement conditions was using  $4\pi$  geometry. The self-absorption factor is applied in the final test result. The sample was operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

### Integrating Sphere Test Conditions

| Temperature ( $^{\circ}\text{C}$ ) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Orientation |
|------------------------------------|---------------|----------------|-------------|-----------|--------------|-------------|
| 25.0                               | 120.05        | 60             | 0.2005      | 23.951    | 0.9949       | Horizontal  |

### Test Results

| CCT (K) | CRI (Ra) | R9   | Duv     | Flux (lm) | Luminous Efficacy (lm/W) | Efficacy(lm/ft) |
|---------|----------|------|---------|-----------|--------------------------|-----------------|
| 4247    | 84       | 14.0 | -0.0007 | 3415.31   | 142.60                   | 1708            |

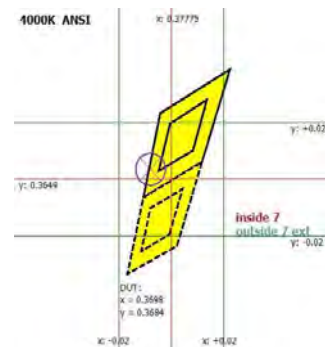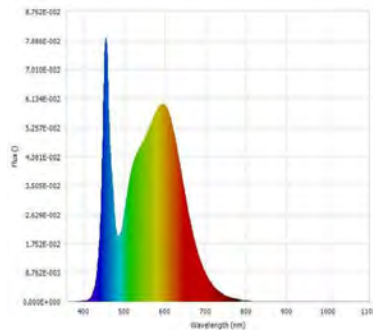


|                    |         |                          |         |
|--------------------|---------|--------------------------|---------|
| Luminous Flux (lm) | 3415.31 | Chrom x                  | 0.3698  |
| Chrom y            | 0.3684  | Chrom u                  | 0.2214  |
| Chrom v            | 0.3308  | Duv                      | -0.0007 |
| Chrom u'           | 0.2214  | Chrom v'                 | 0.4963  |
| CCT (K)            | 4247    | Luminous Efficacy (lm/W) | 142.60  |
| Ra                 | 84      | R1                       | 82.6    |
| R2                 | 90.6    | R3                       | 94.7    |
| R4                 | 81.4    | R5                       | 81.9    |
| R6                 | 85.4    | R7                       | 86.4    |
| R8                 | 66.6    | R9                       | 14.0    |
| R10                | 76.2    | R11                      | 79.9    |
| R12                | 58.2    | R13                      | 84.9    |
| R14                | 97.3    | R15                      | 77.5    |
| Rf                 | 83      | Rg                       | 95      |
| Rcs,h1             | -12%    |                          |         |



## Integrating Sphere Test (Cont'd)

### TM-30 Report

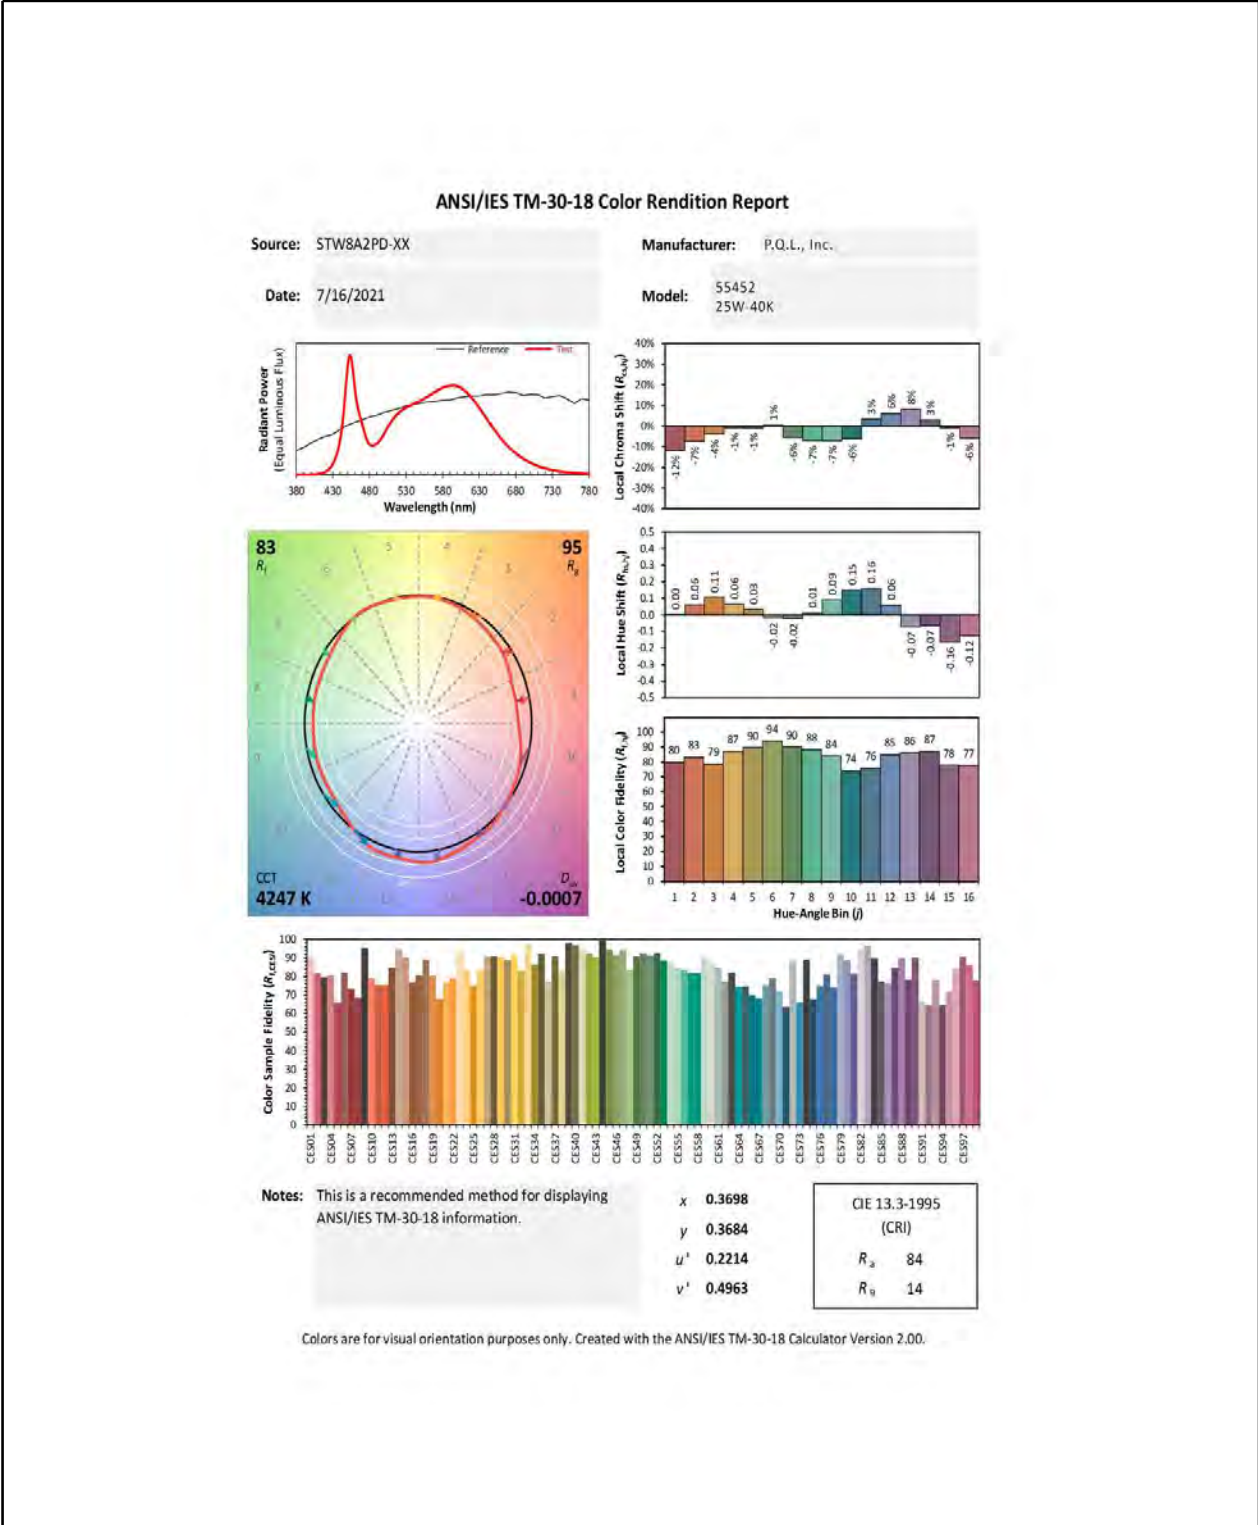



## Integrating Sphere Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>25W-50K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

### Test Method

1. The sample was tested according to the IES LM-79-2008, and the product is assumed to be brand new without seasoning.

2. Photometric parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at  $25\text{ }^{\circ}\text{C} \pm 1\text{ }^{\circ}\text{C}$ . The reference standard lamp is rated current 2.679A omni-directional Incandescent lamp and was calibrated by National Institute of Metrology P.R.China.



3. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. Coating reflectance of the integrating sphere was 90% to 98%. Photometric measurement conditions were using  $4\pi$  geometry. The self-absorption factor is applied in the final test result. The sample was operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

### Integrating Sphere Test Conditions

| Temperature ( $^{\circ}\text{C}$ ) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Orientation |
|------------------------------------|---------------|----------------|-------------|-----------|--------------|-------------|
| 25.0                               | 120.05        | 60             | 0.2052      | 24.514    | 0.9951       | Horizontal  |

### Test Results

| CCT (K) | CRI (Ra) | R9   | Duv    | Flux (lm) | Luminous Efficacy (lm/W) | Efficacy(lm/ft) |
|---------|----------|------|--------|-----------|--------------------------|-----------------|
| 5262    | 84       | 11.0 | 0.0014 | 3281.06   | 133.84                   | 1641            |

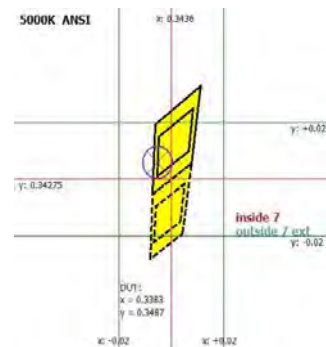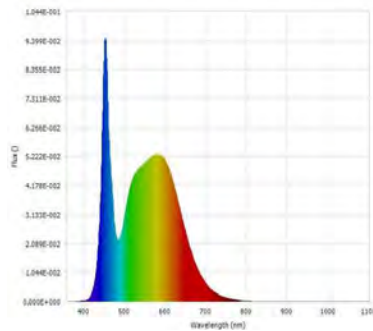

|                    |         |                          |        |
|--------------------|---------|--------------------------|--------|
| Luminous Flux (lm) | 3281.06 | Chrom x                  | 0.3383 |
| Chrom y            | 0.3487  | Chrom u                  | 0.2079 |
| Chrom v            | 0.3215  | Duv                      | 0.0014 |
| Chrom u'           | 0.2079  | Chrom v'                 | 0.4822 |
| CCT (K)            | 5258.0  | Luminous Efficacy (lm/W) | 133.84 |
| Ra                 | 84      | R1                       | 82.2   |
| R2                 | 88.9    | R3                       | 92.2   |
| R4                 | 83.0    | R5                       | 82.5   |
| R6                 | 83.4    | R7                       | 87.3   |
| R8                 | 68.7    | R9                       | 11.0   |
| R10                | 72.4    | R11                      | 81.9   |
| R12                | 60.0    | R13                      | 84.2   |
| R14                | 95.9    | R15                      | 77.7   |
| Rf                 | 83      | Rg                       | 95     |
| Rcs,h1             | -12%    |                          |        |





### Goniophotometer Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>25W-35K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

#### Test Method

- 1.The sample was tested according to the IES LM-79-2008, and the product is assume to be brand new without seasoning.
- 2.Photometric parameters were measured using a type C goniophotometer and software.
- 3.The ambient temperature shall be maintained at 25° C ± 1° C, measured at a point not more than 1 m from the sample and at the same height as the sample. The reference standard lamp is rated current 3.8581A, 3.8558A, 3.8466A omni-directional Incandescent lamp and was calibrated by National Institute of Metrology P.R.China.
- 4.The samples were operated at rated voltage and was stabilized before measurement. Luminous flux, luminaire efficacy, zonallumen were calculated from the software taken at 1° vertical intervals and 22.5° horizontal intervals. Photometric distance was more than five times of the largest dimension of the test SSL product.

#### Goniophotometer Test Conditions

| Temperature (°C) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Current THD | Orientation |
|------------------|---------------|----------------|-------------|-----------|--------------|-------------|-------------|
| 24.9             | 120.01        | 60             | 0.2069      | 24.73     | 0.9959       | 4.94%       | Horizontal  |

#### Test Results

| Luminous Flux (lm) | Zonal Lumen Requirement 1 | Zonal Lumen Requirement 2 | Beam Angle (50%)  |                 | Luminous Efficacy (lm/W) |
|--------------------|---------------------------|---------------------------|-------------------|-----------------|--------------------------|
|                    | 0°-60°                    | N/A                       | Horizontal Spread | Vertical Spread |                          |
| 3172.3             | 63.00%                    | N/A                       | 133.8             | 102.8           | 128.28                   |


| Backlight | Uplight | Glare |
|-----------|---------|-------|
| N/A       | N/A     | N/A   |

| UGR       |         | Spacing Criteria (0-180°) | Spacing Criteria (90°-270°) |
|-----------|---------|---------------------------|-----------------------------|
| Crosswise | Endwise |                           |                             |
| N/A       | N/A     | N/A                       | N/A                         |




## Goniophotometer Test (Cont'd)

### Polar Candela Distribution

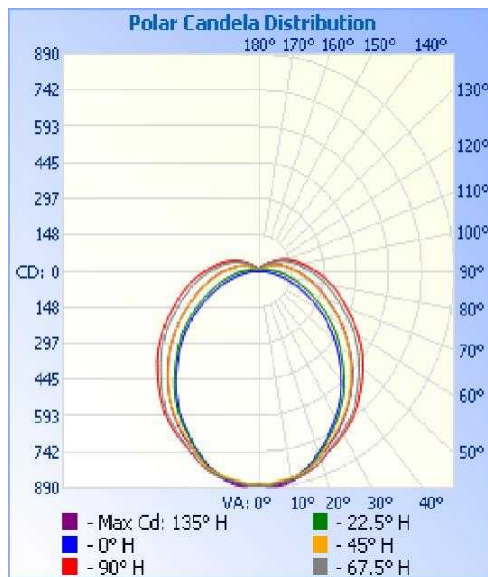

### IsoCandela Plot

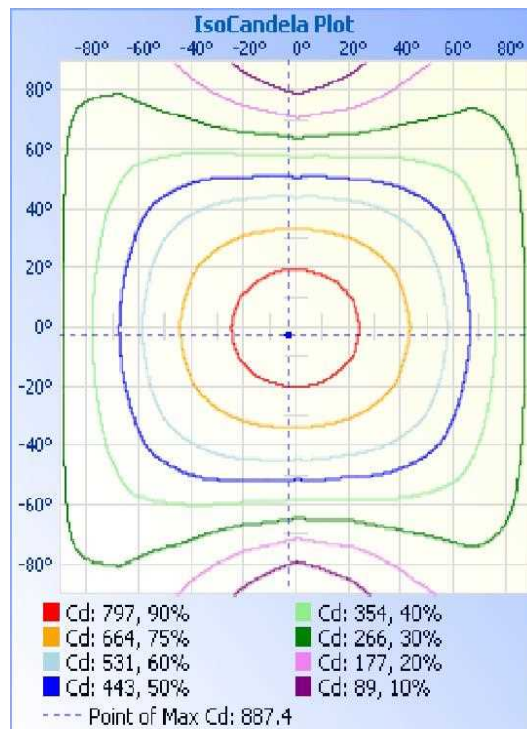





**Goniophotometer Test (Cont'd)**  
Zonal Lumen Summary

| Zonal Lumen Summary |        |             |
|---------------------|--------|-------------|
| Zone                | Lumens | % Luminaire |
| 0-30                | 677.2  | 21.30%      |
| 0-40                | 1109.5 | 35.00%      |
| 0-60                | 1994.0 | 62.90%      |
| 60-90               | 842.4  | 26.60%      |
| 70-100              | 616.1  | 19.40%      |
| 90-120              | 278.0  | 8.80%       |
| 0-90                | 2836.4 | 89.40%      |
| 90-180              | 335.9  | 10.60%      |
| 0-180               | 3172.3 | 100.00%     |

Lumens Per Zone

| Lumens Per Zone |        |        |         |        |        |
|-----------------|--------|--------|---------|--------|--------|
| Zone            | Lumens | %Total | Zone    | Lumens | %Total |
| 0-5             | 21.0   | 0.70%  | 90-95   | 74.3   | 2.30%  |
| 5-10            | 62.4   | 2.00%  | 95-100  | 61.6   | 1.90%  |
| 10-15           | 101.5  | 3.20%  | 100-105 | 50.3   | 1.60%  |
| 15-20           | 136.5  | 4.30%  | 105-110 | 39.7   | 1.30%  |
| 20-25           | 165.6  | 5.20%  | 110-115 | 30.2   | 1.00%  |
| 25-30           | 190.2  | 6.00%  | 115-120 | 21.9   | 0.70%  |
| 30-35           | 209.7  | 6.60%  | 120-125 | 15.8   | 0.50%  |
| 35-40           | 222.5  | 7.00%  | 125-130 | 11.5   | 0.40%  |
| 40-45           | 227.7  | 7.20%  | 130-135 | 8.4    | 0.30%  |
| 45-50           | 227.0  | 7.20%  | 135-140 | 6.1    | 0.20%  |
| 50-55           | 220.9  | 7.00%  | 140-145 | 4.6    | 0.10%  |
| 55-60           | 208.9  | 6.60%  | 145-150 | 3.4    | 0.10%  |
| 60-65           | 191.3  | 6.00%  | 150-155 | 2.6    | 0.10%  |
| 65-70           | 170.8  | 5.40%  | 155-160 | 2.0    | 0.10%  |
| 70-75           | 150.5  | 4.70%  | 160-165 | 1.5    | 0.00%  |
| 75-80           | 129.8  | 4.10%  | 165-170 | 1.1    | 0.00%  |
| 80-85           | 109.5  | 3.50%  | 170-175 | 0.7    | 0.00%  |
| 85-90           | 90.4   | 2.90%  | 175-180 | 0.2    | 0.00%  |



**Goniophotometer Test (Cont'd)**  
**Intensity Data(cd)**

Candela Table - Type C

|     | 0   | 22.5 | 45  | 67.5 | 90  | 112.5 | 135 | 157.5 | 180 | 202.5 | 225 | 247.5 | 270 | 292.5 | 315 | 337.5 | 360 |
|-----|-----|------|-----|------|-----|-------|-----|-------|-----|-------|-----|-------|-----|-------|-----|-------|-----|
| 0   | 876 | 876  | 876 | 876  | 876 | 876   | 876 | 876   | 876 | 876   | 876 | 876   | 876 | 876   | 876 | 876   | 876 |
| 1   | 878 | 878  | 875 | 881  | 879 | 880   | 879 | 876   | 876 | 877   | 875 | 881   | 878 | 879   | 878 | 876   | 875 |
| 2   | 880 | 879  | 876 | 882  | 881 | 882   | 883 | 880   | 878 | 878   | 876 | 882   | 880 | 882   | 881 | 879   | 877 |
| 3   | 880 | 879  | 875 | 882  | 881 | 884   | 885 | 882   | 880 | 878   | 875 | 881   | 880 | 883   | 883 | 880   | 878 |
| 4   | 879 | 878  | 874 | 880  | 880 | 885   | 886 | 883   | 880 | 876   | 872 | 879   | 879 | 883   | 885 | 882   | 878 |
| 5   | 878 | 875  | 870 | 877  | 879 | 885   | 887 | 883   | 879 | 874   | 869 | 876   | 877 | 883   | 886 | 882   | 877 |
| 6   | 877 | 872  | 867 | 874  | 878 | 884   | 887 | 882   | 877 | 871   | 866 | 873   | 875 | 883   | 885 | 881   | 875 |
| 7   | 875 | 870  | 864 | 872  | 876 | 883   | 885 | 880   | 874 | 869   | 864 | 871   | 874 | 881   | 883 | 879   | 873 |
| 8   | 872 | 868  | 862 | 870  | 874 | 881   | 882 | 877   | 872 | 867   | 861 | 868   | 872 | 879   | 881 | 877   | 871 |
| 9   | 869 | 865  | 860 | 869  | 872 | 878   | 879 | 874   | 868 | 864   | 859 | 866   | 870 | 876   | 877 | 873   | 868 |
| 10  | 865 | 862  | 859 | 867  | 870 | 874   | 875 | 869   | 864 | 860   | 857 | 864   | 866 | 872   | 872 | 868   | 864 |
| 11  | 860 | 859  | 857 | 865  | 866 | 870   | 870 | 863   | 859 | 857   | 855 | 862   | 863 | 867   | 866 | 862   | 859 |
| 12  | 855 | 856  | 855 | 863  | 863 | 866   | 864 | 857   | 854 | 854   | 853 | 860   | 860 | 862   | 861 | 856   | 853 |
| 13  | 849 | 852  | 853 | 861  | 860 | 861   | 858 | 851   | 849 | 850   | 851 | 858   | 857 | 858   | 855 | 850   | 848 |
| 14  | 843 | 847  | 850 | 858  | 857 | 857   | 852 | 845   | 843 | 846   | 847 | 856   | 854 | 854   | 849 | 843   | 842 |
| 15  | 837 | 842  | 845 | 856  | 854 | 853   | 846 | 838   | 836 | 840   | 843 | 853   | 850 | 849   | 843 | 836   | 836 |
| 16  | 829 | 835  | 840 | 852  | 851 | 848   | 841 | 832   | 829 | 833   | 838 | 849   | 847 | 844   | 836 | 829   | 828 |
| 17  | 821 | 828  | 834 | 848  | 847 | 844   | 834 | 824   | 820 | 825   | 831 | 844   | 842 | 838   | 829 | 821   | 820 |
| 18  | 812 | 820  | 828 | 842  | 843 | 838   | 827 | 816   | 812 | 817   | 824 | 837   | 837 | 832   | 822 | 813   | 811 |
| 19  | 803 | 811  | 820 | 836  | 837 | 832   | 820 | 807   | 802 | 808   | 816 | 830   | 830 | 826   | 815 | 804   | 802 |
| 20  | 794 | 801  | 811 | 827  | 830 | 826   | 812 | 799   | 793 | 798   | 807 | 822   | 823 | 819   | 807 | 795   | 792 |
| 25  | 748 | 755  | 769 | 791  | 797 | 793   | 777 | 756   | 747 | 751   | 764 | 785   | 790 | 785   | 770 | 752   | 746 |
| 30  | 697 | 709  | 733 | 762  | 772 | 765   | 740 | 711   | 698 | 705   | 726 | 753   | 762 | 755   | 732 | 706   | 696 |
| 35  | 646 | 661  | 694 | 730  | 741 | 729   | 698 | 663   | 646 | 657   | 686 | 720   | 730 | 718   | 688 | 656   | 644 |
| 40  | 584 | 605  | 646 | 690  | 705 | 691   | 650 | 606   | 585 | 597   | 635 | 677   | 692 | 677   | 637 | 597   | 584 |
| 45  | 521 | 543  | 593 | 642  | 661 | 645   | 600 | 548   | 522 | 535   | 581 | 629   | 647 | 630   | 585 | 538   | 520 |
| 50  | 457 | 483  | 542 | 598  | 618 | 599   | 546 | 488   | 457 | 476   | 529 | 582   | 602 | 583   | 531 | 477   | 457 |
| 55  | 391 | 422  | 489 | 550  | 573 | 553   | 492 | 427   | 392 | 413   | 475 | 535   | 558 | 535   | 475 | 414   | 391 |
| 60  | 324 | 361  | 434 | 498  | 524 | 502   | 438 | 363   | 322 | 348   | 418 | 482   | 507 | 482   | 418 | 350   | 322 |
| 65  | 254 | 297  | 377 | 445  | 472 | 449   | 381 | 300   | 253 | 284   | 361 | 428   | 455 | 430   | 362 | 288   | 253 |
| 70  | 190 | 239  | 325 | 395  | 424 | 400   | 330 | 244   | 189 | 228   | 310 | 379   | 406 | 380   | 312 | 232   | 192 |
| 75  | 134 | 192  | 280 | 352  | 381 | 357   | 287 | 194   | 131 | 178   | 264 | 335   | 363 | 337   | 268 | 183   | 133 |
| 80  | 79  | 146  | 239 | 312  | 340 | 316   | 245 | 150   | 77  | 134   | 224 | 295   | 322 | 297   | 227 | 138   | 78  |
| 85  | 35  | 107  | 202 | 272  | 300 | 276   | 207 | 112   | 34  | 97    | 188 | 257   | 283 | 258   | 191 | 102   | 35  |
| 90  | 7   | 77   | 168 | 234  | 259 | 237   | 174 | 82    | 8   | 68    | 154 | 218   | 243 | 220   | 157 | 73    | 7   |
| 95  | 6   | 55   | 139 | 200  | 223 | 203   | 144 | 60    | 7   | 48    | 126 | 187   | 208 | 188   | 128 | 52    | 6   |
| 100 | 6   | 41   | 114 | 172  | 193 | 176   | 119 | 45    | 7   | 36    | 103 | 159   | 180 | 160   | 105 | 38    | 6   |
| 105 | 6   | 28   | 93  | 145  | 165 | 147   | 97  | 31    | 7   | 24    | 83  | 132   | 150 | 133   | 85  | 26    | 6   |
| 110 | 6   | 19   | 69  | 120  | 138 | 122   | 74  | 22    | 6   | 17    | 61  | 108   | 125 | 109   | 64  | 18    | 7   |
| 115 | 7   | 15   | 50  | 92   | 110 | 95    | 53  | 17    | 7   | 14    | 44  | 83    | 99  | 84    | 46  | 14    | 7   |
| 120 | 7   | 12   | 37  | 68   | 81  | 70    | 40  | 14    | 7   | 11    | 33  | 60    | 73  | 62    | 35  | 12    | 7   |
| 125 | 7   | 10   | 26  | 51   | 60  | 52    | 31  | 13    | 8   | 10    | 23  | 45    | 54  | 46    | 27  | 11    | 7   |
| 130 | 8   | 10   | 18  | 39   | 45  | 40    | 25  | 12    | 8   | 10    | 17  | 34    | 40  | 34    | 21  | 10    | 8   |
| 135 | 8   | 10   | 14  | 28   | 34  | 31    | 20  | 11    | 8   | 9     | 14  | 25    | 29  | 26    | 18  | 10    | 8   |
| 140 | 9   | 9    | 12  | 18   | 26  | 24    | 17  | 11    | 9   | 9     | 11  | 17    | 22  | 21    | 15  | 10    | 9   |
| 145 | 9   | 9    | 11  | 12   | 20  | 18    | 15  | 11    | 9   | 9     | 10  | 11    | 17  | 15    | 13  | 10    | 9   |
| 150 | 10  | 9    | 10  | 10   | 15  | 15    | 12  | 11    | 10  | 9     | 9   | 9     | 12  | 13    | 11  | 10    | 10  |
| 155 | 10  | 10   | 9   | 8    | 11  | 11    | 11  | 11    | 10  | 9     | 9   | 8     | 9   | 10    | 10  | 10    | 10  |
| 160 | 11  | 10   | 9   | 7    | 8   | 10    | 11  | 11    | 11  | 10    | 8   | 7     | 7   | 9     | 10  | 10    | 11  |
| 165 | 12  | 11   | 9   | 8    | 5   | 9     | 11  | 12    | 12  | 11    | 9   | 7     | 5   | 8     | 10  | 11    | 12  |
| 170 | 12  | 12   | 10  | 7    | 6   | 8     | 10  | 12    | 12  | 12    | 9   | 7     | 5   | 7     | 9   | 12    | 12  |
| 175 | 12  | 12   | 10  | 7    | 5   | 8     | 11  | 12    | 13  | 12    | 10  | 7     | 5   | 7     | 10  | 12    | 12  |
| 180 | 10  | 10   | 10  | 10   | 10  | 10    | 10  | 10    | 10  | 10    | 10  | 10    | 10  | 10    | 10  | 10    | 10  |



### Goniophotometer Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>25W-50K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

#### Test Method

- 1.The sample was tested according to the IES LM-79-2008, and the product is assume to be brand new without seasoning.
- 2.Photometric parameters were measured using a type C goniophotometer and software.
- 3.The ambient temperature shall be maintained at 25° C ± 1° C, measured at a point not more than 1 m from the sample and at the same height as the sample. The reference standard lamp is rated current 3.8581A, 3.8558A, 3.8466A omni-directional Incandescent lamp and was calibrated by National Institute of Metrology P.R.China.
- 4.The samples were operated at rated voltage and was stabilized before measurement. Luminous flux, luminaire efficacy, zonallumen were calculated from the software taken at 1° vertical intervals and 22.5° horizontal intervals. Photometric distance was more than five times of the largest dimension of the test SSL product.

#### Goniophotometer Test Conditions

| Temperature (°C) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Current THD | Orientation |
|------------------|---------------|----------------|-------------|-----------|--------------|-------------|-------------|
| 24.9             | 120.00        | 60             | 0.2054      | 24.543    | 0.9958       | 4.97%       | Horizontal  |

#### Test Results

| Luminous Flux (lm) | Zonal Lumen Requirement 1 | Zonal Lumen Requirement 2 | Beam Angle (50%)  |                 | Luminous Efficacy (lm/W) |
|--------------------|---------------------------|---------------------------|-------------------|-----------------|--------------------------|
|                    | 0°-60°                    | N/A                       | Horizontal Spread | Vertical Spread |                          |
| 3247.1             | 63.00%                    | N/A                       | 134.3             | 103.8           | 132.30                   |


| Backlight | Uplight | Glare |
|-----------|---------|-------|
| N/A       | N/A     | N/A   |

| UGR       |         | Spacing Criteria (0-180°) | Spacing Criteria (90°-270°) |
|-----------|---------|---------------------------|-----------------------------|
| Crosswise | Endwise |                           |                             |
| N/A       | N/A     | N/A                       | N/A                         |




## Goniophotometer Test (Cont'd)

### Polar Candela Distribution

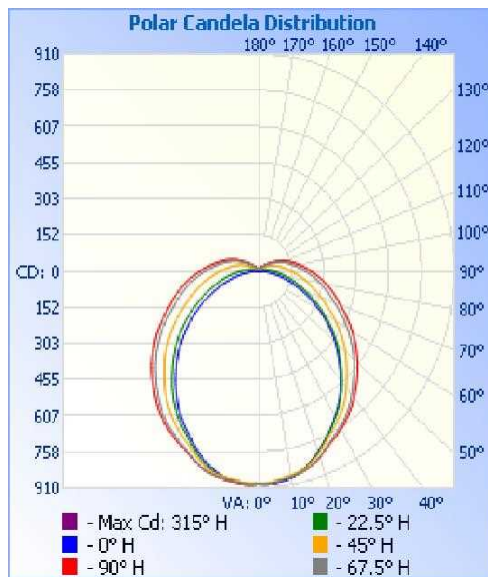

### IsoCandela Plot

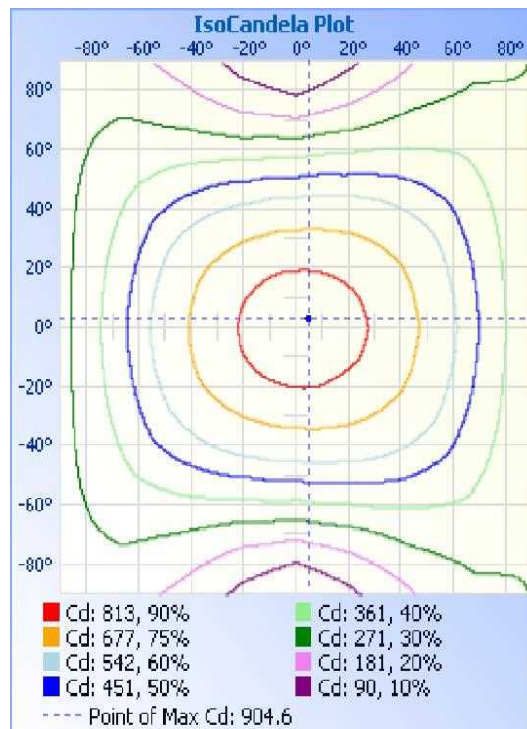



**Goniophotometer Test (Cont'd)**  
Zonal Lumen Summary

| Zonal Lumen Summary |        |             |
|---------------------|--------|-------------|
| Zone                | Lumens | % Luminaire |
| 0-30                | 690.1  | 21.30%      |
| 0-40                | 1131.4 | 34.80%      |
| 0-60                | 2036.9 | 62.70%      |
| 60-90               | 864.3  | 26.60%      |
| 70-100              | 632.4  | 19.50%      |
| 90-120              | 286.1  | 8.80%       |
| 0-90                | 2901.2 | 89.30%      |
| 90-180              | 345.9  | 10.70%      |
| 0-180               | 3247.1 | 100.00%     |

Lumens Per Zone

| Lumens Per Zone |        |        |         |        |        |
|-----------------|--------|--------|---------|--------|--------|
| Zone            | Lumens | %Total | Zone    | Lumens | %Total |
| 0-5             | 21.4   | 0.70%  | 90-95   | 76.3   | 2.40%  |
| 5-10            | 63.6   | 2.00%  | 95-100  | 63.3   | 1.90%  |
| 10-15           | 103.4  | 3.20%  | 100-105 | 51.7   | 1.60%  |
| 15-20           | 139.1  | 4.30%  | 105-110 | 41.0   | 1.30%  |
| 20-25           | 168.8  | 5.20%  | 110-115 | 31.2   | 1.00%  |
| 25-30           | 194.0  | 6.00%  | 115-120 | 22.7   | 0.70%  |
| 30-35           | 214.1  | 6.60%  | 120-125 | 16.3   | 0.50%  |
| 35-40           | 227.2  | 7.00%  | 125-130 | 11.8   | 0.40%  |
| 40-45           | 233.0  | 7.20%  | 130-135 | 8.6    | 0.30%  |
| 45-50           | 232.7  | 7.20%  | 135-140 | 6.3    | 0.20%  |
| 50-55           | 226.2  | 7.00%  | 140-145 | 4.7    | 0.10%  |
| 55-60           | 213.6  | 6.60%  | 145-150 | 3.5    | 0.10%  |
| 60-65           | 196.3  | 6.00%  | 150-155 | 2.7    | 0.10%  |
| 65-70           | 175.2  | 5.40%  | 155-160 | 2.1    | 0.10%  |
| 70-75           | 154.2  | 4.70%  | 160-165 | 1.6    | 0.00%  |
| 75-80           | 133.4  | 4.10%  | 165-170 | 1.2    | 0.00%  |
| 80-85           | 112.5  | 3.50%  | 170-175 | 0.7    | 0.00%  |
| 85-90           | 92.7   | 2.90%  | 175-180 | 0.2    | 0.00%  |



**Goniophotometer Test (Cont'd)**  
**Intensity Data(cd)**

| Candela Table - Type C |     |      |     |      |     |       |     |       |     |       |     |       |     |       |     |       |     |
|------------------------|-----|------|-----|------|-----|-------|-----|-------|-----|-------|-----|-------|-----|-------|-----|-------|-----|
|                        | 0   | 22.5 | 45  | 67.5 | 90  | 112.5 | 135 | 157.5 | 180 | 202.5 | 225 | 247.5 | 270 | 292.5 | 315 | 337.5 | 360 |
| 0                      | 892 | 892  | 892 | 892  | 892 | 892   | 892 | 892   | 892 | 892   | 892 | 892   | 892 | 892   | 892 | 892   | 892 |
| 1                      | 895 | 893  | 891 | 896  | 893 | 894   | 893 | 891   | 892 | 893   | 892 | 898   | 894 | 895   | 894 | 892   | 891 |
| 2                      | 896 | 894  | 891 | 897  | 895 | 896   | 897 | 895   | 894 | 894   | 892 | 899   | 898 | 900   | 900 | 896   | 894 |
| 3                      | 895 | 893  | 889 | 896  | 895 | 897   | 899 | 897   | 895 | 894   | 892 | 899   | 898 | 901   | 902 | 898   | 894 |
| 4                      | 895 | 892  | 887 | 894  | 893 | 898   | 900 | 898   | 895 | 894   | 890 | 898   | 898 | 902   | 904 | 899   | 894 |
| 5                      | 894 | 889  | 883 | 890  | 891 | 897   | 900 | 898   | 894 | 892   | 888 | 895   | 897 | 903   | 905 | 899   | 894 |
| 6                      | 892 | 886  | 880 | 887  | 889 | 896   | 899 | 897   | 892 | 890   | 885 | 892   | 896 | 903   | 904 | 898   | 892 |
| 7                      | 890 | 883  | 876 | 883  | 886 | 894   | 897 | 894   | 890 | 887   | 883 | 890   | 894 | 901   | 903 | 896   | 889 |
| 8                      | 887 | 880  | 873 | 881  | 884 | 892   | 894 | 892   | 888 | 885   | 881 | 889   | 894 | 900   | 900 | 893   | 886 |
| 9                      | 883 | 877  | 871 | 878  | 882 | 888   | 891 | 888   | 885 | 883   | 879 | 888   | 892 | 898   | 898 | 890   | 883 |
| 10                     | 879 | 874  | 868 | 876  | 879 | 885   | 886 | 884   | 881 | 881   | 878 | 886   | 890 | 894   | 894 | 886   | 879 |
| 11                     | 874 | 871  | 866 | 873  | 875 | 880   | 881 | 879   | 877 | 878   | 877 | 886   | 887 | 891   | 889 | 881   | 874 |
| 12                     | 869 | 867  | 864 | 871  | 872 | 875   | 875 | 872   | 871 | 875   | 876 | 884   | 884 | 886   | 883 | 874   | 869 |
| 13                     | 863 | 862  | 861 | 868  | 868 | 869   | 868 | 865   | 865 | 871   | 874 | 882   | 881 | 881   | 877 | 868   | 863 |
| 14                     | 857 | 857  | 857 | 865  | 863 | 864   | 861 | 858   | 859 | 866   | 871 | 880   | 878 | 877   | 871 | 861   | 856 |
| 15                     | 851 | 850  | 852 | 861  | 859 | 859   | 854 | 850   | 852 | 860   | 867 | 878   | 876 | 873   | 865 | 854   | 849 |
| 16                     | 843 | 843  | 847 | 857  | 855 | 853   | 848 | 843   | 845 | 854   | 862 | 875   | 873 | 869   | 859 | 847   | 842 |
| 17                     | 834 | 836  | 840 | 852  | 851 | 848   | 841 | 836   | 837 | 847   | 856 | 871   | 870 | 864   | 853 | 839   | 834 |
| 18                     | 825 | 828  | 832 | 845  | 845 | 842   | 834 | 828   | 829 | 840   | 850 | 866   | 866 | 860   | 847 | 832   | 826 |
| 19                     | 816 | 819  | 824 | 838  | 839 | 836   | 827 | 819   | 821 | 832   | 842 | 859   | 860 | 854   | 840 | 824   | 816 |
| 20                     | 806 | 810  | 815 | 830  | 832 | 829   | 820 | 810   | 812 | 823   | 834 | 851   | 854 | 848   | 834 | 816   | 807 |
| 25                     | 760 | 758  | 769 | 789  | 794 | 792   | 779 | 765   | 762 | 775   | 793 | 817   | 822 | 817   | 797 | 772   | 759 |
| 30                     | 708 | 712  | 730 | 756  | 766 | 761   | 742 | 721   | 716 | 732   | 758 | 790   | 799 | 790   | 762 | 729   | 709 |
| 35                     | 656 | 661  | 689 | 720  | 732 | 722   | 695 | 667   | 662 | 684   | 721 | 759   | 770 | 755   | 718 | 677   | 655 |
| 40                     | 594 | 600  | 634 | 675  | 691 | 680   | 645 | 610   | 602 | 628   | 673 | 719   | 735 | 718   | 673 | 623   | 595 |
| 45                     | 530 | 539  | 580 | 626  | 647 | 633   | 593 | 551   | 539 | 567   | 621 | 674   | 692 | 673   | 623 | 564   | 531 |
| 50                     | 466 | 478  | 526 | 580  | 601 | 584   | 536 | 488   | 474 | 507   | 570 | 628   | 649 | 626   | 568 | 503   | 466 |
| 55                     | 398 | 412  | 470 | 529  | 552 | 533   | 478 | 421   | 403 | 443   | 515 | 579   | 603 | 578   | 512 | 439   | 397 |
| 60                     | 326 | 346  | 412 | 476  | 503 | 483   | 421 | 356   | 334 | 378   | 458 | 528   | 553 | 527   | 457 | 375   | 327 |
| 65                     | 256 | 283  | 354 | 423  | 452 | 430   | 365 | 293   | 264 | 314   | 400 | 472   | 499 | 473   | 400 | 313   | 258 |
| 70                     | 193 | 223  | 304 | 373  | 402 | 380   | 313 | 234   | 197 | 255   | 346 | 419   | 448 | 420   | 347 | 254   | 192 |
| 75                     | 132 | 174  | 258 | 331  | 361 | 338   | 269 | 185   | 137 | 202   | 299 | 374   | 403 | 376   | 301 | 202   | 133 |
| 80                     | 77  | 131  | 219 | 292  | 321 | 298   | 229 | 140   | 82  | 156   | 256 | 332   | 359 | 333   | 258 | 158   | 78  |
| 85                     | 34  | 94   | 184 | 253  | 281 | 259   | 193 | 103   | 38  | 115   | 214 | 288   | 315 | 289   | 217 | 117   | 33  |
| 90                     | 7   | 67   | 151 | 216  | 243 | 222   | 160 | 75    | 8   | 82    | 179 | 247   | 273 | 249   | 181 | 85    | 7   |
| 95                     | 7   | 48   | 125 | 186  | 209 | 190   | 132 | 55    | 6   | 58    | 147 | 211   | 235 | 212   | 150 | 62    | 6   |
| 100                    | 7   | 36   | 103 | 159  | 181 | 162   | 109 | 42    | 6   | 42    | 120 | 181   | 200 | 182   | 123 | 46    | 7   |
| 105                    | 7   | 24   | 84  | 134  | 154 | 136   | 89  | 29    | 7   | 29    | 97  | 151   | 170 | 152   | 99  | 30    | 7   |
| 110                    | 7   | 18   | 62  | 110  | 129 | 113   | 68  | 21    | 7   | 20    | 73  | 124   | 142 | 125   | 74  | 20    | 7   |
| 115                    | 8   | 14   | 45  | 85   | 102 | 88    | 50  | 16    | 7   | 15    | 51  | 96    | 113 | 97    | 54  | 16    | 8   |
| 120                    | 8   | 12   | 34  | 62   | 76  | 65    | 38  | 14    | 7   | 12    | 38  | 69    | 83  | 71    | 40  | 14    | 8   |
| 125                    | 8   | 11   | 24  | 47   | 57  | 49    | 29  | 13    | 7   | 10    | 28  | 52    | 61  | 52    | 31  | 13    | 8   |
| 130                    | 9   | 10   | 17  | 36   | 43  | 37    | 23  | 12    | 8   | 10    | 19  | 38    | 45  | 39    | 24  | 12    | 8   |
| 135                    | 9   | 10   | 14  | 26   | 32  | 29    | 20  | 11    | 8   | 9     | 15  | 29    | 33  | 30    | 20  | 11    | 9   |
| 140                    | 10  | 10   | 12  | 17   | 24  | 23    | 16  | 11    | 9   | 9     | 12  | 19    | 25  | 23    | 16  | 11    | 9   |
| 145                    | 10  | 10   | 11  | 11   | 19  | 17    | 14  | 11    | 9   | 9     | 11  | 12    | 19  | 18    | 15  | 11    | 10  |
| 150                    | 11  | 10   | 10  | 10   | 14  | 14    | 12  | 11    | 9   | 10    | 10  | 10    | 13  | 14    | 12  | 11    | 10  |
| 155                    | 11  | 11   | 9   | 8    | 10  | 11    | 11  | 11    | 10  | 10    | 8   | 8     | 10  | 11    | 11  | 11    | 11  |
| 160                    | 12  | 11   | 10  | 7    | 8   | 10    | 11  | 11    | 11  | 10    | 9   | 7     | 8   | 9     | 11  | 11    | 12  |
| 165                    | 13  | 12   | 10  | 8    | 6   | 9     | 11  | 12    | 12  | 11    | 9   | 7     | 5   | 8     | 10  | 12    | 12  |
| 170                    | 13  | 13   | 10  | 7    | 5   | 8     | 11  | 12    | 12  | 12    | 9   | 7     | 5   | 8     | 11  | 13    | 14  |
| 175                    | 14  | 13   | 11  | 8    | 5   | 8     | 10  | 12    | 12  | 12    | 10  | 7     | 5   | 8     | 11  | 13    | 13  |
| 180                    | 10  | 10   | 10  | 10   | 10  | 10    | 10  | 10    | 10  | 10    | 10  | 10    | 10  | 10    | 10  | 10    | 10  |



### THD and PF Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>15W-35K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

#### Test Method

1. The samples were tested according to the ANSI C82.77-10-2014.  
 2. The ambient temperature condition was maintained at 25 °C ± 1 °C. The sample measurement was made using a digital power meter and power supply. The sample was operated at rated voltage and stabilized before measurement. The total harmonic distortion were calculated from the digital power meter.

#### Test Results

| Temperature (°C) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Current THD | Orientation |
|------------------|---------------|----------------|-------------|-----------|--------------|-------------|-------------|
| 24.9             | 120.05        | 60             | 0.1360      | 16.17     | 0.9905       | 7.62%       | Horizontal  |
| 24.9             | 277.07        | 60             | 0.0654      | 16.37     | 0.9045       | 9.85%       | Horizontal  |



## THD and PF Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>20W-35K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

### Test Method

1. The samples were tested according to the ANSI C82.77-10-2014.
2. The ambient temperature condition was maintained at 25 °C ± 1 °C. The sample measurement was made using a digital power meter and power supply. The sample was operated at rated voltage and stabilized before measurement. The total harmonic distortion were calculated from the digital power meter.

### Test Results

| Temperature (°C) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Current THD | Orientation |
|------------------|---------------|----------------|-------------|-----------|--------------|-------------|-------------|
| 24.9             | 120.12        | 60             | 0.1728      | 20.64     | 0.9951       | 5.33%       | Horizontal  |
| 24.9             | 277.10        | 60             | 0.0804      | 20.77     | 0.9317       | 8.96%       | Horizontal  |





## THD and PF Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>25W-35K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

### Test Method

1. The samples were tested according to the ANSI C82.77-10-2014.
2. The ambient temperature condition was maintained at  $25\text{ }^{\circ}\text{C} \pm 1\text{ }^{\circ}\text{C}$ . The sample measurement was made using a digital power meter and power supply. The sample was operated at rated voltage and stabilized before measurement. The total harmonic distortion were calculated from the digital power meter.

### Test Results

| Temperature ( $^{\circ}\text{C}$ ) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Current THD | Orientation |
|------------------------------------|---------------|----------------|-------------|-----------|--------------|-------------|-------------|
| 24.9                               | 120.01        | 60             | 0.2069      | 24.73     | 0.9959       | 4.94%       | Horizontal  |
| 24.9                               | 277.09        | 60             | 0.0940      | 24.72     | 0.9492       | 7.22%       | Horizontal  |



### THD and PF Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>25W-40K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

#### Test Method

1. The samples were tested according to the ANSI C82.77-10-2014.  
 2. The ambient temperature condition was maintained at 25 °C ± 1 °C. The sample measurement was made using a digital power meter and power supply. The sample was operated at rated voltage and stabilized before measurement. The total harmonic distortion were calculated from the digital power meter.

#### Test Results

| Temperature (°C) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Current THD | Orientation |
|------------------|---------------|----------------|-------------|-----------|--------------|-------------|-------------|
| 24.9             | 120.02        | 60             | 0.2006      | 23.96     | 0.9957       | 4.40%       | Horizontal  |
| 24.9             | 277.05        | 60             | 0.0917      | 24.10     | 0.9466       | 7.89%       | Horizontal  |



## THD and PF Test

|                            |                  |                                  |         |
|----------------------------|------------------|----------------------------------|---------|
| <b>Model No.</b>           | 55452<br>25W-50K | <b>Sample ID.</b>                | 4067651 |
| <b>Operate time (Min.)</b> | 90               | <b>Stabilization time (Min.)</b> | 45      |

### Test Method

1. The samples were tested according to the ANSI C82.77-10-2014.
2. The ambient temperature condition was maintained at  $25\text{ }^{\circ}\text{C} \pm 1\text{ }^{\circ}\text{C}$ . The sample measurement was made using a digital power meter and power supply. The sample was operated at rated voltage and stabilized before measurement. The total harmonic distortion were calculated from the digital power meter.

### Test Results

| Temperature ( $^{\circ}\text{C}$ ) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Current THD | Orientation |
|------------------------------------|---------------|----------------|-------------|-----------|--------------|-------------|-------------|
| 24.9                               | 120.00        | 60             | 0.2053      | 24.54     | 0.9958       | 4.97%       | Horizontal  |
| 24.9                               | 277.07        | 60             | 0.0934      | 24.56     | 0.9488       | 7.35%       | Horizontal  |



### In-Situ Temperature Measurement Test

|                  |                  |                   |         |
|------------------|------------------|-------------------|---------|
| <b>Model No.</b> | 55452<br>25W-35K | <b>Sample ID.</b> | 4067651 |
|------------------|------------------|-------------------|---------|

#### Test Method

1. In-Situ Temperature Measurement Test is conducted according to the UL 1598-2008, Section 14.  
 2. The testing was conducted in a room with ambient temperature of 25 °C ± 5 °C. The apparatus construction followed those described in UL1598-2008 for normal temperature testing. Thermocouples were placed on the LED package in the locations indicated by LM-80 report. Thermocouples were placed on the LED driver case in the locations specified by the manufacture if necessary. The temperature was recorded after the lamp was operated by 7.5 hours.  
 3. The data and photos in LM-80 test report is provided by the customer/ The data and photos in driver specification is provided by the customer.

#### In-Situ Temperature Measurement Test Conditions

| Temperature (°C) | Voltage (Vac) | Frequency (Hz) | Current (A) | Power (W) | Power Factor | Current THD | Orientation |
|------------------|---------------|----------------|-------------|-----------|--------------|-------------|-------------|
| 24.7             | 120.01        | 60             | 0.2069      | 24.73     | 0.9959       | 4.94%       | Horizontal  |

#### Test Results (LEDs)

| Thermocouple Location | Declared Light Source Current (mA) | Temperature for Light Source (°C) |                                | Max Chromaticity Shift (1000-6000h) | LED Model Number | LM-80 Limit Current (mA) | LM-80 Limit Temp (°C) |
|-----------------------|------------------------------------|-----------------------------------|--------------------------------|-------------------------------------|------------------|--------------------------|-----------------------|
|                       |                                    | Test Result                       | Test Result (Correct to 25 °C) |                                     |                  |                          |                       |
| Ambient TEMP          | N/A                                | 24.7                              | 25.0                           |                                     |                  |                          |                       |
| TMP of Location 1     | 110                                | 67.3                              | 67.6                           | 0.0024                              | STW8A2PD-XX      | 200                      | 105                   |




#### Test Results (Drivers)

| Thermocouple Location | Temperature for Driver (°C) |                                | Driver Model Number            | Driver Limit Temp (°C) |
|-----------------------|-----------------------------|--------------------------------|--------------------------------|------------------------|
|                       | Test Result                 | Test Result (Correct to 25 °C) |                                |                        |
| Ambient TEMP          | 24.7                        | 25.0                           |                                |                        |
| TMP of Location 1     | 55.5                        | 55.8                           | SIL 60-I550 120-277 W D1+D3 P3 | 90                     |



## In-Situ Temperature Measurement Test (Cont'd)

### Test Photos for Ts Point of Light Sources & Tc Point of Drivers

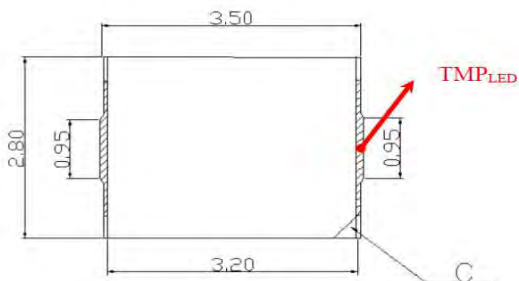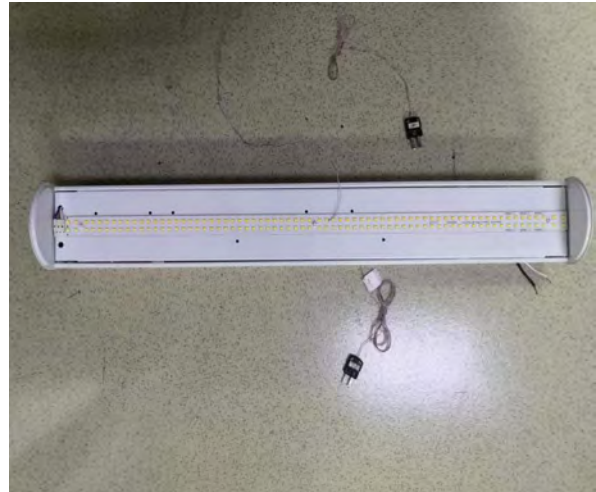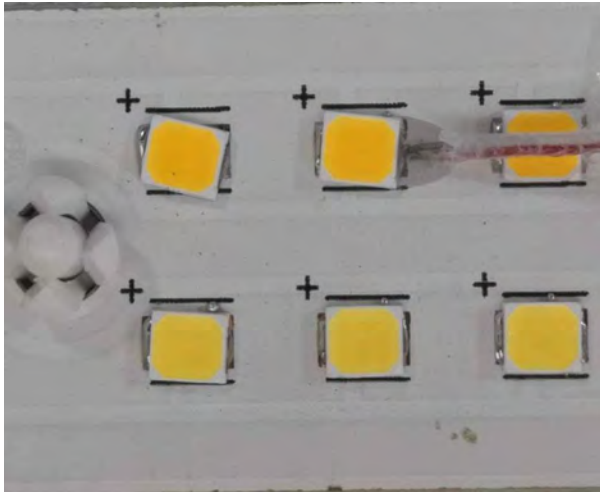



\*\*\*\*\* END OF REPORT. THIS PAGE INTENTIONALLY LEFT BLANK \*\*\*\*\*