



Date of issue 2022-05-31

Version 1.0

Total pages 20

**Test report of**

**IES LM-79-08**

**Approved Method: Electrical and Photometric**

**Measurements of Solid-State Lighting Products**

**Applicant:**

P.Q.L., Inc.

**Address:**

2285 Ward Avenue / Simi Valley, CA 93065

**For Product:**

High Bay Luminaires (Commercial and Industrial)

**Model No.:**

CHB3-100-D-HV-30K-170S, CHB3-100-D-HV-65K-170S were selected as the representative models. All measurements are the same except CCT.

Test laboratory: Shenzhen Belling Efficiency Testing Lab Co., Ltd, 1Floor, No.1 Building, Meibaohe Industrial Park, Dalang Street, Longhua District, Shenzhen, Guangdong Prov.518101 China.

---

Complied by: Sam Chen

Review by: Jason Zhou

---

Project Engineer

Technical Manager

Note: The test data was only valid for the test sample(s). This test report is prepared for the customer shown above and for the device described herein. It may not be duplicated or use in part without prior written consent from Shenzhen Belling Efficiency Testing Lab Co., Ltd. This report must not be used by the customer to claim product certification, approval, or endorsement By NVLAP, NIST, or any agency of the U.S. Government.



# 1 General

## 1.1 Product Information

<b>Manufacturer</b>	P.Q.L., Inc.
<b>Manufacturer Address</b>	2285 Ward Avenue Simi Valley, CA 93065
<b>Brand Name</b>	PQL
<b>Luminaire Type</b>	High Bay Luminaires (Commercial and Industrial)
<b>Model Number</b>	CHB3-100-D-HV-30K-170S, CHB3-100-D-HV-65K-170S
<b>Rated Inputs</b>	AC 277-480V, 50/60Hz
<b>Rated Power</b>	100 W
<b>Nominal CCT</b>	3000K, 6500K
<b>Dimming Capability</b>	Continuous, 0-10V
<b>Integral Control Sensors</b>	No
<b>Date of Receipt Samples</b>	2022-04-26
<b>Date of test</b>	2022-04-27 to 2022-05-24
<b>Burning Time Before Test</b>	0hour(For New Products)

## 1.2 Standards or methods

- ANSI C78.377-2017:Specifications for the Chromaticity of Solid State Lighting Products
- ANSI C82.77-10:2014:Harmonic Emission Limits - Related Power Quality Requirements for Lighting Equipment - Solid State
- CIE Publication No.13.3-1995:Method of Measuring and Specifying Color Rendering of Light Sources
- IESNA LM-79-08 Approved Method: Electric & Photometric Measurement of Solid-state Lighting Products



### 1.3 Equipment list

Device	Manufacture	Model No.	Serial No.	Calibration due date
Goniophotometric System	SENSING	GMS-3000	N.A	2023-04-08
AC Power Source	ALL POWER	APW-105N	970780	2023-04-10
Total Luminous Flux Standard Lamp	SENSING	110V/100W	S13100188	2023-03-30
Total Luminous Flux Standard Lamp	OSRAM	12V/20W	LSD1220173	2023-03-30
Digital Power Meter	YOKOGAWA	WT310	C2QM02030V	2023-04-10
Thermostatic stabilized photometric sphere	SENSING	SPR-600M	N.A	2023-04-08
Digital Power Meter	YOKOGAWA	WT210	91L929742	2023-04-10
Spectral radiometer	SENSING	SPR-3000	S1101108	2023-04-08
Environment Measurer	XUYAO	HS-1	N/A	2023-03-30
Environment Measurer	XUYAO	HS-1	N/A	2023-03-30
Stop watch	KISLO	K610	N/A	2023-04-14
Digital Anemometer	TECMAN	TD8901	026141	2022-09-08

Statement of Traceability: Shenzhen Belling Efficiency Testing Lab Co., Ltd attests that all calibration has been performed using suitable standards traceable to national primary standards and International System of Unit (SI).



## 2 Test conducted and method

### 2.1 Ambient Condition

The ambient temperature in which measurements are being taken was maintained at  $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$ , the air flow around the sample(s) being tested did not affect the performance.

### 2.2 Power Supply Characteristics

The AC power supply had a sinusoidal voltage wave shape at the prescribed frequency (60 Hz) such that the RMS summation of the harmonic components does not exceed 3 percent of the fundamental during operation of the test item.

The voltage of AC power supply (RMS voltage) applied to the device under test was regulated to within  $\pm 0.2$  percent under load.

### 2.3 Seasoning and Stabilization

No seasoning was performed in accordance with IESNA LM-79-08. And before the measurement, the sample was stabilized until the light output and power variations were less than 0.5% in 30 minutes intervals (3 readings, 15 minutes apart).

### 2.4 Integrating Sphere System

The system includes AC power source, digital power meter, DC power supply, spectrophotometer, and integrating sphere. The integrating sphere system is calibrated by standard light source before measurement. The system and standard light source has been calibrated regularly and traceable to the National Primary Standards.  $4\pi$  geometry was used during measurement. The product was operated in its intended orientation in application and was recorded in this report.

Integrating Sphere Uncertainty: The uncertainty of the light output (luminous flux) measurements is  $U=1.8\%$  ( $K=2$ ), at the 95% confidence level. The uncertainty of the correlated color temperature measurements is  $U=20\text{K}$  ( $K=2$ ), at the 95% confidence level. The uncertainty of the CRI is  $U=1.8(K=2)$ , at the 95% confidence level. The uncertainty of power meter AC current  $U=0.18\%$  of rdg, AC Voltage  $U=0.16\%$  of rdg, Power  $U=0.20\%$  ( $K=2$ ), at the 95% confidence level.



## 2.5 Goniophotometer System

The goniophotometer system is calibrated by standard light source before measurement. The standard light source has been calibrated regularly and traceable to the National Primary Standards.

Type C goniophotometer was used for measuring total luminous flux, luminous intensity distribution, and color spatial uniformity. The product was operated in its intended orientation in application and was recorded in this report. The method according to IESNA LM-79-08 following chapter.

Goniophotometer Uncertainty :The uncertainty of the luminous intensity is  $U=1.6\%$  ( $K=2$ ), at the 95% confidence level.



## 3 Test Result Summary

### 3.1 Integrating Sphere System (Total operating time for integrating sphere test: 1.0 hour)

#### 3.1.1 Model Number: CHB3-100-D-HV-30K-170S

##### Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
277.03	60	0.365	100.68	0.995

##### Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
15816.74	157.1	2894


##### Chromaticity Coordinate

Duv	x	y	u'	v'
-0.00056	0.4438	0.4049	0.2547	0.5227

##### Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
73.3	-16	75	96	-14

##### Spectral Distribution

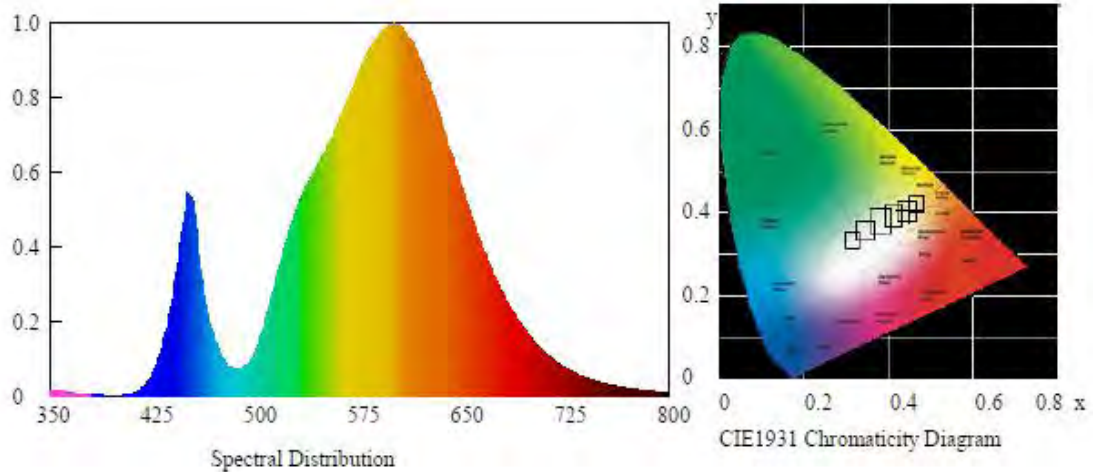









### 7/4 Step Quadrangle

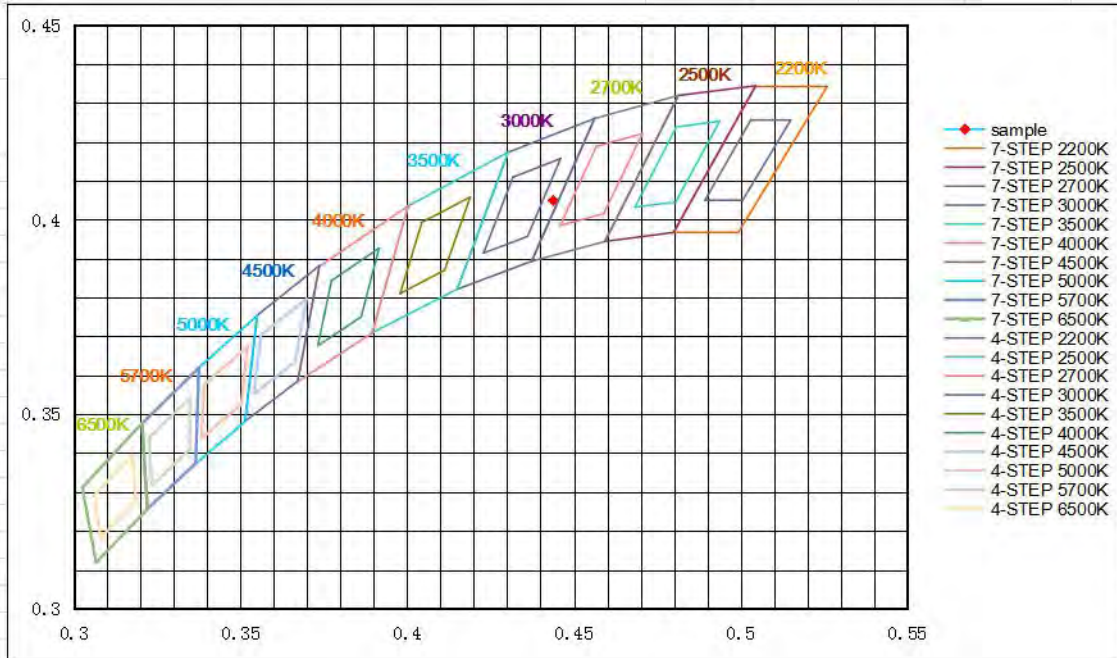



### ANSI/IES TM-30-18 Color Rendition Report

<b>Source:</b>	BL220426013-9	<b>Manufacturer:</b>	P.Q.L., Inc.
<b>Date:</b>	2022-05-31	<b>Model:</b>	CHB3-100-D-HV-30K-170S

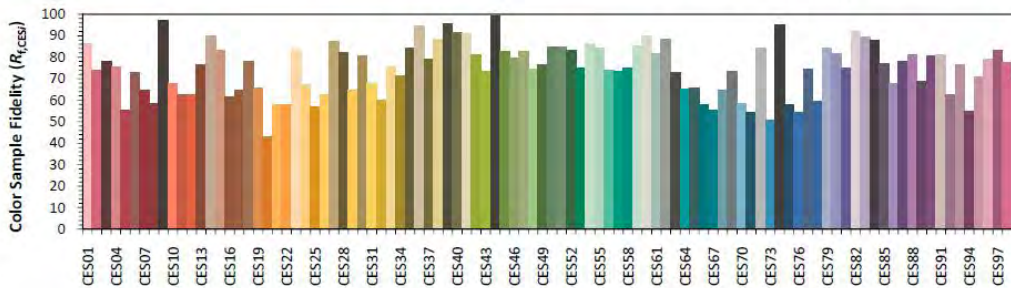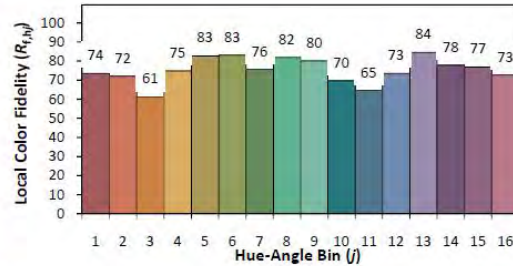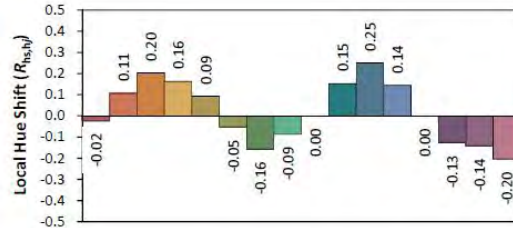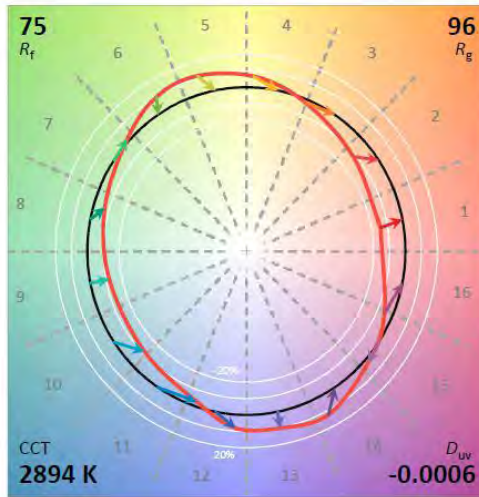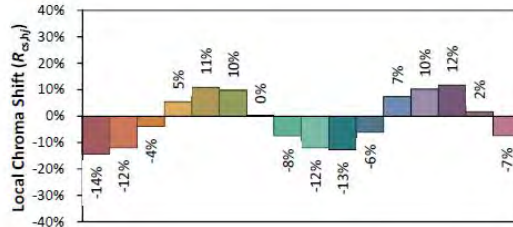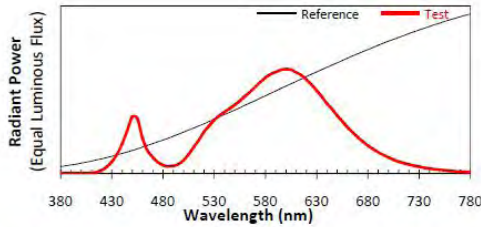

**Notes:** This is a recommended method for displaying ANSI/IES TM-30-18 information.

$x$  0.4438  
 $y$  0.4049  
 $u'$  0.2547  
 $v'$  0.5227

CIE 13.3-1995 (CRI)	
$R_a$	73
$R_g$	-16

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.





### 3.1.2 Model Number: CHB3-100-D-HV-65K-170S

#### Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
277.09	60	0.366	101.18	0.997

#### Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
17534.38	173.3	6372


#### Chromaticity Coordinate

Duv	x	y	u'	v'
+0.0062	0.3143	0.3365	0.1961	0.4725

#### Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
71.4	-31	73	91	-18

#### Spectral Distribution

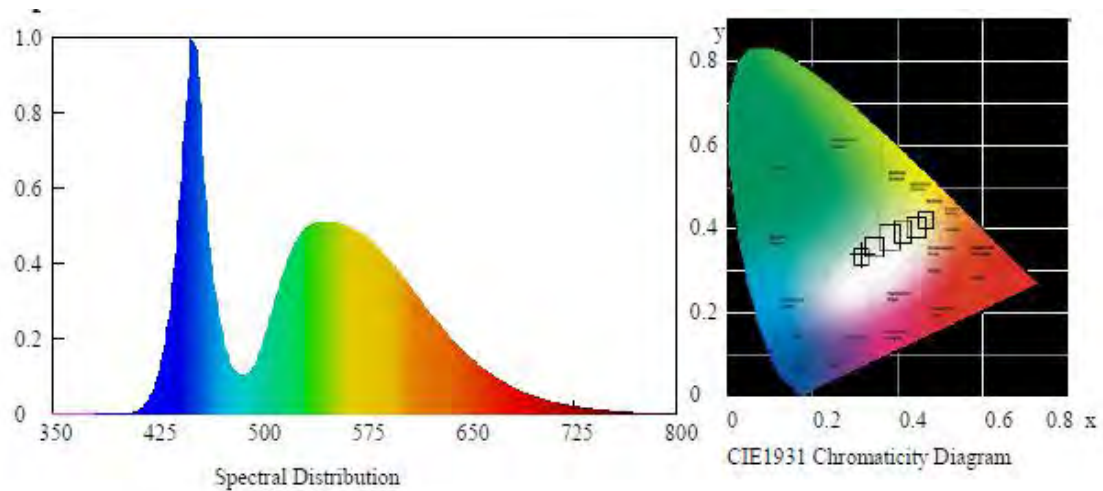









### 7/4 Step Quadrangle

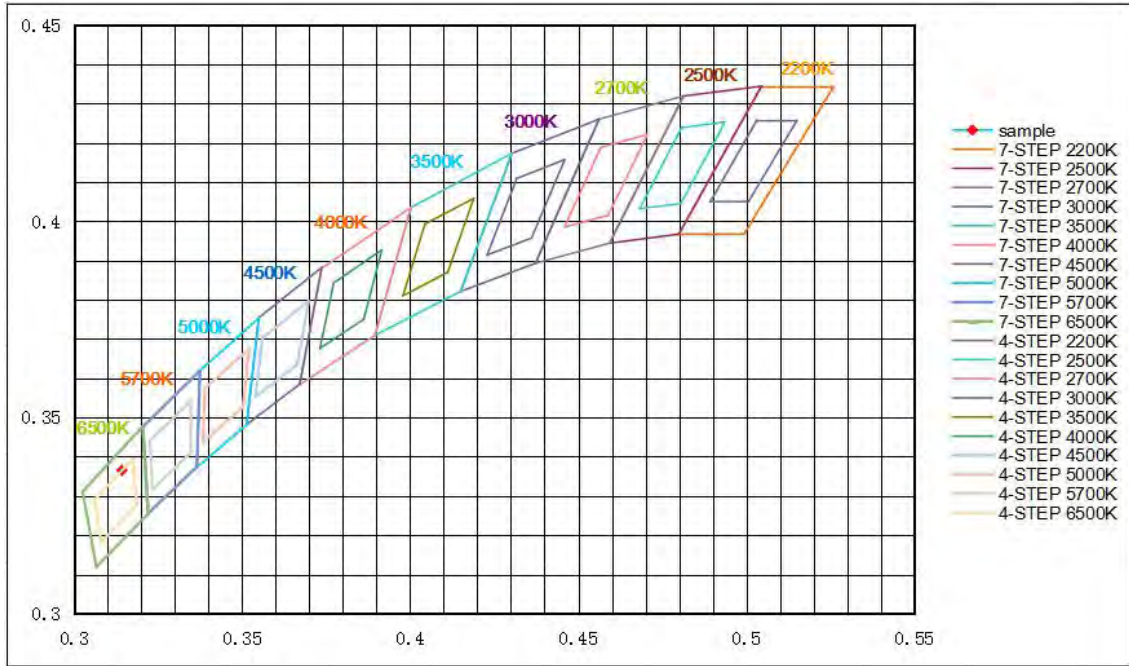



### ANSI/IES TM-30-18 Color Rendition Report

<b>Source:</b>	BL220426013-9	<b>Manufacturer:</b>	P.Q.L., Inc.
<b>Date:</b>	2022-05-31	<b>Model:</b>	CHB3-100-D-HV-65K-170S

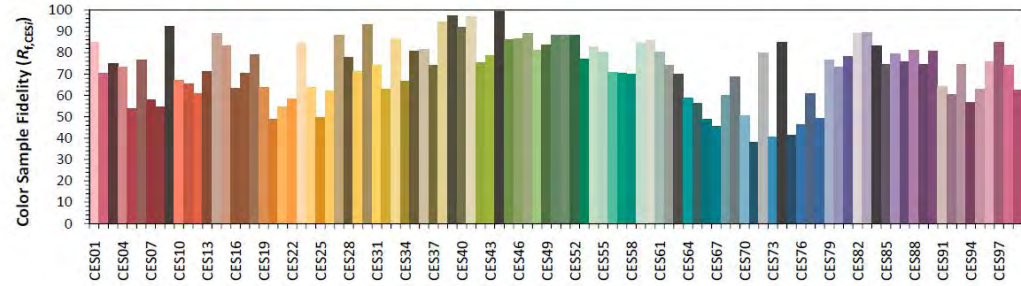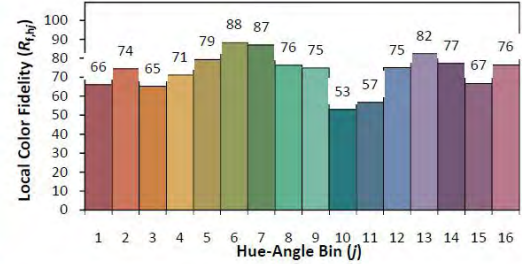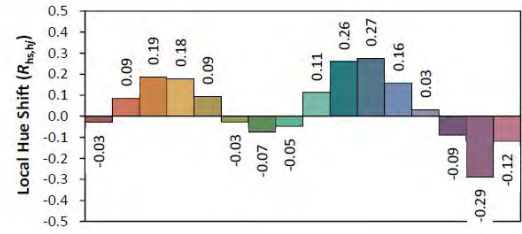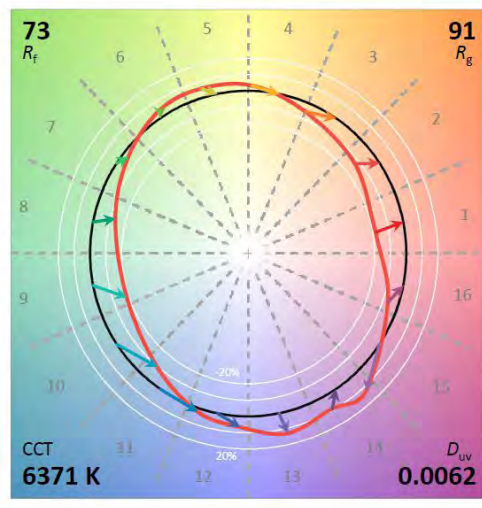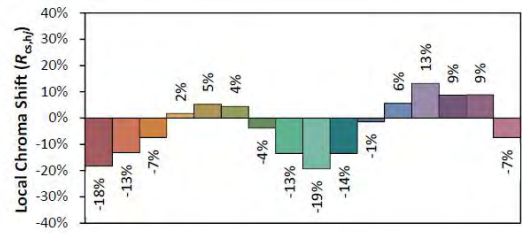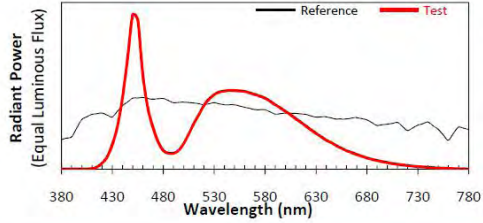

**Notes:** This is a recommended method for displaying ANSI/IES TM-30-18 information.

$x$  0.3143  
 $y$  0.3365  
 $u'$  0.1961  
 $v'$  0.4725

CIE 13.3-1995 (CRI)	
$R_a$	72
$R_g$	-32

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.



### 3.2 Goniophotometer System (Total operating time for luminous intensity distribution: 1.0 hour)

#### 3.2.1 Model Number: CHB3-100-D-HV-30K-170S

##### Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
277.03	60	0.3680	101.28	0.9939

##### Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	Zonal Lumen in 20-50°(%lm)
15944.52	157.43	52.53



## Zonal Flux Diagram



Zonal flux distribution table

$\gamma(^{\circ})$	Average I(cd)	Zonal F(lm)	Sum F(lm)	Eff Flux(%)	Eff Sum(%)
0.0	5843.217	0.000	0	0.00%	0.00%
5.0	5817.801	139.404	139.404	0.00%	0.87%
10.0	5731.386	413.151	552.555	0.00%	3.47%
15.0	5602.579	672.323	1224.878	0.00%	7.68%
20.0	5427.525	909.035	2133.914	0.00%	13.38%
25.0	5212.895	1115.984	3249.897	0.00%	20.38%
30.0	5003.453	1292.887	4542.785	0.00%	28.49%
35.0	4674.468	1425.142	5967.926	0.00%	37.43%
40.0	4331.920	1502.648	7470.574	0.00%	46.85%
45.0	3945.127	1532.562	9003.136	0.00%	56.47%
50.0	3506.381	1505.686	10508.822	0.00%	65.91%
55.0	3021.789	1419.441	11928.264	0.00%	74.81%
60.0	2472.912	1270.085	13198.348	0.00%	82.78%
65.0	1867.086	1055.062	14253.41	0.00%	89.39%
70.0	1250.826	789.476	15042.885	0.00%	94.35%
75.0	704.069	510.978	15553.864	0.00%	97.55%
80.0	272.615	261.333	15815.197	0.00%	99.19%
85.0	56.755	89.498	15904.695	0.00%	99.75%
90.0	1.749	16.019	15920.714	0.00%	99.85%
95.0	1.290	0.832	15921.546	0.00%	99.86%
100.0	1.349	0.717	15922.263	0.00%	99.86%
105.0	1.645	0.801	15923.064	0.00%	99.87%
110.0	2.268	1.023	15924.087	0.00%	99.87%
115.0	2.816	1.287	15925.374	0.00%	99.88%
120.0	3.483	1.531	15926.906	0.00%	99.89%
125.0	4.195	1.775	15928.68	0.00%	99.90%
130.0	4.951	1.989	15930.669	0.00%	99.91%
135.0	5.440	2.100	15932.769	0.00%	99.93%
140.0	5.855	2.091	15934.86	0.00%	99.94%
145.0	6.255	2.020	15936.88	0.00%	99.95%
150.0	6.611	1.895	15938.775	0.00%	99.96%
155.0	6.863	1.705	15940.48	0.00%	99.97%
160.0	6.908	1.444	15941.924	0.00%	99.98%
165.0	6.833	1.132	15943.057	0.00%	99.99%
170.0	6.789	0.808	15943.865	0.00%	100.00%
175.0	6.922	0.490	15944.355	0.00%	100.00%
180.0	7.227	0.169	15944.524	0.00%	100.00%



### Luminous Intensity Distribution Diagram

Light Distribution Curve [Unit:cd]

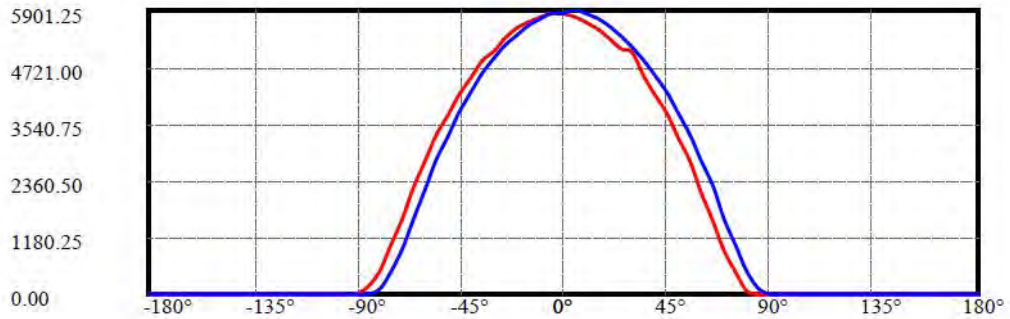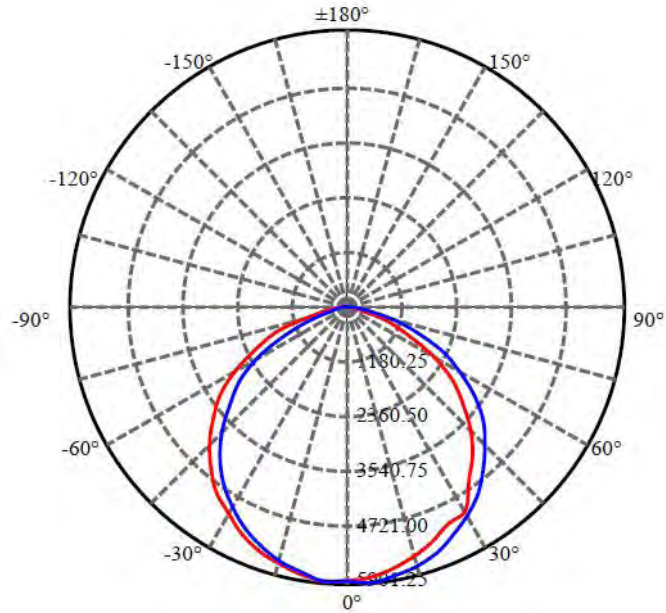

C0/C180: —

C90/C270: —

Field angle(10%Imax):C0/180Left:78.9 Right:73.4


:C90/270Left:73.5 Right:78.8

Beam Angle(50%Imax):C0/180Left:58.5 Right:53.3

:C90/270Left:53.4 Right:58.5



Lux distance Curve

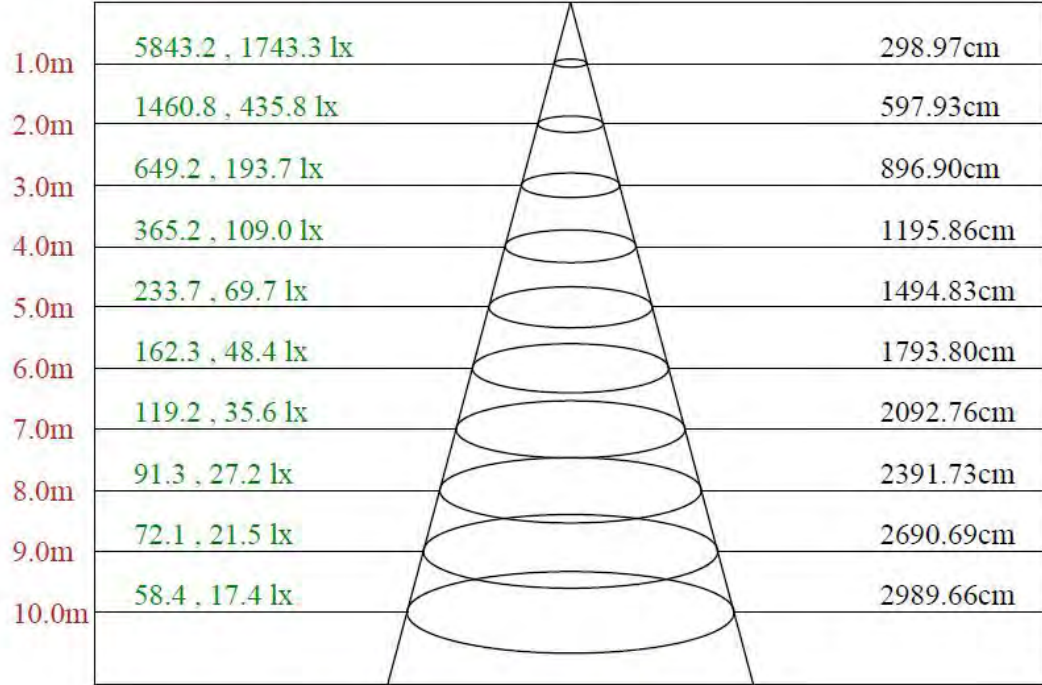

Max , Ave      Beam angle of C90 plane 112.44



**UGR Glare**

Illumination assessment according UGR											
Rf of Ceiling	70	70	50	50	30	70	70	50	50	30	
Rf of Wall	50	30	50	30	30	50	30	50	30	30	
Rf of Floor	20	20	20	20	20	20	20	20	20	20	
Room dimensions		Viewed crosswise					Viewed endwise				
X	Y										
2H	2H	19.78	21.38	20.14	21.70	22.02	20.27	21.87	20.63	22.19	22.51
	3H	20.78	22.22	21.16	22.56	22.91	21.76	23.21	22.15	23.55	23.89
	4H	20.95	22.30	21.34	22.66	23.02	22.23	23.59	22.63	23.94	24.31
	6H	20.96	22.22	21.37	22.59	22.98	22.51	23.76	22.92	24.13	24.53
	8H	20.91	22.12	21.32	22.49	22.90	22.54	23.75	22.95	24.13	24.53
4H	12H	20.85	22.01	21.27	22.40	22.81	22.52	23.68	22.94	24.07	24.48
	2H	20.20	21.56	20.60	21.91	22.27	20.62	21.97	21.01	22.32	22.69
	3H	21.33	22.47	21.74	22.86	23.27	22.16	23.31	22.58	23.69	24.10
	4H	21.59	22.60	22.02	23.02	23.46	22.68	23.69	23.12	24.11	24.55
	6H	21.58	22.48	22.05	22.92	23.37	22.94	23.83	23.40	24.27	24.72
8H	8H	21.55	22.39	22.03	22.84	23.30	23.00	23.84	23.48	24.29	24.75
	12H	21.53	22.30	22.01	22.74	23.25	23.02	23.80	23.50	24.24	24.75
	4H	21.63	22.47	22.10	22.91	23.38	22.68	23.51	23.15	23.96	24.42
	6H	21.62	22.32	22.12	22.79	23.29	22.92	23.62	23.42	24.09	24.59
	8H	21.64	22.25	22.16	22.76	23.25	23.04	23.65	23.56	24.16	24.65
12H	12H	21.61	22.12	22.14	22.63	23.14	23.06	23.57	23.59	24.08	24.59
	4H	21.61	22.39	22.09	22.83	23.33	22.65	23.43	23.13	23.87	24.37
	6H	21.64	22.25	22.16	22.76	23.25	22.94	23.54	23.45	24.05	24.54
	8H	21.62	22.13	22.15	22.64	23.15	23.01	23.52	23.54	24.03	24.54
Variation with the observer position at spacings:											
S = 1.0H	0.4/-0.4					0.5/-0.4					
S = 1.5H	0.8/-0.8					0.6/-1.1					
S = 2.0H	1.6/-1.8					1.9/-1.9					
Standard tables:	BK2					BK2					
Uncorrected UGR	5.0					3.9					

UGR calculation is based on CIE Publ. 117 ,S/H = 1



**Luminous Intensity Distribution Data**

C/ $\gamma$ (°)	0.0	5.0	10.0	15.0	20.0	25.0	30.0	35.0	40.0
0.0	5843.22	5754.21	5649.86	5505.20	5320.21	5097.28	5004.79	4505.33	4145.79
22.5	5843.22	5761.33	5666.46	5512.31	5322.58	5094.91	4995.30	4523.59	4170.22
45.0	5843.22	5773.19	5671.21	5531.28	5334.44	5111.51	4853.01	4544.93	4174.96
67.5	5843.22	5777.93	5666.46	5531.28	5332.07	5109.14	4869.61	4563.91	4201.05
90.0	5843.22	5901.25	5818.25	5716.27	5566.86	5362.90	5130.48	4855.38	4528.10
112.5	5843.22	5877.54	5796.90	5694.92	5538.40	5339.18	5118.62	4845.89	4537.58
135.0	5843.22	5860.94	5801.65	5687.81	5531.28	5324.95	5099.65	4841.15	4513.87
157.5	5843.22	5844.33	5796.90	5671.21	5519.43	5327.33	5097.28	4829.29	4516.24
180.0	5843.22	5839.59	5770.81	5652.23	5517.05	5310.72	5068.82	4824.55	4504.38
202.5	5843.22	5827.73	5747.10	5668.84	5495.71	5287.01	5071.19	4786.60	4475.92
225.0	5843.22	5827.73	5761.33	5649.86	5493.34	5282.27	5052.22	4770.00	4459.32
247.5	5843.22	5815.88	5761.33	5635.63	5486.22	5282.27	5037.99	4758.14	4430.86
270.0	5843.22	5841.96	5730.50	5585.83	5384.24	5168.43	4895.69	4566.75	4203.90
292.5	5843.22	5813.50	5699.67	5543.14	5348.67	5113.88	4898.07	4538.77	4167.85
315.0	5843.22	5787.42	5683.07	5524.17	5332.07	5094.91	4936.01	4512.44	4131.09
337.5	5843.22	5780.30	5680.69	5531.28	5317.84	5099.65	4926.53	4524.78	4149.59
360.0	5843.22	5754.21	5649.86	5505.20	5320.21	5097.28	5004.79	4505.33	4145.79
C/ $\gamma$ (°)	45.0	50.0	55.0	60.0	65.0	70.0	75.0	80.0	85.0
0.0	3721.52	3247.91	2748.21	2139.90	1494.82	917.57	423.57	65.46	2.13
22.5	3753.06	3284.43	2768.84	2177.37	1531.82	955.99	442.07	92.02	2.13
45.0	3764.44	3298.66	2799.44	2213.41	1554.35	969.98	480.72	102.93	2.37
67.5	3811.64	3347.75	2835.96	2273.42	1609.84	1022.63	496.38	137.32	2.13
90.0	4167.61	3762.07	3309.09	2792.08	2220.53	1575.45	993.46	465.31	110.99
112.5	4172.36	3771.56	3311.47	2811.06	2253.73	1592.06	1007.93	495.90	126.17
135.0	4162.87	3764.44	3306.72	2794.46	2244.25	1615.77	1008.88	494.48	122.14
157.5	4184.21	3759.70	3299.61	2782.60	2248.99	1601.54	1008.17	497.09	131.62
180.0	4136.78	3738.35	3287.75	2770.74	2208.67	1592.06	987.53	472.19	130.68
202.5	4117.81	3714.64	3247.43	2732.79	2182.58	1537.51	950.06	452.74	104.83
225.0	4096.47	3683.81	3228.46	2711.45	2165.98	1506.68	920.89	419.30	87.28
247.5	4060.89	3655.35	3200.00	2678.25	2109.06	1461.62	897.65	412.18	77.08
270.0	3786.50	3306.25	2783.31	2210.57	1556.72	950.30	429.02	98.90	2.13
292.5	3741.20	3268.54	2750.11	2175.94	1509.76	909.98	411.71	69.49	2.13
315.0	3719.86	3250.99	2725.68	2142.27	1502.41	907.85	398.67	36.05	2.13
337.5	3724.84	3247.67	2746.55	2160.29	1479.88	896.23	408.39	50.52	2.13
360.0	3721.52	3247.91	2748.21	2139.90	1494.82	917.57	423.57	65.46	2.13
C/ $\gamma$ (°)	90.0	95.0	100.0	105.0	110.0	115.0	120.0	125.0	130.0
0.0	1.66	1.66	1.42	1.90	2.61	3.32	3.80	4.74	5.46
22.5	1.42	1.19	1.66	1.90	2.85	3.08	3.56	4.51	5.22
45.0	1.66	1.42	1.42	1.90	2.61	3.32	4.03	4.74	5.46
67.5	1.42	1.42	1.66	1.90	2.61	3.56	4.03	4.74	5.22
90.0	1.90	0.95	1.19	1.42	1.90	2.37	3.08	3.80	4.74
112.5	1.90	1.19	0.95	1.42	1.66	2.37	3.32	3.80	4.51
135.0	2.13	1.19	0.95	1.42	1.90	2.37	3.08	3.80	4.74
157.5	2.13	1.19	1.19	1.19	1.90	2.37	3.08	3.56	4.27
180.0	1.90	1.19	1.19	1.42	1.66	2.37	2.85	3.80	4.51
202.5	2.13	1.19	0.95	1.19	1.90	2.37	2.85	3.80	4.51
225.0	1.90	1.19	1.19	1.42	1.90	2.37	3.32	3.80	4.51
247.5	1.90	1.42	1.19	1.42	2.13	2.37	3.08	3.80	4.51
270.0	1.42	1.19	1.42	1.90	2.37	3.08	4.03	4.51	5.22
292.5	1.42	0.95	1.66	1.90	2.85	3.32	4.03	4.51	5.46
315.0	1.42	1.66	1.66	1.90	2.85	3.32	3.80	4.74	5.69
337.5	1.66	1.66	1.90	2.13	2.61	3.08	3.80	4.51	5.22
360.0	1.66	1.66	1.42	1.90	2.61	3.32	3.80	4.74	5.46



C/γ(°)	135.0	140.0	145.0	150.0	155.0	160.0	165.0	170.0	175.0
0.0	5.46	6.17	6.40	6.64	6.64	6.88	6.64	6.88	7.12
22.5	5.69	5.93	6.17	6.40	6.88	6.88	7.12	7.12	6.88
45.0	5.69	5.93	6.40	6.88	7.12	7.12	6.88	7.12	7.12
67.5	5.93	6.40	6.40	7.12	7.12	6.88	7.12	6.88	7.12
90.0	5.46	5.69	6.17	6.64	7.12	7.12	6.88	6.64	6.88
112.5	5.22	5.93	6.17	6.64	7.12	6.88	6.88	6.88	6.64
135.0	5.22	5.93	6.17	6.40	6.88	6.88	6.64	6.88	6.88
157.5	5.22	5.69	5.93	6.40	6.64	6.88	6.64	6.40	6.64
180.0	4.98	5.46	5.93	6.17	6.64	6.64	6.64	6.64	6.88
202.5	4.98	5.69	5.93	6.40	6.40	6.64	6.64	6.64	6.64
225.0	5.22	5.46	6.17	6.40	6.64	6.88	6.88	6.64	6.64
247.5	5.22	5.69	6.17	6.40	6.88	6.88	6.88	6.88	6.64
270.0	5.69	5.93	6.64	6.88	7.12	6.88	7.12	6.64	7.35
292.5	5.69	6.17	6.64	6.88	6.88	7.12	6.88	6.64	7.12
315.0	5.69	5.69	6.40	6.88	6.88	7.12	6.88	6.88	7.12
337.5	5.69	5.93	6.40	6.64	6.88	6.88	6.64	6.88	7.12
360.0	5.46	6.17	6.40	6.64	6.64	6.88	6.64	6.88	7.12
C/γ(°)	180.0								
0.0	7.23								
22.5	7.23								
45.0	7.23								
67.5	7.23								
90.0	7.23								
112.5	7.23								
135.0	7.23								
157.5	7.23								
180.0	7.23								
202.5	7.23								
225.0	7.23								
247.5	7.23								
270.0	7.23								
292.5	7.23								
315.0	7.23								
337.5	7.23								
360.0	7.23								



## 4 Additional Test

### Electrical data at 480V

Model Number	Test Voltage (V)	Frequency(Hz)	Power Factor	THD
CHB3-100-D-HV-30K-170S	480	60	0.930	8.0%
CHB3-100-D-HV-65K-170S	480	60	0.948	6.1%

## 5 Performance Assessment

Model name	CCT(K)	Total Luminous(lm)	Power(W)	Luminous Efficacy(lm/W)
CHB3-100-D HV-30K-170S	3000	15816.74	100.68	157.1
CHB3-100-D HV-35K-170S	3500	16103.01 * <sup>1</sup>	100.93 * <sup>2</sup>	159.5 * <sup>3</sup>
CHB3-100-D HV-40K-170S	4000	16389.29 * <sup>1</sup>	100.93 * <sup>2</sup>	162.4 * <sup>3</sup>
CHB3-100-D HV-45K-170S	4500	16675.56 * <sup>1</sup>	100.93 * <sup>2</sup>	165.2 * <sup>3</sup>
CHB3-100-D HV-50K-170S	5000	16961.83 * <sup>1</sup>	100.93 * <sup>2</sup>	168.1 * <sup>3</sup>
CHB3-100-D HV-57K-170S	5700	17248.11 * <sup>1</sup>	100.93 * <sup>2</sup>	170.9 * <sup>3</sup>
CHB3-100-D HV-65K-170S	6500	17534.38	101.18	173.3

\*1: This value is calculated and the calculation formula is as below:

$$16103.01=(17534.38-15816.74)/6+15816.74$$

$$16389.29=(17534.38-15816.74)/6+16103.01$$

$$16675.56=(17534.38-15816.74)/6+16389.29$$

$$16961.83=(17534.38-15816.74)/6+16675.56$$

$$17248.11=(17534.38-15816.74)/6+16961.83$$

\*2: This value is calculated and the calculation formula is as below:

$$100.93=(100.68+101.18)/2$$

\*3: This value is calculated and the calculation formula is as below:

$$159.5=16103.01/100.93$$

$$162.4=16389.29/100.93$$



$$165.2=16675.56/100.93$$

$$168.1=16961.83/100.93$$

$$170.9=17248.11/100.93$$



## Photo Document

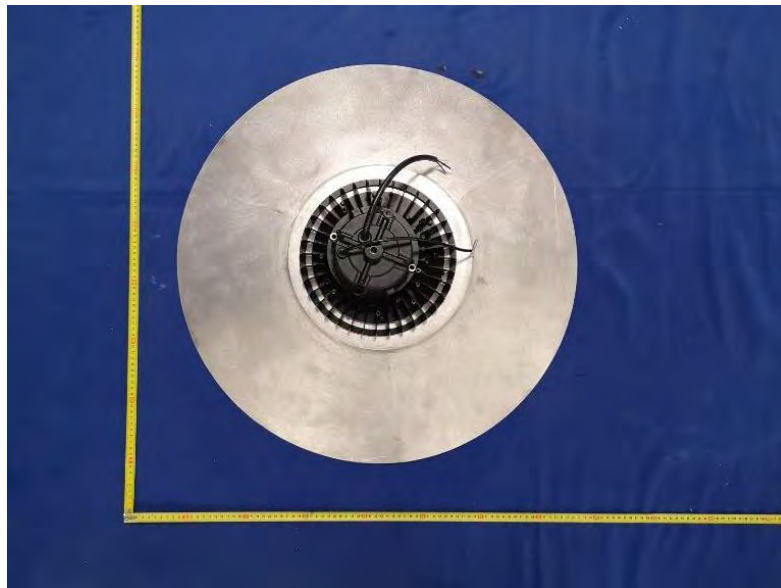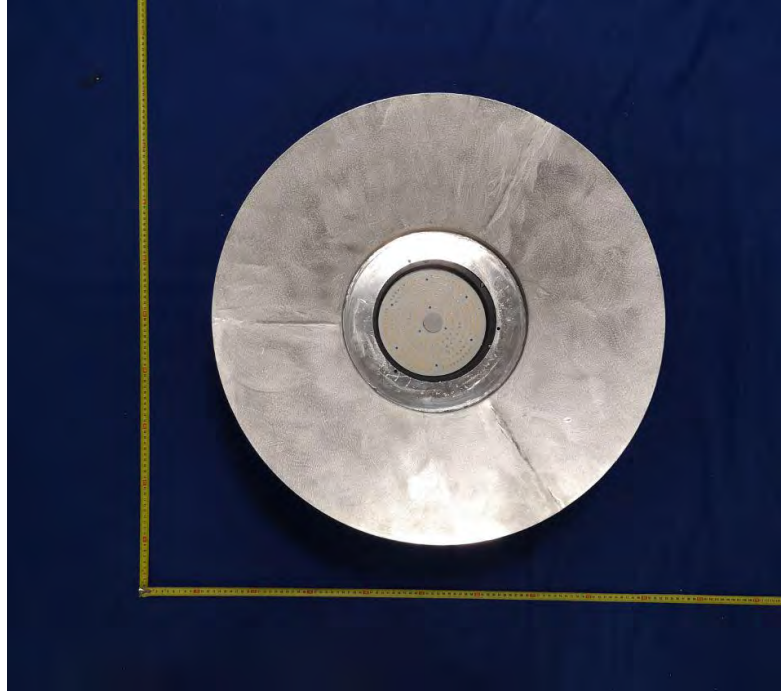

\*\*\*\*End of test report\*\*\*\*