



Date of issue 2022-05-31

Version 1.0

Total pages 20

**Test report of**

**IES LM-79-08**

**Approved Method: Electrical and Photometric**

**Measurements of Solid-State Lighting Products**

**Applicant:**

P.Q.L., Inc.

**Address:**

2285 Ward Avenue / Simi Valley, CA 93065

**For Product:**

High Bay Luminaires (Commercial and Industrial)

**Model No.:**

CHB3-240-D-HV-30K-170S, CHB3-240-D-HV-65K-170S were selected as the representative models. All measurements are the same except CCT.

Test laboratory: Shenzhen Belling Efficiency Testing Lab Co., Ltd, 1Floor, No.1 Building, Meibaohe Industrial Park, Dalang Street, Longhua District, Shenzhen, Guangdong Prov.518101 China.

---

Complied by: Sam Chen

Review by: Jason Zhou

---

Project Engineer

Technical Manager

Note: The test data was only valid for the test sample(s). This test report is prepared for the customer shown above and for the device described herein. It may not be duplicated or use in part without prior written consent from Shenzhen Belling Efficiency Testing Lab Co., Ltd. This report must not be used by the customer to claim product certification, approval, or endorsement By NVLAP, NIST, or any agency of the U.S. Government.



# 1 General

## 1.1 Product Information

<b>Manufacturer</b>	P.Q.L., Inc.
<b>Manufacturer Address</b>	2285 Ward Avenue Simi Valley, CA 93065
<b>Brand Name</b>	PQL
<b>Luminaire Type</b>	High Bay Luminaires (Commercial and Industrial)
<b>Model Number</b>	CHB3-240-D-HV-30K-170S, CHB3-240-D-HV-65K-170S
<b>Rated Inputs</b>	AC 277-480V, 50/60Hz
<b>Rated Power</b>	240 W
<b>Nominal CCT</b>	3000K, 6500K
<b>Dimming Capability</b>	Continuous, 0-10V
<b>Integral Control Sensors</b>	No
<b>Date of Receipt Samples</b>	2022-04-26
<b>Date of test</b>	2022-04-27 to 2022-05-24
<b>Burning Time Before Test</b>	0hour(For New Products)

## 1.2 Standards or methods

- ANSI C78.377-2017:Specifications for the Chromaticity of Solid State Lighting Products
- ANSI C82.77-10:2014:Harmonic Emission Limits - Related Power Quality Requirements for Lighting Equipment - Solid State
- CIE Publication No.13.3-1995:Method of Measuring and Specifying Color Rendering of Light Sources
- IESNA LM-79-08 Approved Method: Electric & Photometric Measurement of Solid-state Lighting Products



### 1.3 Equipment list

Device	Manufacture	Model No.	Serial No.	Calibration due date
Goniophotometric System	SENSING	GMS-3000	N.A	2023-04-08
AC Power Source	ALL POWER	APW-105N	970780	2023-04-10
Total Luminous Flux Standard Lamp	SENSING	110V/100W	S13100188	2023-03-30
Total Luminous Flux Standard Lamp	OSRAM	12V/20W	LSD1220173	2023-03-30
Digital Power Meter	YOKOGAWA	WT310	C2QM02030V	2023-04-10
Thermostatic stabilized photometric sphere	SENSING	SPR-600M	N.A	2023-04-08
Digital Power Meter	YOKOGAWA	WT210	91L929742	2023-04-10
Spectral radiometer	SENSING	SPR-3000	S1101108	2023-04-08
Environment Measurer	XUYAO	HS-1	N/A	2023-03-30
Environment Measurer	XUYAO	HS-1	N/A	2023-03-30
Stop watch	KISLO	K610	N/A	2023-04-14
Digital Anemometer	TECMAN	TD8901	026141	2022-09-08

Statement of Traceability: Shenzhen Belling Efficiency Testing Lab Co., Ltd attests that all calibration has been performed using suitable standards traceable to national primary standards and International System of Unit (SI).



## 2 Test conducted and method

### 2.1 Ambient Condition

The ambient temperature in which measurements are being taken was maintained at  $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$ , the air flow around the sample(s) being tested did not affect the performance.

### 2.2 Power Supply Characteristics

The AC power supply had a sinusoidal voltage wave shape at the prescribed frequency (60 Hz) such that the RMS summation of the harmonic components does not exceed 3 percent of the fundamental during operation of the test item.

The voltage of AC power supply (RMS voltage) applied to the device under test was regulated to within  $\pm 0.2$  percent under load.

### 2.3 Seasoning and Stabilization

No seasoning was performed in accordance with IESNA LM-79-08. And before the measurement, the sample was stabilized until the light output and power variations were less than 0.5% in 30 minutes intervals (3 readings, 15 minutes apart).

### 2.4 Integrating Sphere System

The system includes AC power source, digital power meter, DC power supply, spectrophotometer, and integrating sphere. The integrating sphere system is calibrated by standard light source before measurement. The system and standard light source has been calibrated regularly and traceable to the National Primary Standards.  $4\pi$  geometry was used during measurement. The product was operated in its intended orientation in application and was recorded in this report.

Integrating Sphere Uncertainty: The uncertainty of the light output (luminous flux) measurements is  $U=1.8\%$  ( $K=2$ ), at the 95% confidence level. The uncertainty of the correlated color temperature measurements is  $U=20\text{K}$  ( $K=2$ ), at the 95% confidence level. The uncertainty of the CRI is  $U=1.8(K=2)$ , at the 95% confidence level. The uncertainty of power meter AC current  $U=0.18\%$  of rdg, AC Voltage  $U=0.16\%$  of rdg, Power  $U=0.20\%$  ( $K=2$ ), at the 95% confidence level.



## 2.5 Goniophotometer System

The goniophotometer system is calibrated by standard light source before measurement. The standard light source has been calibrated regularly and traceable to the National Primary Standards.

Type C goniophotometer was used for measuring total luminous flux, luminous intensity distribution, and color spatial uniformity. The product was operated in its intended orientation in application and was recorded in this report. The method according to IESNA LM-79-08 following chapter.

Goniophotometer Uncertainty :The uncertainty of the luminous intensity is  $U=1.6\%$  ( $K=2$ ), at the 95% confidence level.



## 3 Test Result Summary

### 3.1 Integrating Sphere System (Total operating time for integrating sphere test: 1.0 hour)

#### 3.1.1 Model Number: CHB3-240-D-HV-30K-170S

##### Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
277.15	60	0.873	241.53	0.998

##### Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
37292.64	154.4	2900


##### Chromaticity Coordinate

Duv	x	y	u'	v'
-0.00072	0.4431	0.4043	0.2545	0.5224

##### Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
72.9	-17	75	96	-15

##### Spectral Distribution

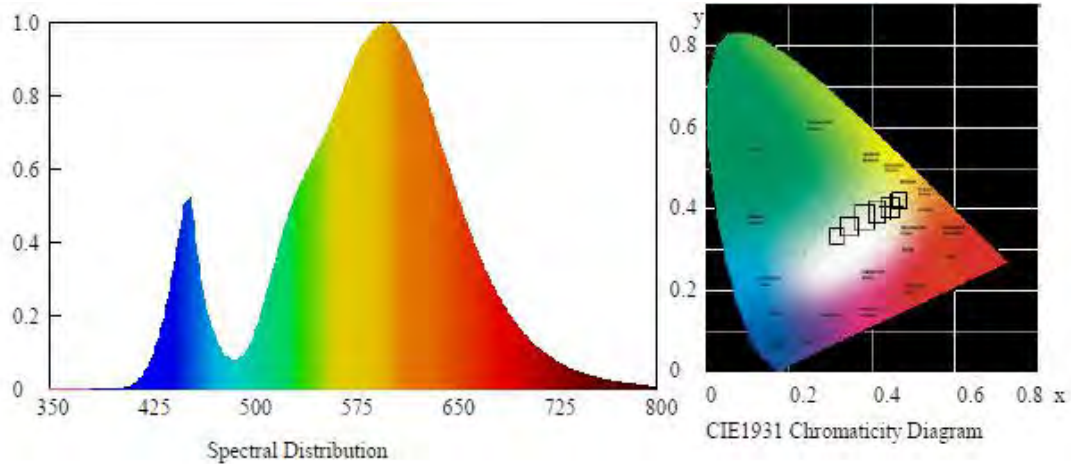



### 7/4 Step Quadrangle

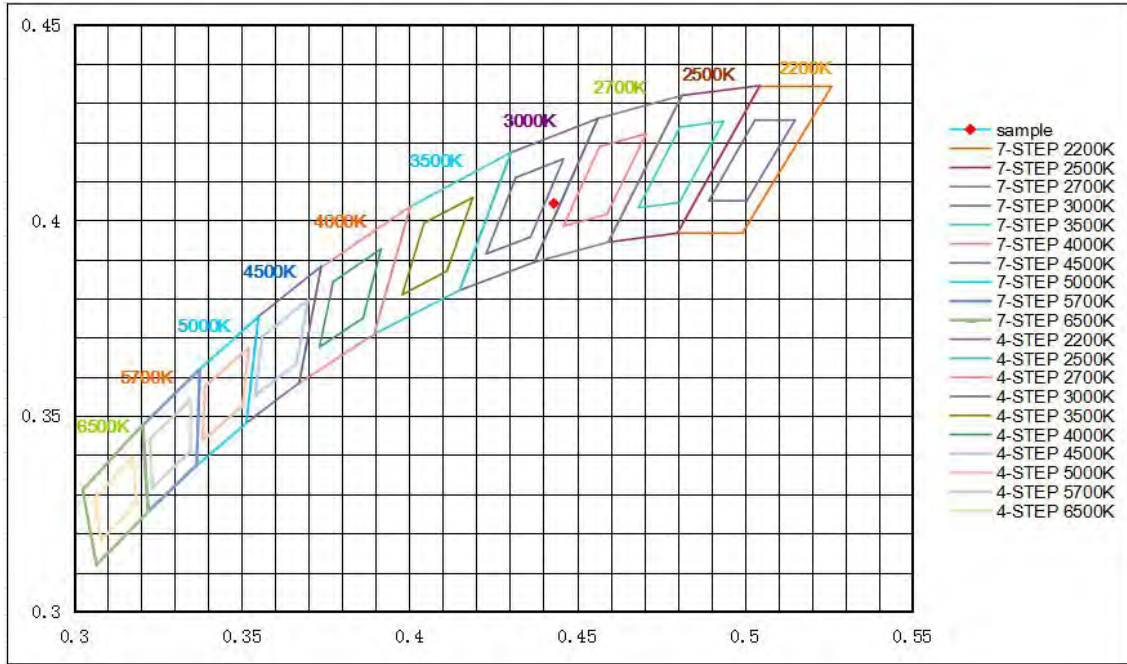









### ANSI/IES TM-30-18 Color Rendition Report

Source: BL220426016-9

Manufacturer: P.Q.L., Inc.

Date: 2022-05-31

Model: CHB3-240-D-HV-30K-170S

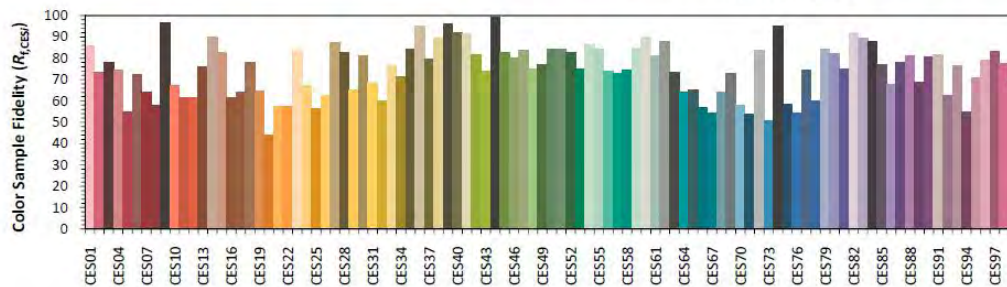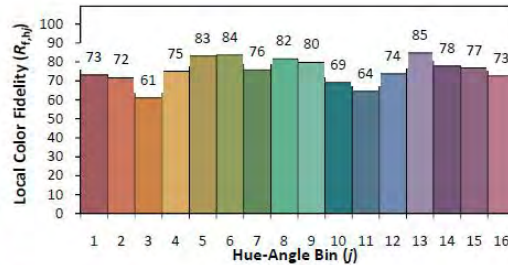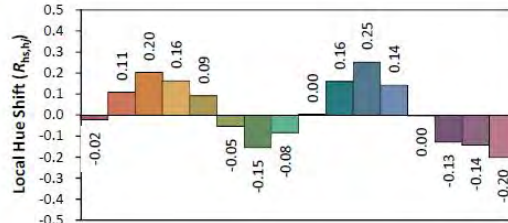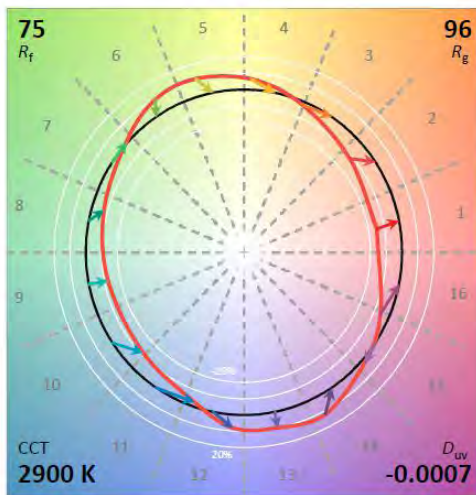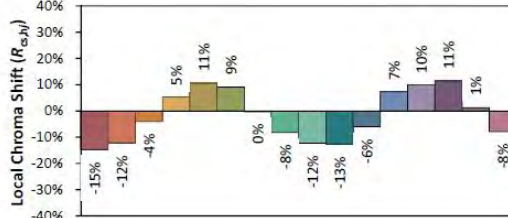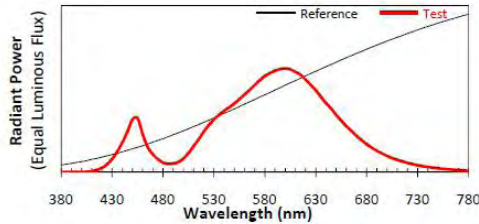

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

$x$  0.4431  
 $y$  0.4043  
 $u'$  0.2545  
 $v'$  0.5224

CIE 13.3-1995  
 (CRI)  
 $R_a$  73  
 $R_g$  -17

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.





### 3.1.2 Model Number: CHB3-240-D-HV-65K-170S

#### Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
277.17	60	0.870	240.35	0.997

#### Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
41123.74	171.1	6336


#### Chromaticity Coordinate

Duv	x	y	u'	v'
+0.00629	0.3149	0.3373	0.1963	0.473

#### Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
71.8	-30	73	91	-18

#### Spectral Distribution

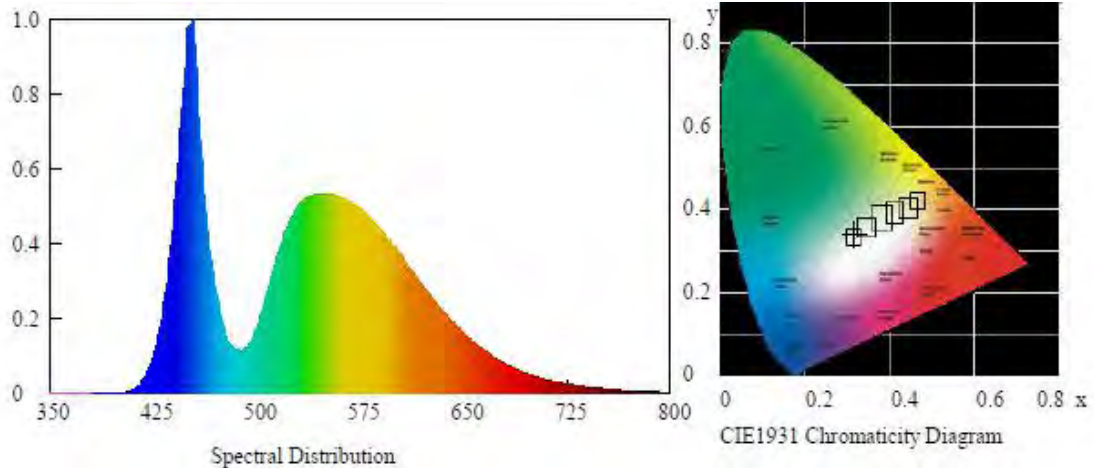









### 7/4 Step Quadrangle

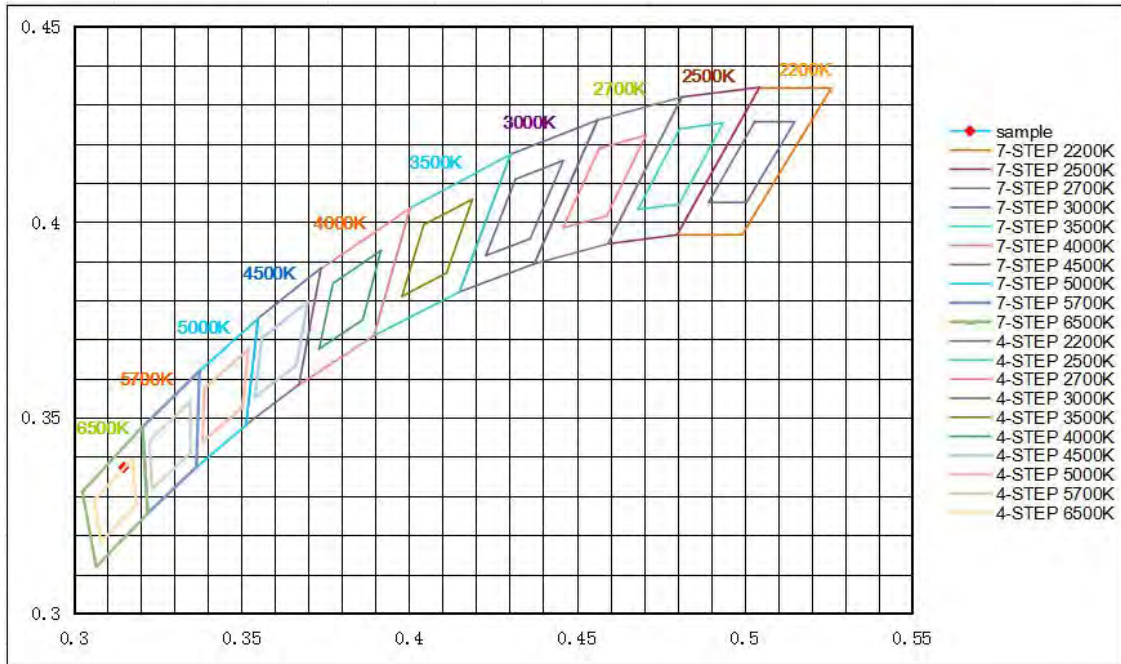



### ANSI/IES TM-30-18 Color Rendition Report

Source: BL220426016-9      Manufacturer: P.Q.L., Inc.  
 Date: 2022-05-31      Model: CHB3-240-D-HV-65K-170S

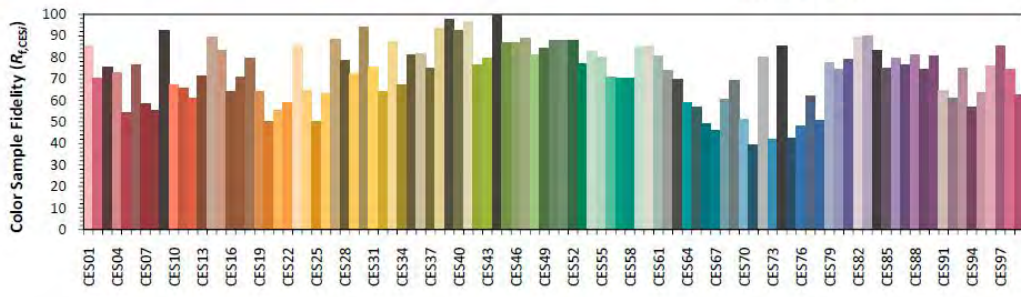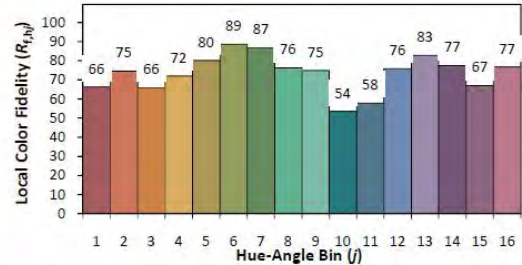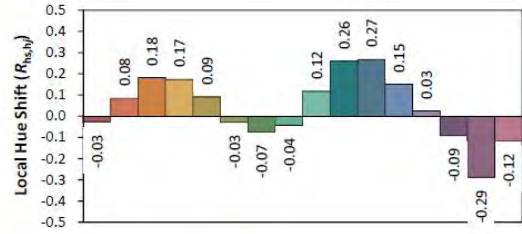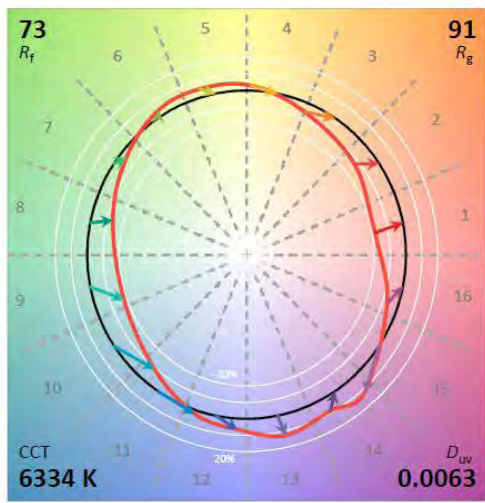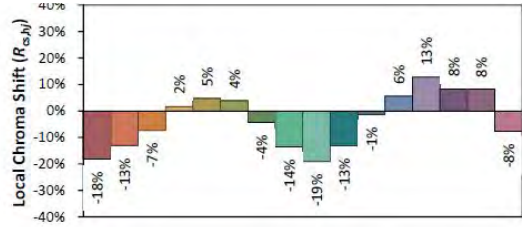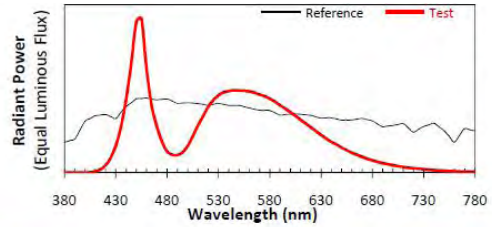

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

$x$	0.3149	CIE 13.3-1995 (CRI)	
$y$	0.3373		
$u'$	0.1963		
$v'$	0.4730		
		$R_a$	72
		$R_g$	-30

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.



### 3.2 Goniophotometer System (Total operating time for luminous intensity distribution: 1.0 hour)

#### 3.2.1 Model Number: CHB3-240-D-HV-30K-170S

##### Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
277.11	60	0.874	241.28	0.996

##### Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	Zonal Lumen in 20-50°(%lm)
37356.04	154.82	52.67



## Zonal Flux Diagram


Zonal flux distribution table

$\gamma(^{\circ})$	Average I(cd)	Zonal F(lm)	Sum F(lm)	Eff Flux(%)	Eff Sum(%)
0.0	13875.510	0.000	0	0.00%	0.00%
5.0	13810.039	330.973	330.973	0.00%	0.89%
10.0	13597.137	980.441	1311.414	0.00%	3.51%
15.0	13266.688	1593.544	2904.958	0.00%	7.78%
20.0	12844.953	2151.966	5056.924	0.00%	13.54%
25.0	12332.637	2640.665	7697.588	0.00%	20.61%
30.0	11734.231	3045.682	10743.27	0.00%	28.76%
35.0	11007.328	3348.854	14092.124	0.00%	37.72%
40.0	10182.959	3535.439	17627.563	0.00%	47.19%
45.0	9227.281	3593.963	21221.527	0.00%	56.81%
50.0	8152.653	3511.870	24733.396	0.00%	66.21%
55.0	6957.950	3285.548	28018.945	0.00%	75.01%
60.0	5644.902	2913.114	30932.058	0.00%	82.80%
65.0	4301.237	2417.925	33349.983	0.00%	89.28%
70.0	2928.853	1830.705	35180.689	0.00%	94.18%
75.0	1657.851	1198.891	36379.58	0.00%	97.39%
80.0	697.722	630.286	37009.865	0.00%	99.07%
85.0	172.794	236.540	37246.406	0.00%	99.71%
90.0	14.311	51.231	37297.637	0.00%	99.84%
95.0	3.230	4.803	37302.439	0.00%	99.86%
100.0	3.216	1.752	37304.191	0.00%	99.86%
105.0	3.974	1.924	37306.115	0.00%	99.87%
110.0	5.140	2.382	37308.497	0.00%	99.87%
115.0	6.601	2.973	37311.47	0.00%	99.88%
120.0	8.089	3.571	37315.041	0.00%	99.89%
125.0	9.704	4.113	37319.154	0.00%	99.90%
130.0	11.249	4.556	37323.71	0.00%	99.91%
135.0	12.513	4.802	37328.512	0.00%	99.93%
140.0	13.665	4.847	37333.359	0.00%	99.94%
145.0	14.634	4.721	37338.08	0.00%	99.95%
150.0	15.575	4.448	37342.528	0.00%	99.96%
155.0	16.150	4.015	37346.543	0.00%	99.97%
160.0	16.221	3.395	37349.938	0.00%	99.98%
165.0	16.010	2.656	37352.595	0.00%	99.99%
170.0	15.954	1.896	37354.491	0.00%	100.00%
175.0	16.361	1.156	37355.647	0.00%	100.00%
180.0	16.813	0.397	37356.043	0.00%	100.00%



### Luminous Intensity Distribution Diagram

Light Distribution Curve [Unit:cd]

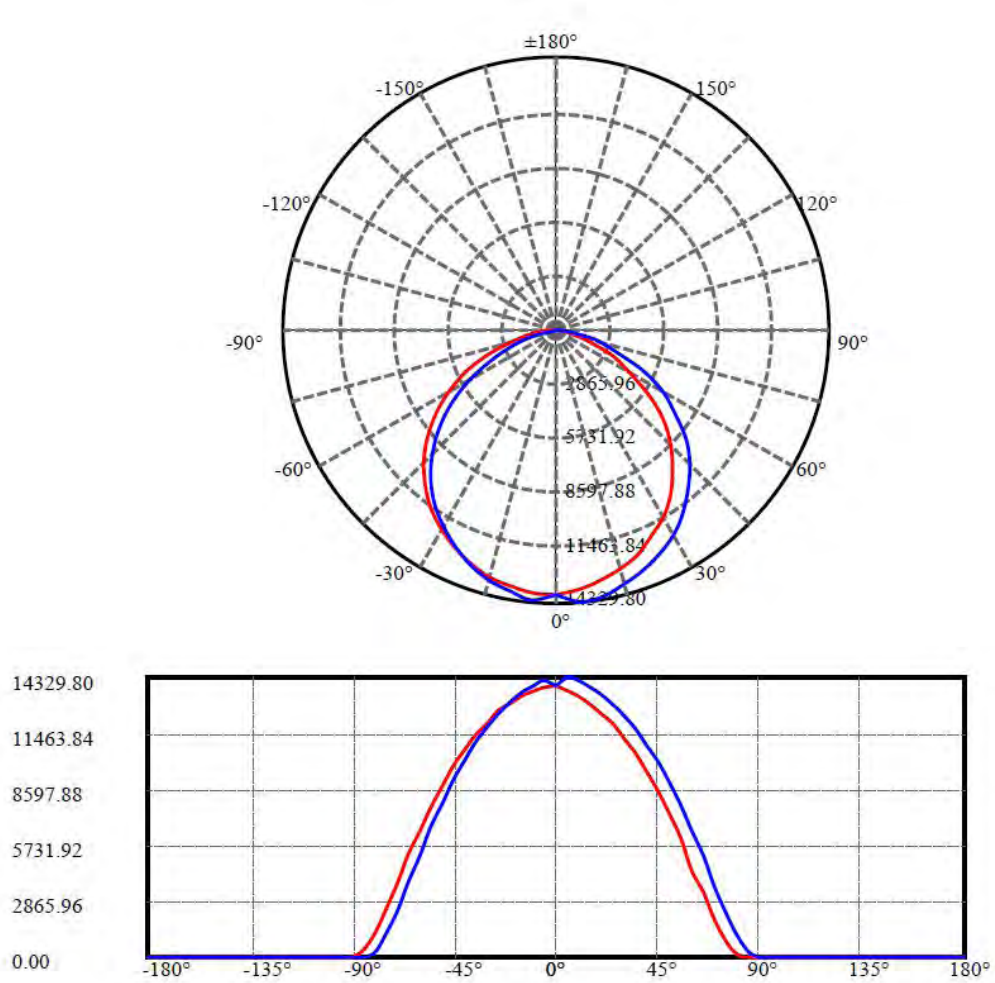

C0/C180: —

C90/C270: —

Field angle(10%Imax):C0/180Left:79.4 Right:72.6


:C90/270Left:73.9 Right:78.6

Beam Angle(50%Imax):C0/180Left:58.2 Right:51.6

:C90/270Left:53.0 Right:57.3



Lux distance Curve

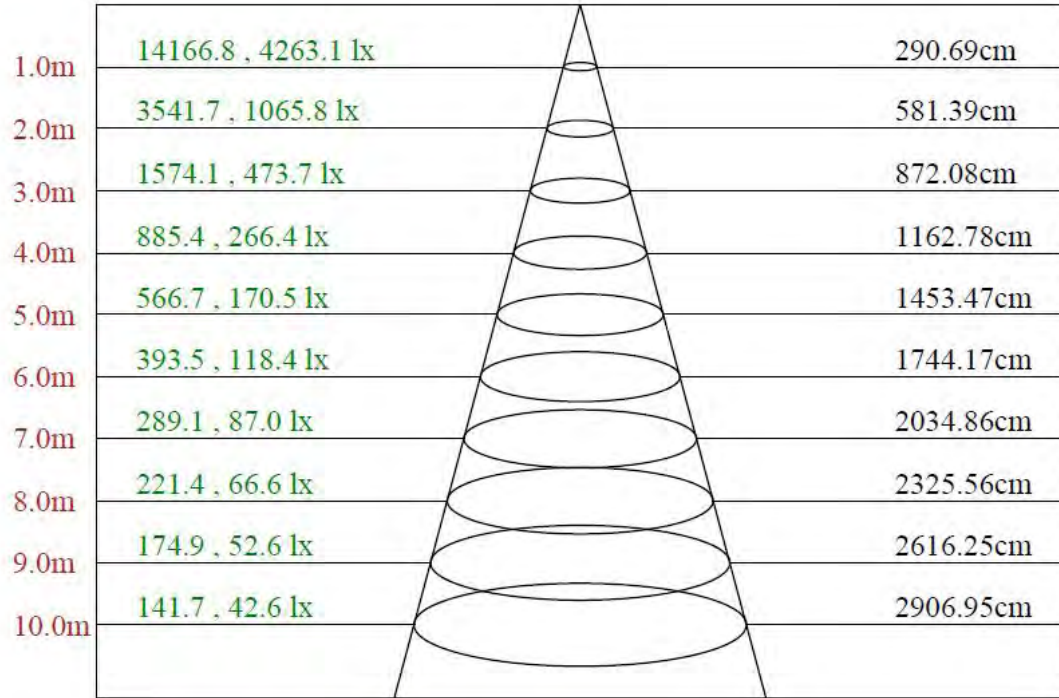

Max , Ave

Beam angle of C90 plane 110.94



**UGR Glare**

Illumination assessment according UGR											
Rf of Ceiling	70	70	50	50	30	70	70	50	50	30	
Rf of Wall	50	30	50	30	30	50	30	50	30	30	
Rf of Floor	20	20	20	20	20	20	20	20	20	20	
Room dimensions		Viewed crosswise					Viewed endwise				
X	Y										
2H	2H	22.08	23.67	22.44	23.99	24.31	22.93	24.52	23.29	24.84	25.16
	3H	23.07	24.52	23.46	24.86	25.20	24.38	25.82	24.76	26.16	26.50
	4H	23.22	24.57	23.62	24.93	25.29	24.84	26.19	25.23	26.54	26.91
	6H	23.23	24.48	23.64	24.85	25.25	25.13	26.38	25.53	26.75	27.14
	8H	23.18	24.38	23.59	24.76	25.16	25.17	26.38	25.58	26.75	27.16
	12H	23.12	24.28	23.54	24.67	25.08	25.16	26.32	25.58	26.70	27.12
4H	2H	22.50	23.85	22.90	24.21	24.57	23.23	24.58	23.62	24.93	25.29
	3H	23.61	24.75	24.03	25.14	25.55	24.71	25.85	25.13	26.24	26.65
	4H	23.84	24.85	24.27	25.26	25.70	25.21	26.21	25.64	26.63	27.07
	6H	23.83	24.72	24.29	25.16	25.61	25.47	26.36	25.93	26.80	27.25
	8H	23.80	24.63	24.27	25.08	25.54	25.55	26.38	26.02	26.83	27.29
	12H	23.77	24.54	24.25	24.99	25.49	25.58	26.35	26.05	26.79	27.30
8H	4H	23.86	24.69	24.33	25.14	25.60	25.18	26.01	25.65	26.46	26.92
	6H	23.84	24.53	24.33	25.00	25.50	25.43	26.12	25.92	26.59	27.09
	8H	23.86	24.46	24.37	24.98	25.47	25.56	26.16	26.07	26.67	27.16
	12H	23.83	24.34	24.35	24.85	25.36	25.58	26.09	26.11	26.60	27.11
12H	4H	23.83	24.61	24.31	25.05	25.56	25.15	25.92	25.63	26.37	26.87
	6H	23.86	24.46	24.37	24.97	25.46	25.44	26.05	25.95	26.56	27.05
	8H	23.84	24.34	24.36	24.86	25.37	25.53	26.03	26.05	26.55	27.06
Variation with the observer position at spacings:											
S = 1.0H		0.3/-0.3					0.6/-0.4				
S = 1.5H		0.8/-0.9					0.7/-1.3				
S = 2.0H		1.9/-2.2					2.1/-1.9				
Standard tables:		BK2					BK2				
Uncorrected UGR		7.7					6.3				

UGR calculation is based on CIE Publ. 117 ,S/H = 1



**Luminous Intensity Distribution Data**

C/γ(°)	0.0	5.0	10.0	15.0	20.0	25.0	30.0	35.0	40.0
0.0	13875.51	13628.73	13327.64	12920.93	12487.26	11923.26	11249.16	10431.25	9552.68
22.5	13875.51	13547.84	13237.76	12846.78	12388.39	11833.38	11179.50	10377.32	9500.99
45.0	13875.51	13480.43	13222.03	12855.77	12392.88	11815.41	11181.75	10402.04	9496.50
67.5	13875.51	13462.46	13213.04	12867.00	12419.85	11858.10	11192.99	10413.28	9539.19
90.0	13875.51	14329.80	14170.26	13837.71	13424.26	12911.94	12343.45	11644.63	10849.20
112.5	13875.51	14138.80	13968.03	13666.93	13280.45	12799.59	12228.85	11559.25	10781.79
135.0	13875.51	13986.01	13828.72	13541.10	13161.36	12684.99	12154.70	11478.36	10716.62
157.5	13875.51	13882.65	13718.62	13460.21	13087.21	12631.07	12087.29	11440.16	10671.68
180.0	13875.51	13810.74	13639.97	13392.80	13010.81	12597.36	12051.34	11410.95	10664.94
202.5	13875.51	13761.31	13608.51	13332.13	12959.13	12514.22	12010.89	11361.51	10604.27
225.0	13875.51	13689.40	13565.82	13282.70	12902.95	12442.32	11936.74	11278.37	10554.84
247.5	13875.51	13630.98	13511.89	13244.50	12873.74	12406.37	11864.84	11204.22	10482.93
270.0	13875.51	14179.25	13914.10	13561.33	13064.74	12482.76	11846.86	11080.63	10168.35
292.5	13875.51	13972.53	13693.90	13305.17	12849.03	12314.24	11613.17	10824.48	9952.64
315.0	13875.51	13781.53	13518.63	13134.39	12673.76	12105.27	11453.64	10673.97	9761.65
337.5	13875.51	13678.17	13415.27	13017.55	12543.43	12001.91	11352.52	10536.86	9629.07
360.0	13875.51	13628.73	13327.64	12920.93	12487.26	11923.26	11249.16	10431.25	9552.68
C/γ(°)	45.0	50.0	55.0	60.0	65.0	70.0	75.0	80.0	85.0
0.0	8489.84	7348.37	6063.08	4442.55	3291.18	1978.26	837.68	167.40	4.72
22.5	8460.63	7303.43	6076.56	4462.54	3258.83	1975.56	868.02	178.86	4.72
45.0	8460.63	7348.37	6094.54	4449.74	3336.80	2038.70	899.92	193.24	4.72
67.5	8519.05	7384.32	6134.99	5180.01	3387.80	2080.05	943.97	229.42	5.17
90.0	9948.15	8950.48	7730.36	6496.75	5135.07	3625.09	2267.90	1117.43	266.49
112.5	9905.45	8853.86	7730.36	6472.04	5139.57	3699.24	2294.86	1142.15	310.31
135.0	9851.53	8853.86	7701.15	6519.22	5193.49	3748.67	2431.93	1173.61	334.80
157.5	9811.08	8820.15	7719.12	6501.25	5197.99	3863.27	2409.46	1234.28	371.88
180.0	9813.33	8811.17	7680.92	6512.48	5220.46	3816.08	2438.67	1252.25	374.35
202.5	9741.42	8795.44	7669.69	6476.53	5189.00	3795.86	2429.68	1202.82	383.34
225.0	9687.50	8714.54	7629.24	6436.09	5148.55	3757.66	2375.75	1191.59	353.68
247.5	9611.10	8608.93	7510.15	6339.46	5076.65	3649.80	2279.13	1121.93	328.06
270.0	9114.51	7934.83	6672.02	5292.36	3785.52	2419.35	1158.10	309.86	6.97
292.5	8901.04	7743.84	6465.30	5105.86	3616.10	2246.33	1039.69	247.62	5.62
315.0	8714.54	7539.36	6303.51	5189.00	3468.47	2122.07	970.48	213.69	4.94
337.5	8606.69	7431.51	6146.22	4442.55	3374.32	2045.67	880.38	187.40	4.94
360.0	8489.84	7348.37	6063.08	4442.55	3291.18	1978.26	837.68	167.40	4.72
C/γ(°)	90.0	95.0	100.0	105.0	110.0	115.0	120.0	125.0	130.0
0.0	3.37	3.15	3.60	4.72	5.84	7.42	8.76	10.56	11.91
22.5	3.37	3.15	3.60	4.72	6.07	7.42	8.99	10.56	11.91
45.0	3.37	2.70	3.60	4.27	5.84	7.42	8.99	10.56	11.91
67.5	3.60	3.37	3.60	4.49	5.84	7.87	9.21	10.79	12.36
90.0	10.79	3.37	3.15	3.60	4.94	6.07	7.87	9.44	11.24
112.5	20.67	3.15	2.70	3.37	4.49	6.07	7.42	8.99	10.79
135.0	28.54	3.37	2.70	3.15	4.27	5.39	7.19	8.76	10.34
157.5	38.42	3.15	2.92	3.15	4.27	5.39	6.97	8.31	9.89
180.0	36.40	3.37	2.92	3.15	4.05	5.17	6.74	8.31	9.66
202.5	37.75	3.15	2.70	3.15	4.05	5.39	6.74	8.31	9.89
225.0	20.00	3.15	2.70	3.15	4.05	5.62	6.74	8.54	10.11
247.5	7.19	3.15	2.70	3.15	4.05	5.62	6.97	8.76	10.79
270.0	4.05	3.60	3.82	4.94	6.29	7.87	9.44	11.01	12.81
292.5	4.27	3.37	3.82	4.94	6.07	7.87	9.44	11.24	12.81
315.0	3.82	3.37	3.37	4.72	6.07	7.64	8.99	10.56	11.91
337.5	3.37	3.15	3.60	4.94	6.07	7.42	8.99	10.56	11.68
360.0	3.37	3.15	3.60	4.72	5.84	7.42	8.76	10.56	11.91



C/γ(°)	135.0	140.0	145.0	150.0	155.0	160.0	165.0	170.0	175.0
0.0	13.03	13.93	14.83	15.73	16.18	16.18	15.73	15.73	16.85
22.5	13.03	14.16	14.61	15.73	15.95	15.95	15.95	15.95	16.63
45.0	13.03	14.16	15.28	15.95	16.40	16.18	16.18	15.95	16.85
67.5	13.03	14.38	15.50	15.95	16.18	16.18	15.95	15.95	16.85
90.0	12.81	13.93	15.06	16.18	16.85	16.85	16.63	16.63	16.18
112.5	12.58	13.48	14.83	15.50	16.63	16.85	16.40	16.18	16.18
135.0	11.68	13.03	14.16	15.28	16.18	16.18	16.18	15.95	15.95
157.5	11.46	12.58	13.71	14.83	15.50	15.50	15.73	15.50	15.50
180.0	11.24	12.58	13.48	14.61	15.28	15.50	15.28	15.28	15.28
202.5	11.24	12.36	13.26	14.38	15.06	15.50	15.06	15.06	15.50
225.0	11.46	12.58	13.48	14.83	15.73	15.73	15.50	15.50	15.50
247.5	11.68	13.03	13.93	15.06	15.73	15.95	15.73	15.50	15.28
270.0	14.16	15.50	16.18	17.30	17.53	17.53	17.30	17.08	17.98
292.5	13.71	14.83	15.95	16.40	16.85	16.85	16.40	16.63	17.30
315.0	13.03	14.16	15.06	15.95	16.40	16.63	16.18	16.18	17.08
337.5	13.03	13.93	14.83	15.50	15.95	15.95	15.95	16.18	16.85
360.0	13.03	13.93	14.83	15.73	16.18	16.18	15.73	15.73	16.85
C/γ(°)	180.0								
0.0	16.81								
22.5	16.81								
45.0	16.81								
67.5	16.81								
90.0	16.81								
112.5	16.81								
135.0	16.81								
157.5	16.81								
180.0	16.81								
202.5	16.81								
225.0	16.81								
247.5	16.81								
270.0	16.81								
292.5	16.81								
315.0	16.81								
337.5	16.81								
360.0	16.81								



## 4 Additional Test

### Electrical data at 480V

Model Number	Test Voltage (V)	Frequency(Hz)	Power Factor	THD
CHB3-240-D-HV-30K-170S	480	60	0.976	6.2%
CHB3-240-D-HV-65K-170S	480	60	0.983	4.0%

## 5 Performance Assessment

Model name	CCT(K)	Total Luminous(lm)	Power(W)	Luminous Efficacy(lm/W)
CHB3-240-D-HV-30K-170S	3000	37292.64	241.53	154.4
CHB3-240-D-HV-35K-170S	3500	37931.16 * <sup>1</sup>	240.94 * <sup>2</sup>	157.4 * <sup>3</sup>
CHB3-240-D-HV-40K-170S	4000	38569.67 * <sup>1</sup>	240.94 * <sup>2</sup>	160.1 * <sup>3</sup>
CHB3-240-D-HV-45K-170S	4500	39208.19 * <sup>1</sup>	240.94 * <sup>2</sup>	162.7 * <sup>3</sup>
CHB3-240-D-HV-50K-170S	5000	39846.71 * <sup>1</sup>	240.94 * <sup>2</sup>	165.4 * <sup>3</sup>
CHB3-240-D-HV-57K-170S	5700	40485.22 * <sup>1</sup>	240.94 * <sup>2</sup>	168.0 * <sup>3</sup>
CHB3-240-D-HV-65-170S	6500	41123.74	240.35	171.1

\*1: This value is calculated and the calculation formula is as below:

$$37931.16=(41123.74-37292.64)/6+37292.64$$

$$38569.67=(41123.74-37292.64)/6+37931.16$$

$$39208.19=(41123.74-37292.64)/6+38569.67$$

$$39846.71=(41123.74-37292.64)/6+39208.19$$

$$40485.22=(41123.74-37292.64)/6+39846.71$$

\*2: This value is calculated and the calculation formula is as below:

$$240.94=(241.53+240.35)/2$$

\*3: This value is calculated and the calculation formula is as below:

$$157.4=37931.16 /240.94$$

$$160.1=38569.67 /240.94$$



$$162.7=39208.19 /240.94$$

$$165.4=39846.71 /240.94$$

$$168.0=40485.22 /240.94$$



## Photo Document

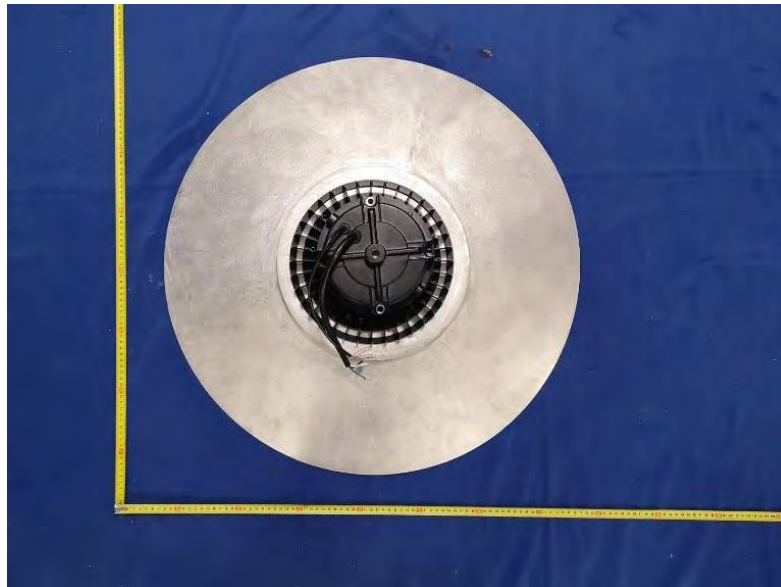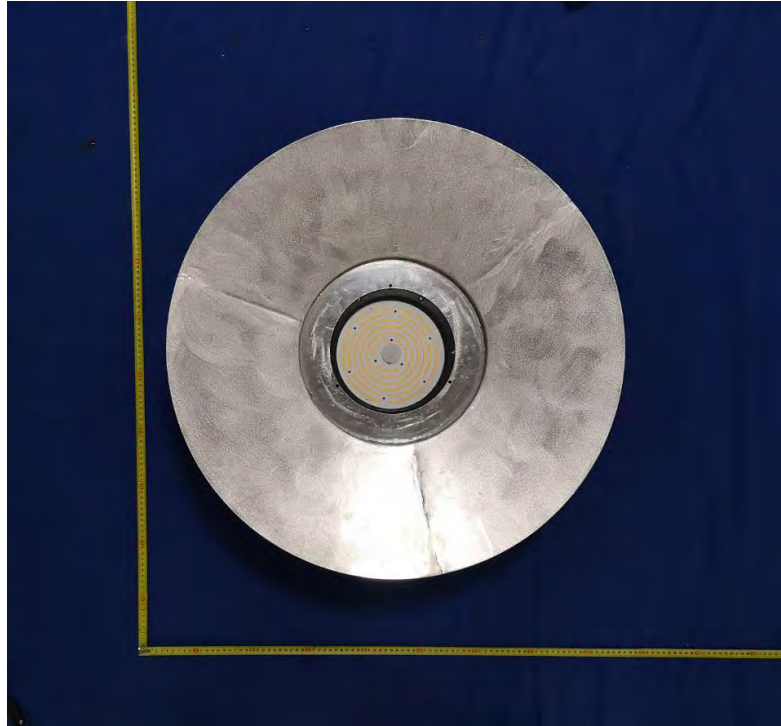

\*\*\*\*End of test report\*\*\*\*