



Date of issue 2022-05-31

Version 1.0

Total pages 20

Test report of

IES LM-79-08

Approved Method: Electrical and Photometric

Measurements of Solid-State Lighting Products

Applicant:

P.Q.L., Inc.

Address:

2285 Ward Avenue
Simi Valley, CA 93065

For Product:

High Bay Luminaires (Commercial and Industrial)

Model No.:

CHB3-200-D-MV-30K-170S, CHB3-200-D-MV-65K-170S

Test laboratory: Shenzhen Belling Efficiency Testing Lab Co., Ltd, 1Floor, No.1 Building, Meibaohe Industrial Park, Dalang Street, Longhua District, Shenzhen, Guangdong Prov.518101 China.

Sam Chen

Jason Zhou

Complied by: Sam Chen

Review by: Jason Zhou

Project Engineer

Technical Manager

Note: The test data was only valid for the test sample(s). This test report is prepared for the customer shown above and for the device described herein. It may not be duplicated or use in part without prior written consent from Shenzhen Belling Efficiency Testing Lab Co., Ltd. This report must not be used by the customer to claim product certification, approval, or endorsement By NVLAP, NIST, or any agency of the U.S. Government.



1 General

1.1 Product Information

Manufacturer	P.Q.L., Inc.
Manufacturer Address	2285 Ward Avenue Simi Valley, CA 93065
Brand Name	PQL
Luminaire Type	High Bay Luminaires (Commercial and Industrial)
Model Number	CHB3-200-D-MV-30K-170S, CHB3-200-D-MV-65K-170S
Rated Inputs	AC 100-277V, 50/60Hz
Rated Power	200W
Nominal CCT	3000K, 6500K
Dimming Capability	Continuous, 0-10V
Integral Control Sensors	No
Date of Receipt Samples	2022-04-26
Date of test	2022-04-27 to 2022-05-24
Burning Time Before Test	0hour(For New Products)

1.2 Standards or methods

- ANSI C78.377-2017:Specifications for the Chromaticity of Solid State Lighting Products
- ANSI C82.77-10:2014:Harmonic Emission Limits - Related Power Quality Requirements for Lighting Equipment - Solid State
- CIE Publication No.13.3-1995:Method of Measuring and Specifying Color Rendering of Light Sources
- IESNA LM-79-08 Approved Method: Electric & Photometric Measurement of Solid-state Lighting Products



1.3 Equipment list

Device	Manufacture	Model No.	Serial No.	Calibration due date
Goniophotometric System	SENSING	GMS-3000	N.A	2023-04-08
AC Power Source	ALL POWER	APW-105N	970780	2023-04-10
Total Luminous Flux Standard Lamp	SENSING	110V/100W	S13100188	2023-03-30
Total Luminous Flux Standard Lamp	OSRAM	12V/20W	LSD1220173	2023-03-30
Digital Power Meter	YOKOGAWA	WT310	C2QM02030V	2023-04-10
Thermostatic stabilized photometric sphere	SENSING	SPR-600M	N.A	2023-04-08
Digital Power Meter	YOKOGAWA	WT210	91L929742	2023-04-10
Spectral radiometer	SENSING	SPR-3000	S1101108	2023-04-08
Environment Measurer	XUYAO	HS-1	N/A	2023-03-30
Environment Measurer	XUYAO	HS-1	N/A	2023-03-30
Stop watch	KISLO	K610	N/A	2023-04-14
Digital Anemometer	TECMAN	TD8901	026141	2022-09-08

Statement of Traceability: Shenzhen Belling Efficiency Testing Lab Co., Ltd attests that all calibration has been performed using suitable standards traceable to national primary standards and International System of Unit (SI).



1. 2 Test conducted and method

2.1 Ambient Condition

The ambient temperature in which measurements are being taken was maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$, the air flow around the sample(s) being tested did not affect the performance.

2.2 Power Supply Characteristics

The AC power supply had a sinusoidal voltage wave shape at the prescribed frequency (60 Hz) such that the RMS summation of the harmonic components does not exceed 3 percent of the fundamental during operation of the test item.

The voltage of AC power supply (RMS voltage) applied to the device under test was regulated to within ± 0.2 percent under load.

2.3 Seasoning and Stabilization

No seasoning was performed in accordance with IESNA LM-79-08. And before the measurement, the sample was stabilized until the light output and power variations were less than 0.5% in 30 minutes intervals (3 readings, 15 minutes apart).

2.4 Integrating Sphere System

The system includes AC power source, digital power meter, DC power supply, spectrophotometer, and integrating sphere. The integrating sphere system is calibrated by standard light source before measurement. The system and standard light source has been calibrated regularly and traceable to the National Primary Standards. 4π geometry was used during measurement. The product was operated in its intended orientation in application and was recorded in this report.

Integrating Sphere Uncertainty: The uncertainty of the light output (luminous flux) measurements is $U=1.8\%$ ($K=2$), at the 95% confidence level. The uncertainty of the correlated color temperature measurements is $U=20\text{K}$ ($K=2$), at the 95% confidence level. The uncertainty of the CRI is $U=1.8(K=2)$, at the 95% confidence level. The uncertainty of power meter AC current $U=0.18\%$ of rdg, AC Voltage $U=0.16\%$ of rdg, Power $U=0.20\%$ ($K=2$), at the 95% confidence level.



2.5 Goniophotometer System

The goniophotometer system is calibrated by standard light source before measurement. The standard light source has been calibrated regularly and traceable to the National Primary Standards.

Type C goniophotometer was used for measuring total luminous flux, luminous intensity distribution, and color spatial uniformity. The product was operated in its intended orientation in application and was recorded in this report. The method according to IESNA LM-79-08 following chapter.

Goniophotometer Uncertainty :The uncertainty of the luminous intensity is $U=1.6\%$ ($K=2$), at the 95% confidence level.



3 Test Result Summary

3.1 Integrating Sphere System (Total operating time for integrating sphere test: 1.0 hour)

3.1.1 Model Number: CHB3-200-D-MV-30K-170S

Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
120.04	60	1.697	202.84	0.996

Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
31318.13	154.4	2882


Chromaticity Coordinate

Duv	x	y	u'	v'
-0.00035	0.4451	0.4058	0.2551	0.5233

Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
73.1	-16	75	96	-15

Spectral Distribution

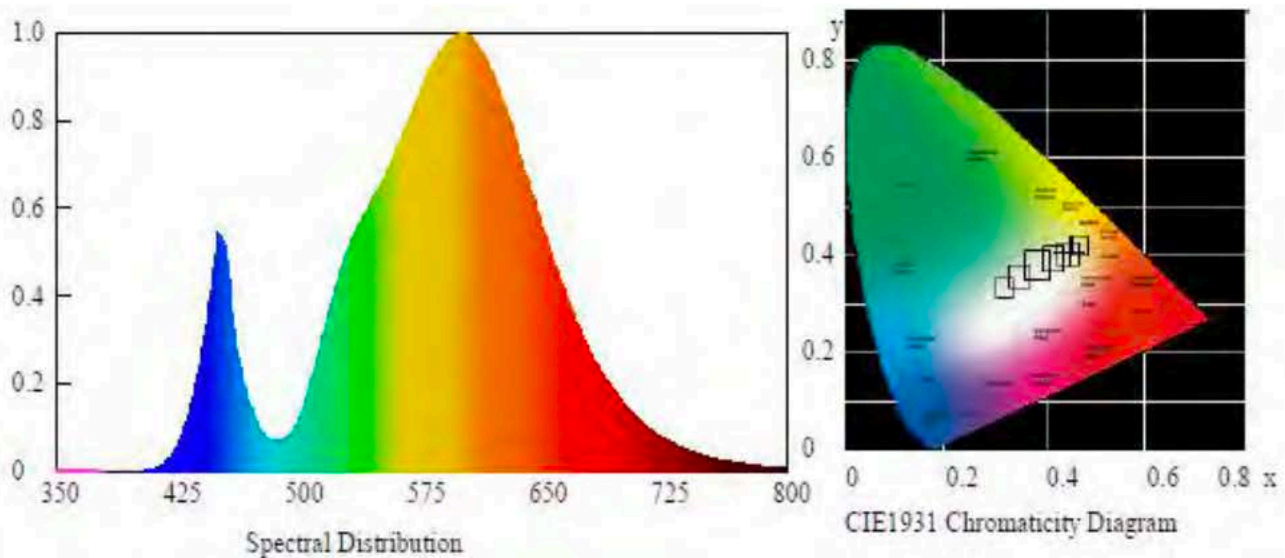



7/4 Step Quadrangle






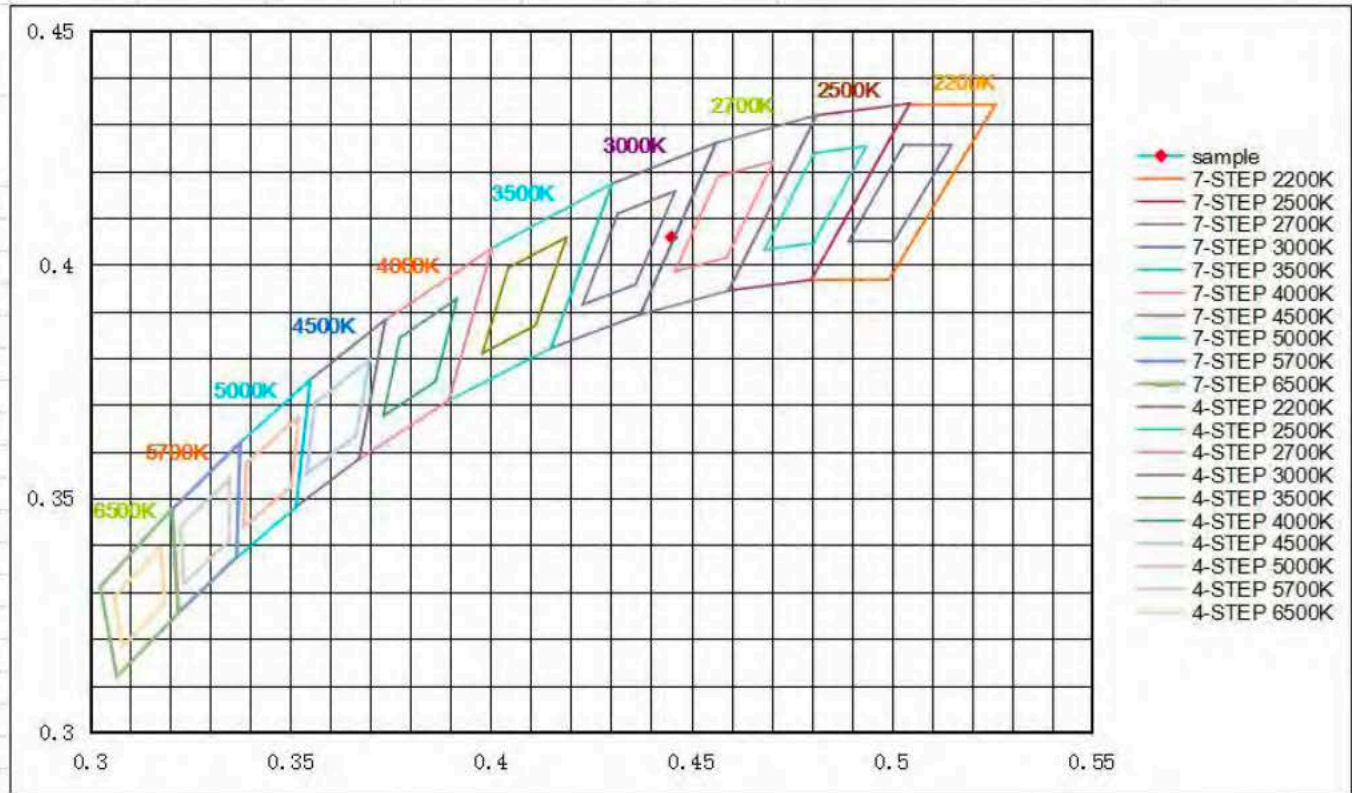




ANSI/IES TM-30-18 Color Rendition Report

Source: BL220426011-9
 Date: 2022-05-31

Manufacturer: P.Q.L., Inc.
 Model: CHB3-200-D-MV-30K-170S

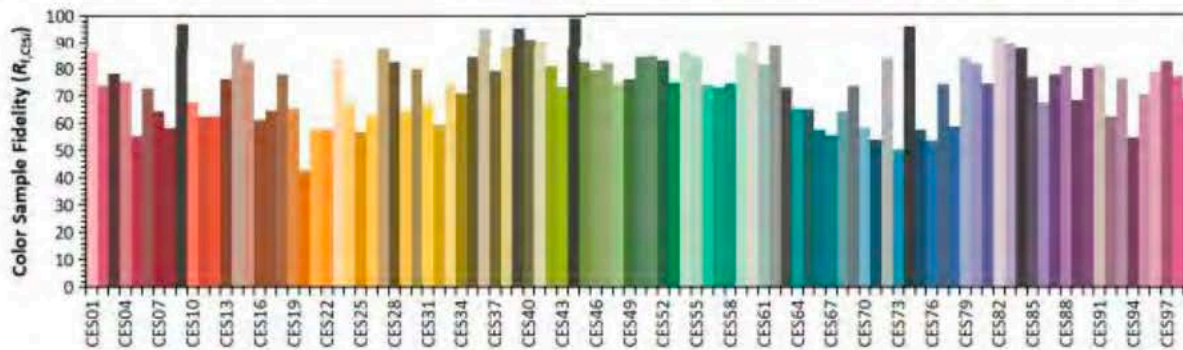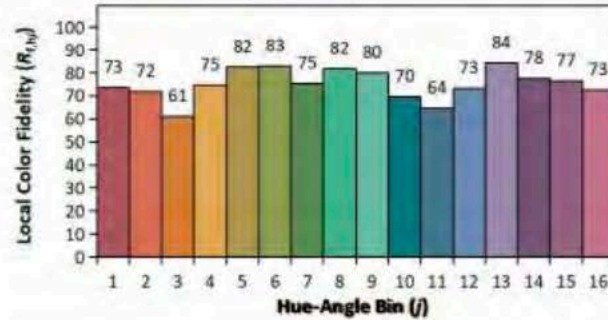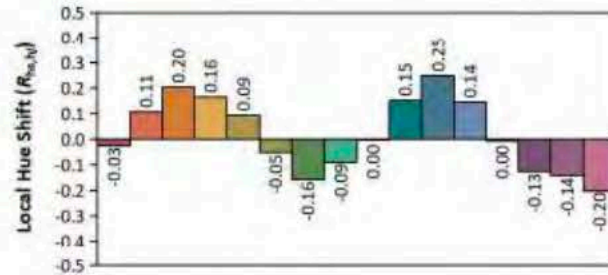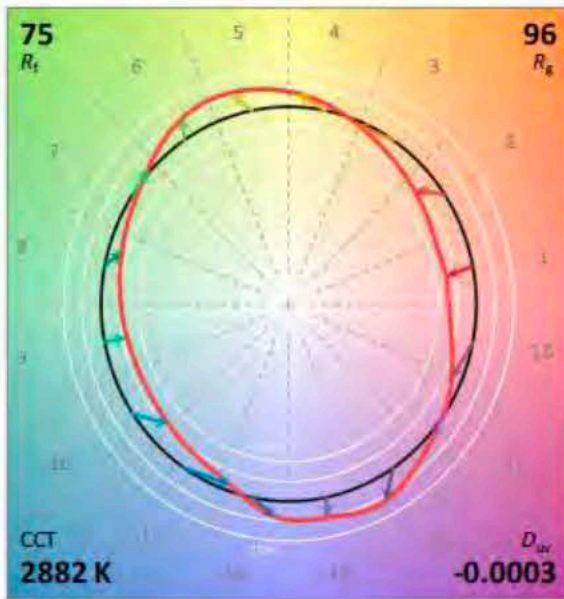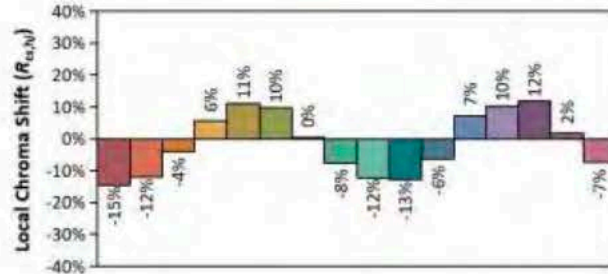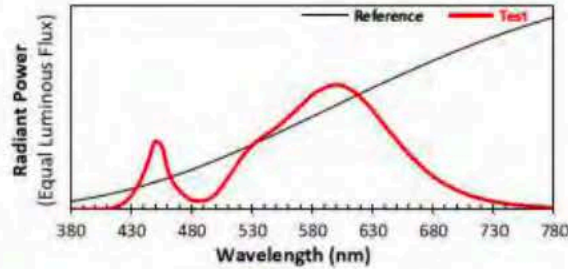

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x 0.4451
 y 0.4058
 u' 0.2551
 v' 0.5233

CIE 13.3-1995 (CRI)	
R_a	73
R_g	-16

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.



3.1.2 Model Number: CHB3-200-D-MV-65K-170S

Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
120.16	60	1.705	204.28	0.997

Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
34462.17	168.7	6308


Chromaticity Coordinate

Duv	x	y	u'	v'
+0.00647	0.3154	0.3381	0.1963	0.4735

Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
71.5	-31	73	91	-18

Spectral Distribution

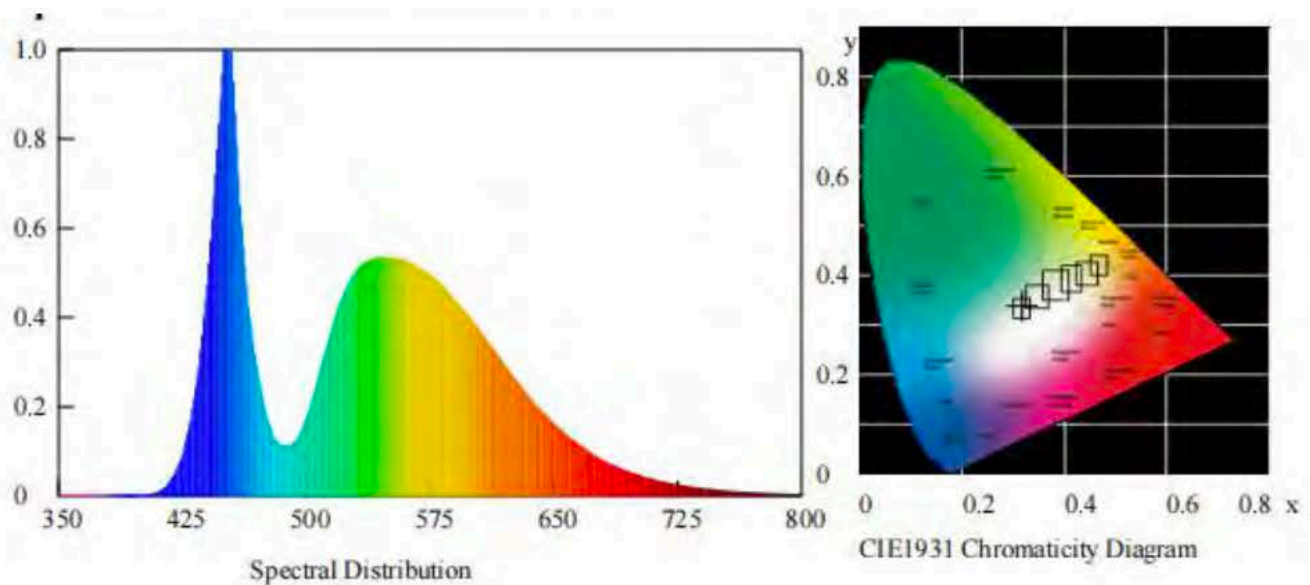



7/4 Step Quadrangle

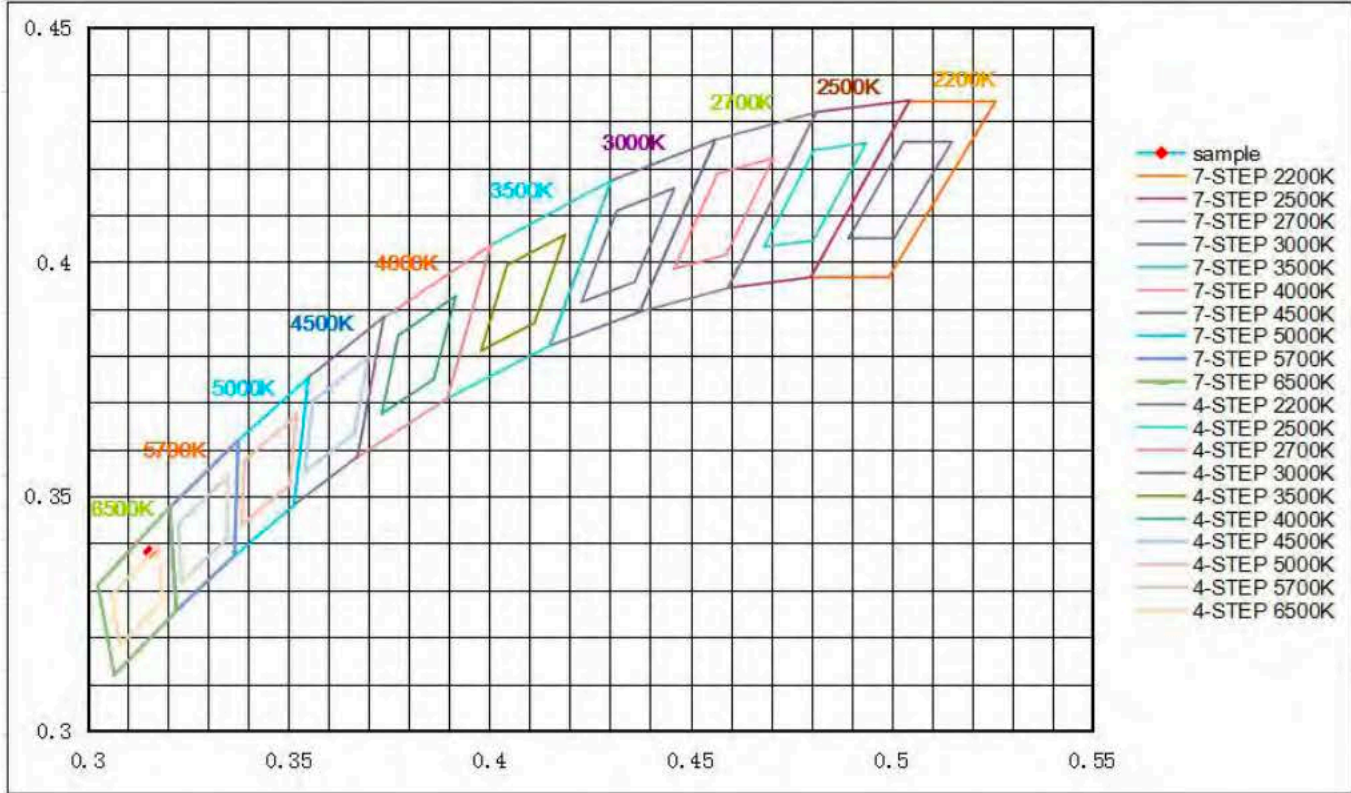







ANSI/IES TM-30-18 Color Rendition Report

Source: BL220426011-9

Manufacturer: P.Q.L., Inc.

Date: 2022-05-31

Model: CHB3-200-D-MV-65K-170S

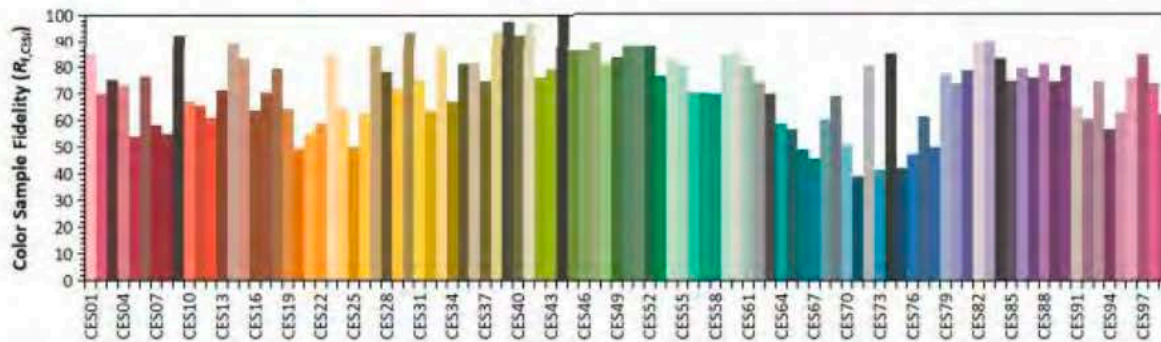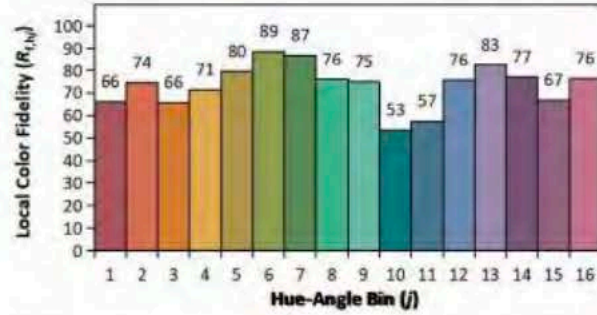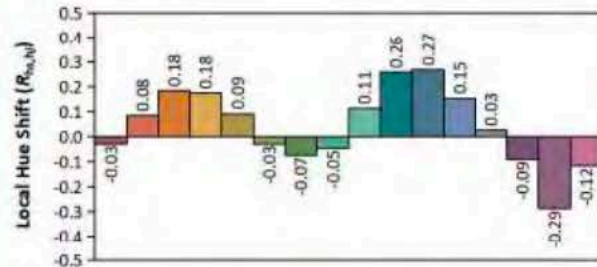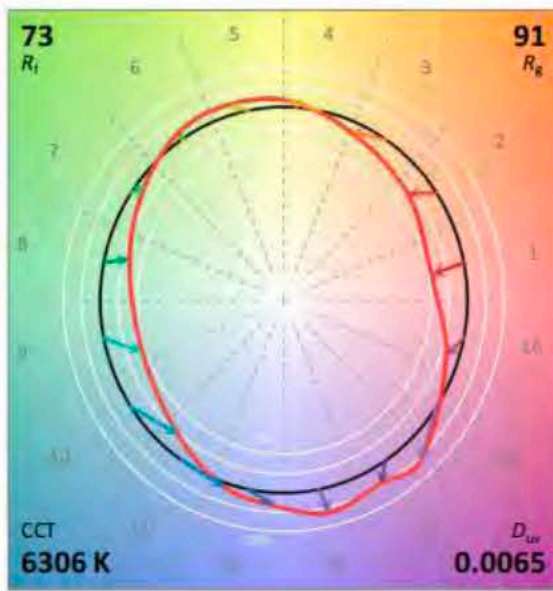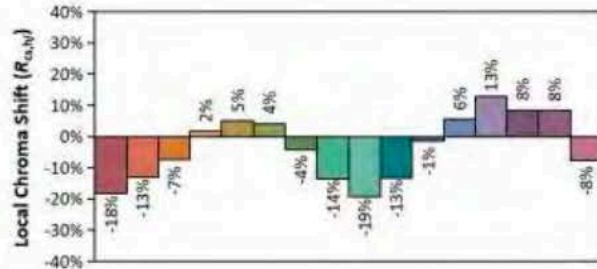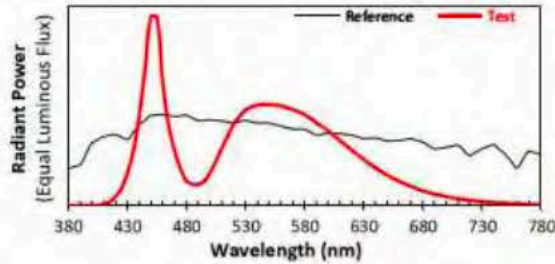

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x 0.3154
 y 0.3381
 u' 0.1963
 v' 0.4735

CIE 13.3-1995 (CRI)	
R_a	72
R_g	-32

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.



3.2 Goniophotometer System (Total operating time for luminous intensity distribution: 1.0 hour)

3.2.1 Model Number: CHB3-200-D-MV-30K-170S

Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
120.16	60	1.699	203.58	0.9974

Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	Zonal Lumen in 20-50°(%lm)
31240.11	153.45	52.93



**Zonal Flux Diagram**

Zonal flux distribution table

$\gamma(^{\circ})$	Average I(cd)	Zonal F(lm)	Sum F(lm)	Eff Flux(%)	Eff Sum(%)
0.0	11797.320	0.000	0	0.00%	0.00%
5.0	11713.698	281.068	281.068	0.00%	0.90%
10.0	11513.704	830.917	1111.985	0.00%	3.56%
15.0	11225.771	1348.890	2460.875	0.00%	7.88%
20.0	10872.569	1821.214	4282.089	0.00%	13.71%
25.0	10422.763	2233.487	6515.576	0.00%	20.86%
30.0	9893.826	2571.081	9086.657	0.00%	29.09%
35.0	9254.711	2819.756	11906.413	0.00%	38.11%
40.0	8533.433	2967.817	14874.231	0.00%	47.61%
45.0	7711.075	3007.803	17882.033	0.00%	57.24%
50.0	6822.293	2936.680	20818.713	0.00%	66.64%
55.0	5837.052	2752.563	23571.276	0.00%	75.45%
60.0	4781.979	2454.559	26025.835	0.00%	83.31%
65.0	3605.379	2038.983	28064.818	0.00%	89.84%
70.0	2405.040	1521.877	29586.694	0.00%	94.71%
75.0	1331.368	976.637	30563.331	0.00%	97.83%
80.0	489.848	487.307	31050.638	0.00%	99.39%
85.0	19.523	138.408	31189.047	0.00%	99.84%
90.0	2.729	6.093	31195.139	0.00%	99.86%
95.0	2.122	1.328	31196.468	0.00%	99.86%
100.0	2.180	1.169	31197.637	0.00%	99.86%
105.0	2.845	1.344	31198.981	0.00%	99.87%
110.0	3.827	1.744	31200.725	0.00%	99.87%
115.0	5.112	2.263	31202.988	0.00%	99.88%
120.0	6.310	2.777	31205.765	0.00%	99.89%
125.0	7.826	3.268	31209.033	0.00%	99.90%
130.0	9.213	3.705	31212.738	0.00%	99.91%
135.0	10.383	3.960	31216.697	0.00%	99.93%
140.0	11.451	4.043	31220.74	0.00%	99.94%
145.0	12.418	3.982	31224.722	0.00%	99.95%
150.0	13.241	3.779	31228.501	0.00%	99.96%
155.0	13.862	3.430	31231.931	0.00%	99.97%
160.0	13.963	2.918	31234.849	0.00%	99.98%
165.0	13.819	2.290	31237.139	0.00%	99.99%
170.0	13.732	1.634	31238.773	0.00%	100.00%
175.0	14.108	0.996	31239.769	0.00%	100.00%
180.0	14.665	0.344	31240.113	0.00%	100.00%



Luminous Intensity Distribution Diagram Light Distribution Curve [Unit:cd]

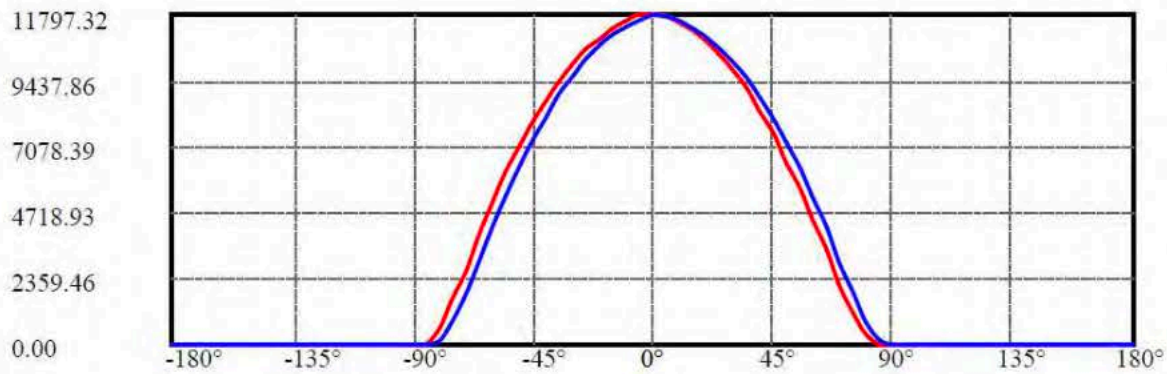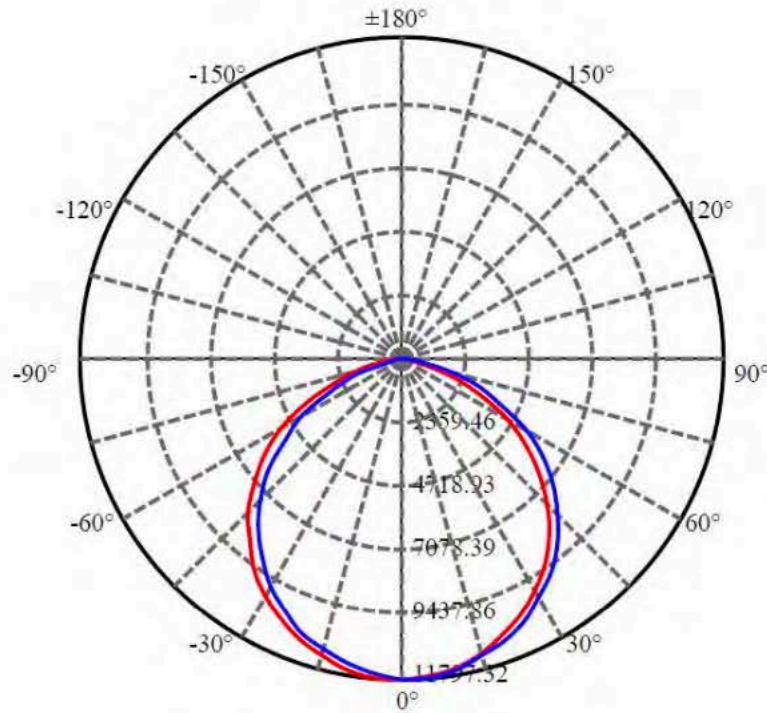

C0/C180: —

C90/C270: —

Field angle(10%Imax):C0/180Left:77.1 Right:74.6


:C90/270Left:73.2 Right:78.3

Beam Angle(50%Imax):C0/180Left:56.2 Right:53.3

:C90/270Left:52.1 Right:57.0



Lux distance Curve

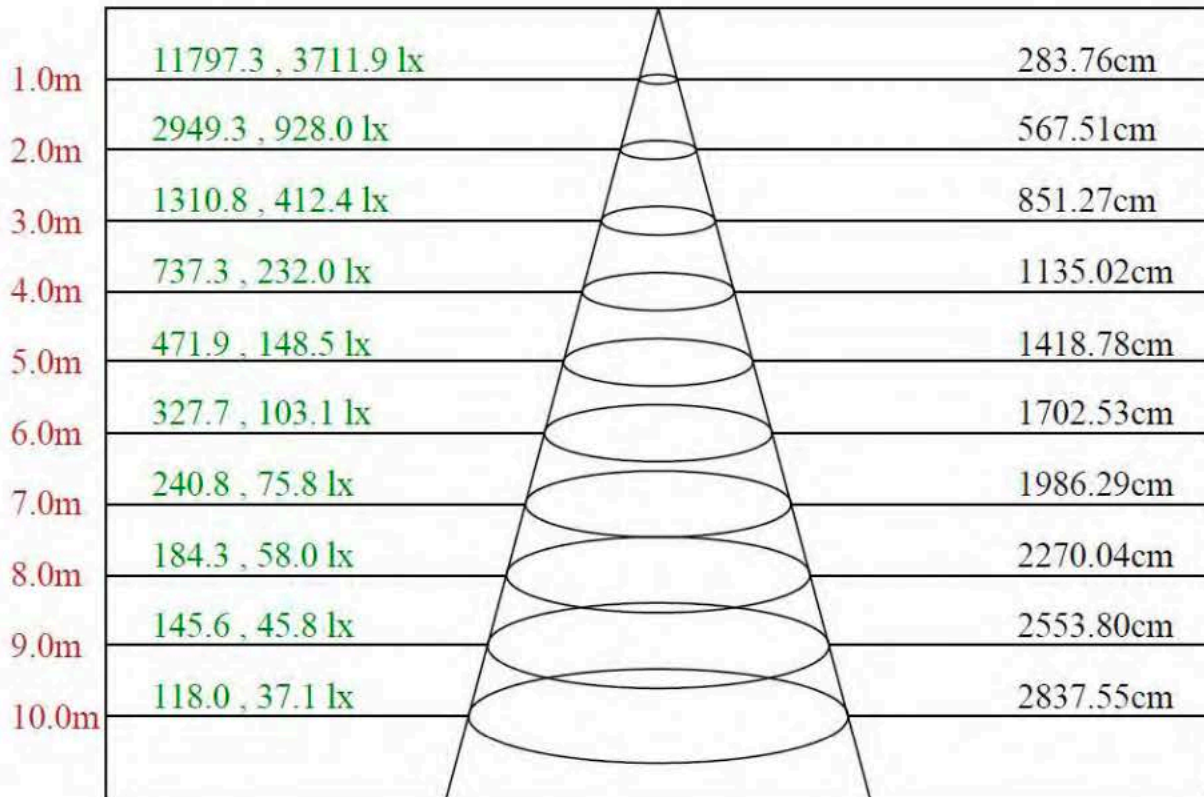

Max , Ave Beam angle of C0 plane 109.65



UGR Glare

Illumination assessment according UGR											
Rf of Ceiling	70	70	50	50	30	70	70	50	50	30	
Rf of Wall	50	30	50	30	30	50	30	50	30	30	
Rf of Floor	20	20	20	20	20	20	20	20	20	20	
Room dimensions		Viewed crosswise					Viewed endwise				
X	Y										
2H	2H	22.47	24.06	22.83	24.38	24.70	22.70	24.29	23.07	24.61	24.93
	3H	23.69	25.12	24.07	25.46	25.81	24.20	25.64	24.59	25.98	26.32
	4H	23.95	25.29	24.35	25.65	26.01	24.66	26.00	25.05	26.35	26.72
	6H	24.03	25.28	24.44	25.65	26.04	24.90	26.15	25.31	26.52	26.91
	8H	23.99	25.19	24.40	25.57	25.97	24.92	26.12	25.33	26.50	26.90
4H	12H	23.94	25.09	24.36	25.48	25.89	24.89	26.04	25.31	26.43	26.84
	2H	22.96	24.31	23.36	24.66	25.02	23.15	24.50	23.55	24.85	25.22
	3H	24.32	25.45	24.73	25.84	26.25	24.73	25.86	25.15	26.25	26.66
	4H	24.68	25.68	25.12	26.10	26.54	25.25	26.25	25.68	26.66	27.10
	6H	24.76	25.65	25.22	26.09	26.53	25.48	26.37	25.94	26.81	27.26
8H	8H	24.75	25.58	25.22	26.02	26.49	25.53	26.36	26.01	26.81	27.27
	12H	24.73	25.49	25.21	25.93	26.44	25.54	26.30	26.02	26.74	27.25
	4H	24.76	25.58	25.23	26.03	26.50	25.29	26.12	25.77	26.57	27.03
	6H	24.85	25.54	25.34	26.01	26.51	25.53	26.22	26.02	26.69	27.19
	8H	24.90	25.49	25.41	26.00	26.49	25.64	26.23	26.15	26.74	27.23
12H	12H	24.87	25.37	25.39	25.88	26.39	25.64	26.14	26.16	26.65	27.16
	4H	24.74	25.51	25.22	25.95	26.45	25.27	26.04	25.75	26.48	26.99
	6H	24.88	25.47	25.39	25.99	26.48	25.55	26.15	26.07	26.66	27.15
	8H	24.88	25.38	25.41	25.89	26.41	25.62	26.12	26.14	26.63	27.14
Variation with the observer position at spacings:											
S = 1.0H	0.4/-0.4					0.5/-0.4					
S = 1.5H	0.8/-0.6					0.7/-0.9					
S = 2.0H	1.4/-1.5					1.6/-1.4					
Standard tables:	BK2					BK2					
Uncorrected UGR	7.4					6.8					

UGR calculation is based on CIE Publ. 117 ,S/H = 1

**Luminous Intensity Distribution Data**

C/γ(°)	0.0	5.0	10.0	15.0	20.0	25.0	30.0	35.0	40.0
0.0	11797.32	11700.56	11524.97	11194.58	10822.61	10360.53	9801.41	9129.08	8385.13
22.5	11797.32	11732.90	11524.97	11215.37	10850.33	10399.80	9829.13	9156.81	8429.03
45.0	11797.32	11737.53	11524.97	11226.93	10871.13	10404.42	9859.17	9170.67	8435.96
67.5	11797.32	11728.28	11536.52	11203.82	10889.61	10418.29	9875.34	9191.46	8447.52
90.0	11797.32	11753.70	11594.28	11317.03	10998.20	10582.33	10097.14	9514.92	8851.84
112.5	11797.32	11735.21	11568.87	11293.93	10984.33	10549.98	10074.04	9503.37	8798.70
135.0	11797.32	11728.28	11545.76	11305.48	10963.54	10556.91	10041.69	9459.47	8798.70
157.5	11797.32	11709.80	11561.93	11289.31	10954.30	10522.25	10025.52	9450.23	8743.25
180.0	11797.32	11781.42	11566.55	11277.75	10954.30	10531.50	10011.66	9410.95	8703.97
202.5	11797.32	11774.49	11571.18	11300.86	10921.95	10503.77	10018.59	9392.47	8697.04
225.0	11797.32	11774.49	11559.62	11305.48	10935.82	10489.91	9995.48	9373.99	8692.42
247.5	11797.32	11779.11	11555.00	11280.07	10924.26	10503.77	9990.86	9350.88	8678.56
270.0	11797.32	11612.76	11367.86	11060.58	10683.98	10198.80	9607.34	8932.70	8167.96
292.5	11797.32	11591.97	11379.41	11083.68	10695.53	10182.63	9628.13	8974.29	8170.27
315.0	11797.32	11615.07	11395.59	11106.79	10737.12	10272.73	9695.13	8999.70	8232.65
337.5	11797.32	11663.59	11441.79	11150.68	10774.09	10286.59	9750.58	9064.39	8301.96
360.0	11797.32	11700.56	11524.97	11194.58	10822.61	10360.53	9801.41	9129.08	8385.13

C/γ(°)	45.0	50.0	55.0	60.0	65.0	70.0	75.0	80.0	85.0
0.0	7514.11	6557.61	5571.07	4502.05	3340.61	2155.14	1105.53	343.56	4.62
22.5	7544.15	6624.61	5608.03	4546.64	3419.85	2206.20	1124.01	368.74	4.62
45.0	7564.94	6629.23	5668.10	4552.64	3409.92	2230.46	1163.29	368.05	5.08
67.5	7604.22	6663.89	5642.69	4592.15	3430.94	2202.97	1155.43	374.05	4.85
90.0	8066.30	7229.93	6315.02	5296.13	4180.21	2962.63	1823.60	836.60	143.94
112.5	8052.44	7211.45	6266.50	5229.13	4152.48	2916.42	1765.84	799.63	56.14
135.0	7999.30	7167.55	6220.29	5206.02	4043.89	2803.21	1724.25	738.17	24.03
157.5	7983.13	7135.21	6176.39	5134.40	3979.20	2726.97	1634.15	702.13	19.18
180.0	7941.54	7084.38	6160.22	5095.13	3859.06	2673.83	1587.94	622.19	10.63
202.5	7909.19	7070.52	6118.63	5028.12	3835.96	2625.31	1520.94	609.02	7.86
225.0	7902.26	7033.55	6093.22	5041.99	3789.75	2576.79	1511.70	584.07	6.47
247.5	7890.71	7075.14	6053.94	5028.12	3801.30	2632.24	1507.07	594.47	9.24
270.0	7285.38	6347.36	5256.85	4224.80	2967.48	1834.46	803.56	159.42	3.70
292.5	7310.80	6365.85	5356.20	4273.78	3017.15	1889.91	895.51	188.30	3.70
315.0	7382.42	6446.71	5409.34	4353.02	3143.76	1977.47	953.50	259.69	4.16
337.5	7426.32	6513.71	5476.34	4407.55	3314.50	2066.65	1025.59	289.49	4.16
360.0	7514.11	6557.61	5571.07	4502.05	3340.61	2155.14	1105.53	343.56	4.62

C/γ(°)	90.0	95.0	100.0	105.0	110.0	115.0	120.0	125.0	130.0
0.0	2.31	2.08	2.31	3.24	4.16	5.31	6.24	7.86	9.24
22.5	2.54	2.31	2.31	3.24	3.93	5.31	6.47	7.86	9.01
45.0	3.00	2.08	2.08	3.00	3.93	5.31	6.47	8.32	9.47
67.5	3.00	2.54	2.31	3.00	4.16	5.55	6.70	8.55	9.70
90.0	3.24	2.08	2.08	2.08	3.47	4.39	5.78	7.16	8.78
112.5	3.00	1.85	1.85	2.31	3.24	4.39	5.78	6.93	8.55
135.0	3.00	2.08	2.08	2.54	3.24	4.62	5.78	7.39	8.78
157.5	3.00	2.31	1.85	2.54	3.47	4.85	6.01	7.39	8.78
180.0	2.77	1.85	2.08	2.54	3.70	4.85	5.78	7.39	8.55
202.5	2.77	2.08	2.08	2.77	3.47	4.85	5.78	7.39	8.78
225.0	2.54	2.08	2.31	2.54	3.70	4.85	6.24	7.62	9.01
247.5	2.77	2.31	2.08	2.77	3.47	5.08	6.24	7.86	9.24
270.0	2.31	1.85	2.31	3.24	4.62	6.01	6.93	8.55	10.17
292.5	2.31	2.08	2.31	3.47	4.39	5.78	7.16	8.78	10.17
315.0	2.31	2.08	2.31	3.24	4.39	5.31	6.93	8.09	9.70
337.5	2.77	2.31	2.54	3.00	3.93	5.31	6.70	8.09	9.47
360.0	2.31	2.08	2.31	3.24	4.16	5.31	6.24	7.86	9.24



$C/\gamma(^{\circ})$	135.0	140.0	145.0	150.0	155.0	160.0	165.0	170.0	175.0
0.0	10.40	11.32	12.25	13.17	13.63	13.86	13.63	13.86	14.56
22.5	10.63	11.32	12.48	13.17	13.63	13.86	14.09	14.09	14.56
45.0	10.63	11.55	12.71	13.40	14.09	14.09	14.09	14.09	14.56
67.5	10.86	12.01	13.17	13.63	14.32	14.09	14.09	14.09	14.79
90.0	9.94	11.09	12.25	13.17	13.63	14.09	13.86	13.63	13.63
112.5	9.94	11.09	12.48	12.94	14.09	14.09	13.63	13.63	13.63
135.0	9.94	11.09	12.01	12.94	13.63	14.09	13.86	13.63	13.63
157.5	9.70	10.86	11.78	12.94	13.63	13.86	13.40	13.63	13.40
180.0	9.94	11.09	11.78	12.71	13.63	13.63	13.40	13.40	13.40
202.5	9.70	11.09	12.01	12.94	13.63	13.63	13.63	13.17	13.40
225.0	10.17	11.32	12.25	13.17	13.63	14.09	13.86	13.40	13.63
247.5	10.63	11.78	12.71	13.63	14.32	14.32	13.86	13.86	13.63
270.0	11.09	12.25	12.94	13.86	14.09	14.09	14.09	13.63	14.56
292.5	11.09	12.25	12.94	13.63	14.09	14.09	13.86	13.86	14.79
315.0	10.86	11.78	12.71	13.40	14.09	13.86	13.86	13.86	14.79
337.5	10.63	11.32	12.25	13.17	13.63	13.63	13.86	13.86	14.79
360.0	10.40	11.32	12.25	13.17	13.63	13.86	13.63	13.86	14.56
$C/\gamma(^{\circ})$	180.0								
0.0	14.67								
22.5	14.67								
45.0	14.67								
67.5	14.67								
90.0	14.67								
112.5	14.67								
135.0	14.67								
157.5	14.67								
180.0	14.67								
202.5	14.67								
225.0	14.67								
247.5	14.67								
270.0	14.67								
292.5	14.67								
315.0	14.67								
337.5	14.67								
360.0	14.67								



4 Additional Test

Electrical data at 277V

Model Number	Test Voltage (V)	Frequency(Hz)	Power Factor	THD
CHB3-200-D-MV-30K-170S	277	60	0.966	8.3%
CHB3-200-D-MV-65K-170S	277	60	0.969	5.5%

5 Performance Assessment

Model name	CCT(K)	Total Luminous(lm)	Power(W)	Luminous Efficacy(lm/W)
CHB3-200-D-MV-30K-170S	3000	31318.13	202.84	154.4
CHB3-200-D-MV-35K-170S	3500	31842.14 * ¹	203.56 * ²	156.4 * ³
CHB3-200-D-MV-40K-170S	4000	32366.14 * ¹	203.56 * ²	159.0 * ³
CHB3-200-D-MV-45K-170S	4500	32890.15 * ¹	203.56 * ²	161.6 * ³
CHB3-200-D-MV-50K-170S	5000	33414.16 * ¹	203.56 * ²	164.1 * ³
CHB3-200-D-MV-57K-170S	5700	33938.16 * ¹	203.56 * ²	166.7 * ³
CHB3-200-D-MV-65K-170S	6500	34462.17	204.28	168.7

*1: This value is calculated and the calculation formula is as below:

$$31842.14=(34462.17-31318.13) /6+31318.13$$

$$32366.14=(34462.17-31318.13) /6+31842.14$$

$$32890.15=(34462.17-31318.13) /6+32366.14$$

$$33414.16=(34462.17-31318.13) /6+32890.15$$

$$33938.16=(34462.17-31318.13) /6+33414.16$$

*2: This value is calculated and the calculation formula is as below:

$$203.56=(202.84+204.28)/2$$

*3: This value is calculated and the calculation formula is as below:

$$156.4=31842.14 /203.56$$

$$159.0=32366.14 /203.56$$


$$161.6=32890.15 /203.56$$

$$164.1=33414.16 /203.56$$

$$166.7=33938.16 /203.56$$



Photo Document

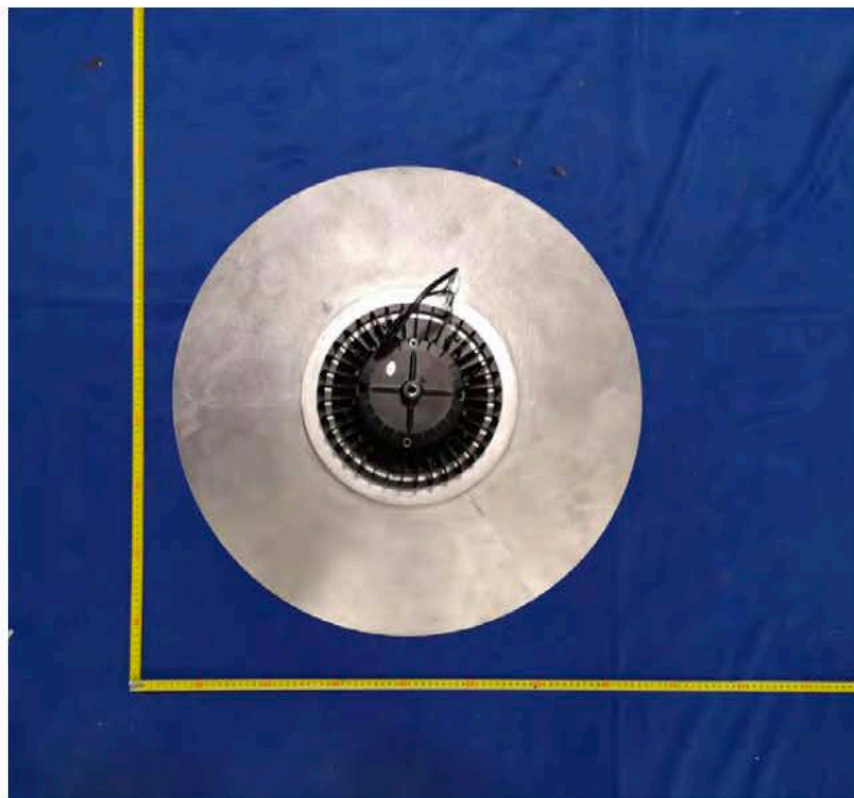

****End of test report****