



Date of issue 2024-09-06

Version 1.0

Total pages 29

**Test report of
IES LM-79-08**

**Approved Method: Electrical and Photometric
Measurements of Solid-State Lighting Products**

Applicant:

P.Q.L., Inc.

Address:

2285 Ward Avenue
Simi Valley, CA 93065

For Product:

High Bay Luminaires (Commercial and Industrial)

Model No.:

HCO2UKAP1503CG

Test laboratory: Shenzhen Belling Efficiency Testing Lab Co., Ltd, 1Floor, No.1 Building, Meibaohe Industrial Park, Dalang Street, Longhua District, Shenzhen, Guangdong Prov.518101 China.

Complied by: Sam Chen

Review by: Jason Zhou

Project Engineer

Technical Manager

Note: The test data was only valid for the test sample(s). This test report is prepared for the customer shown above and for the device described herein. It may not be duplicated or used in part without prior written consent from Shenzhen Belling Efficiency Testing Lab Co., Ltd. This report must not be used by the customer to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the U.S. Government.



1 General

1.1 Product Information

Manufacturer	P.Q.L., Inc.
Manufacturer Address	2285 Ward Avenue Simi Valley, CA 93065
Brand Name	PQL
Luminaire Type	High Bay Luminaires (Commercial and Industrial)
Model Number	HCO2UKAP1503CG, HCO2XKAP1503CG, HCO2HKAP1503CG
Rated Inputs	AC 100-277V, AC 120-347V, AC 200-480V, 50/60Hz
Field-Adjustable Product	Yes, Wattage setting: 80W, 120W, 150W
Color-Tunable Product	Yes, CCT setting: 3000K, 4000K, 5000K
Dimming Capability	Continuous
Integral Control Sensors	Optional
Date of Receipt Samples	2024-08-16
Date of test	2024-08-19 to 2024-08-28
Burning Time Before Test	0hour(For New Products)

1.2 Standards or methods

- ANSI C78.377-2017: Specifications for the Chromaticity of Solid State Lighting Products
- ANSI C82.77-10:2014: Harmonic Emission Limits - Related Power Quality Requirements for Lighting Equipment - Solid State
- CIE Publication No.13.3-1995: Method of Measuring and Specifying Color Rendering of Light Sources
- IESNA LM-79-08 Approved Method: Electric & Photometric Measurement of Solid-state Lighting Products



1.3 Equipment list

Device	Manufacture	Model No.	Serial No.	Calibration due date
Goniophotometric System	SENSING	GMS-3000	M101758514120011	2025-04-09
AC Power Source	ALL POWER	ALL POWER	970780	2025-04-17
Total Luminous Flux Standard Lamp	SENSING	110V/100W	S13100188	2025-04-16
Total Luminous Flux Standard Lamp	OSRAM	12V/20W	LSD12201737	2025-04-16
Total Spectral Radiant Flux Standard Lamp	Everfine	D204	M133806CA1411205	2025-04-16
Digital Power Meter	YOKOGAWA	WT310	C2QM02030V	2025-04-17
Thermostatic stabilized photometric sphere	SENSING	SPR-600M	N.A	2025-04-09
Plant spectral photosynthetically radiometer	Everfine	SP-20	P612946CF1411115	2025-04-09
Digital Power Meter	YOKOGAWA	WT210	91L929742	2025-04-17
Spectral radiometer	SENSING	SPR-3000	S1101108	2025-04-09
Environment Measurer	XUYAO	HS-1	N/A	2025-04-11
Environment Measurer	XUYAO	HS-1	N/A	2025-04-11
Stop watch	KISLO	K610	N/A	2025-04-17
Digital Anemometer	TECMAN	TD8901	026141	2024-09-06

Statement of Traceability: Shenzhen Belling Efficiency Testing Lab Co., Ltd attests that all calibration has been performed using suitable standards traceable to national primary standards and International System of Unit (SI).



2 Test conducted and method

2.1 Ambient Condition

The ambient temperature in which measurements are being taken was maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$, the air flow around the sample(s) being tested did not affect the performance.

2.2 Power Supply Characteristics

The AC power supply had a sinusoidal voltage wave shape at the prescribed frequency (60 Hz) such that the RMS summation of the harmonic components does not exceed 3 percent of the fundamental during operation of the test item.

The voltage of AC power supply (RMS voltage) applied to the device under test was regulated to within ± 0.2 percent under load.

2.3 Seasoning and Stabilization

No seasoning was performed in accordance with IESNA LM-79-08. And before the measurement, the sample was stabilized until the light output and power variations were less than 0.5% in 30 minutes intervals (3 readings, 15 minutes apart).

2.4 Integrating Sphere System

The system includes AC power source, digital power meter, DC power supply, spectrophotometer, and integrating sphere. The integrating sphere system is calibrated by standard light source before measurement. The system and standard light source has been calibrated regularly and traceable to the National Primary Standards. 4π geometry was used during measurement. The product was operated in its intended orientation in application and was recorded in this report.

Integrating Sphere Uncertainty: The uncertainty of the light output (luminous flux) measurements is $U=1.8\%$ ($K=2$), at the 95% confidence level. The uncertainty of the correlated color temperature measurements is $U=20\text{K}$ ($K=2$), at the 95% confidence level. The uncertainty of the CRI is $U=1.8(K=2)$, at the 95% confidence level. The uncertainty of power meter AC current $U=0.18\%$ of rdg, AC Voltage $U=0.16\%$ of rdg, Power $U=0.20\%$ ($K=2$), at the 95% confidence level.



2.5 Goniophotometer System

The goniophotometer system is calibrated by standard light source before measurement. The standard light source has been calibrated regularly and traceable to the National Primary Standards.

Type C goniophotometer was used for measuring total luminous flux, luminous intensity distribution, and color spatial uniformity. The product was operated in its intended orientation in application and was recorded in this report. The method according to IESNA LM-79-08 following chapter.

Goniophotometer Uncertainty: The uncertainty of the luminous intensity is $U=1.6\%$ ($K=2$), at the 95% confidence level.



3 Test Result Summary

3.1 Integrating Sphere System (Total operating time for integrating sphere test: 1.0 hour)

3.1.1 Model Number: HCO2UKAP1503CG, 3000K

Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
120.09	60	1.251	149.78	0.997

Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
21208.44	141.6	2906


Chromaticity Coordinate

Duv	x	y	u'	v'
-0.00298	0.4392	0.3974	0.2550	0.5191

Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
72.3	-29	74	95	-16

Spectral Distribution

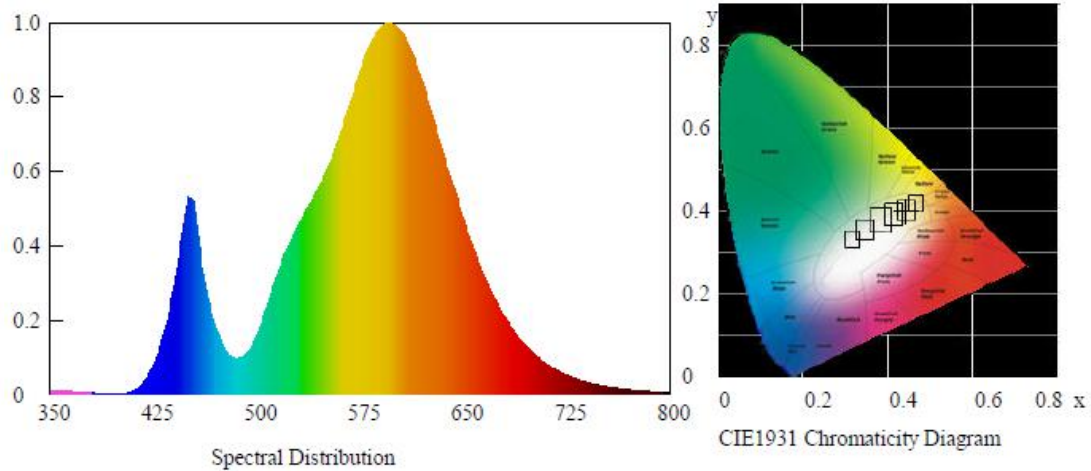









7/4 Step Quadrangle

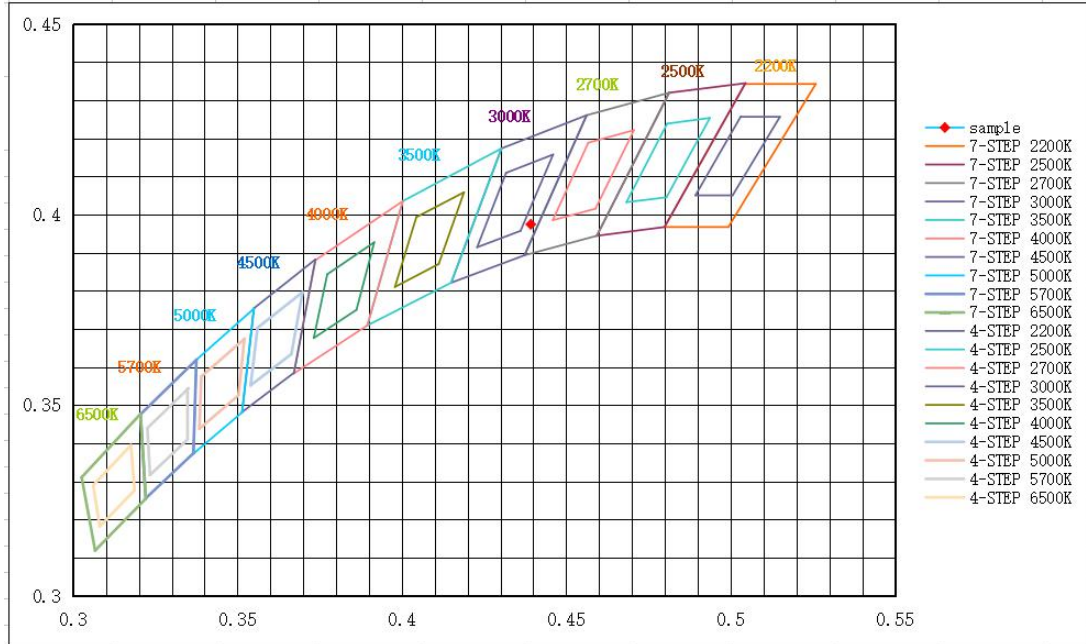



ANSI/IES TM-30-18 Color Rendition Report

Source:	BL240816002-9	Manufacturer:	P.Q.L., Inc.
Date:	2024-09-06	Model:	HCO2UKAP1503CG, 3000K

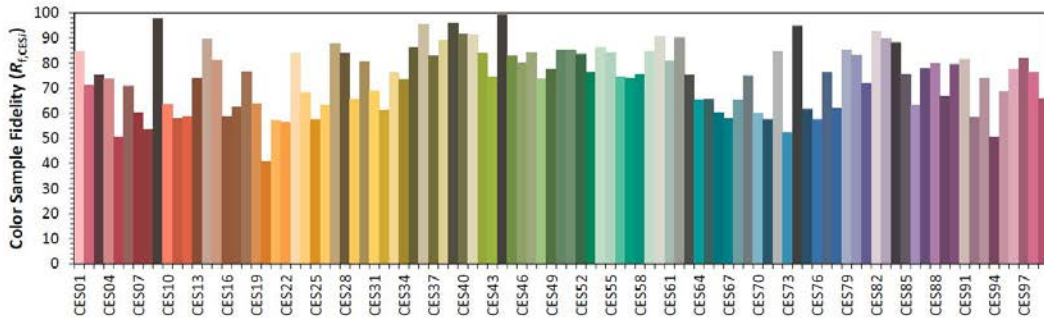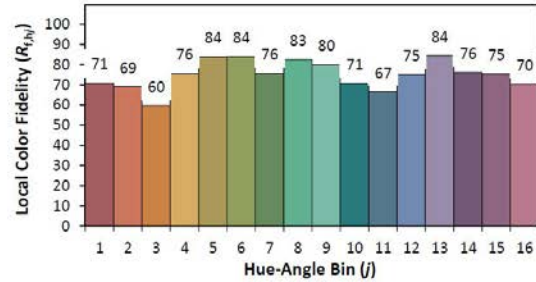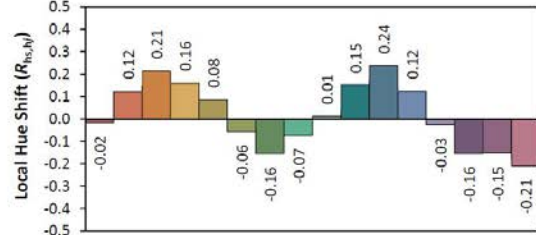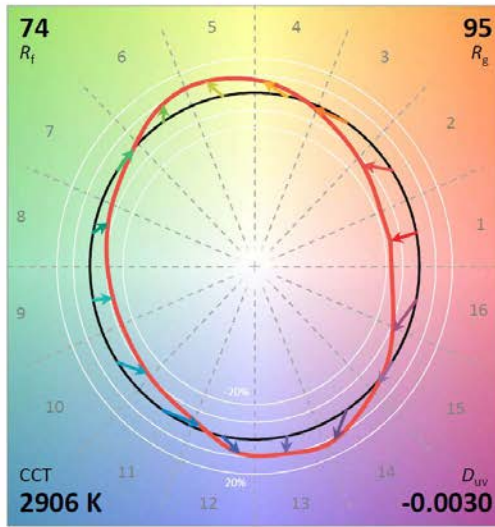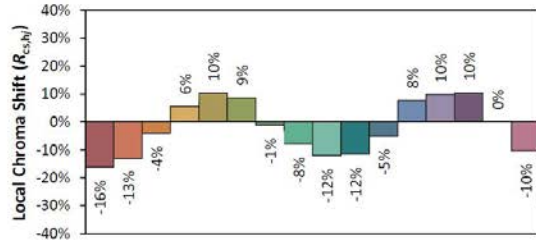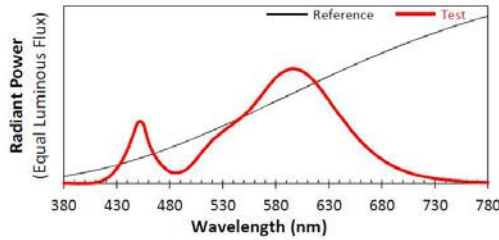

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x	0.4392	CIE 13.3-1995 (CRI) R_a 72 R_g -29
y	0.3974	
u'	0.2550	
v'	0.5191	

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.



3.1.2 Model Number: HCO2UKAP1503CG, 4000K

Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
120.12	60	1.224	146.58	0.997

Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
23628.99	161.2	3742


Chromaticity Coordinate

Duv	x	y	u'	v'
-0.00217	0.3907	0.3782	0.2313	0.5037

Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
75.2	-20	77	94	-16

Spectral Distribution

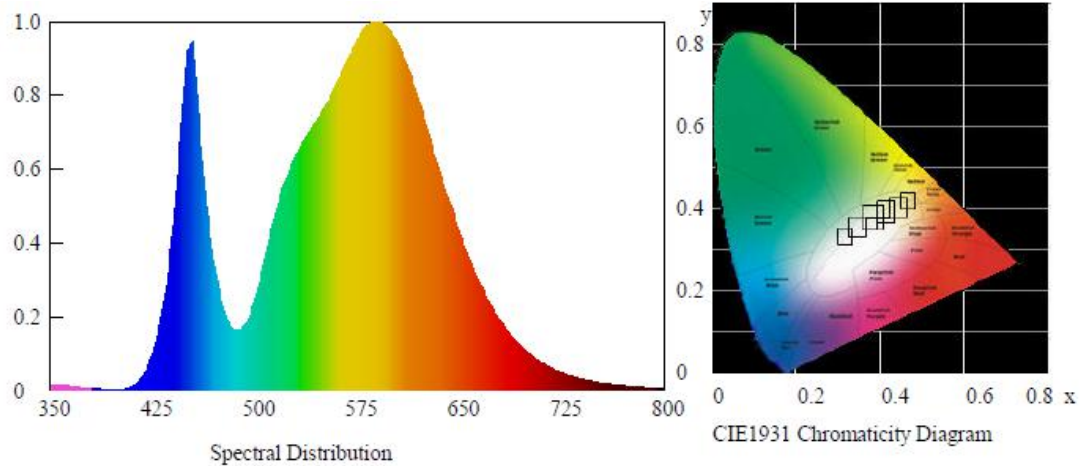









7/4 Step Quadrangle

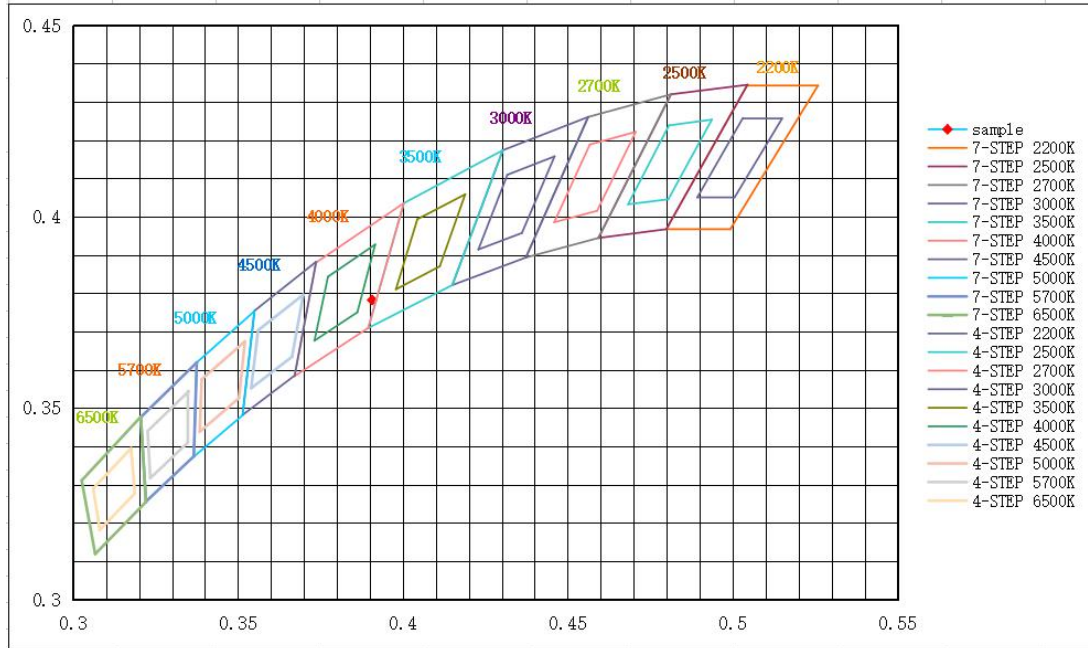



ANSI/IES TM-30-18 Color Rendition Report

Source: BL240816002-9 **Manufacturer:** P.Q.L., Inc.
Date: 2024-09-06 **Model:** HCO2UKAP1503CG, 4000K

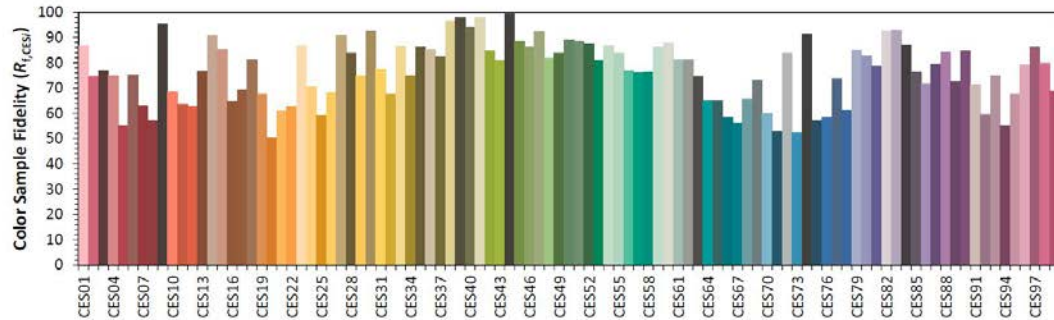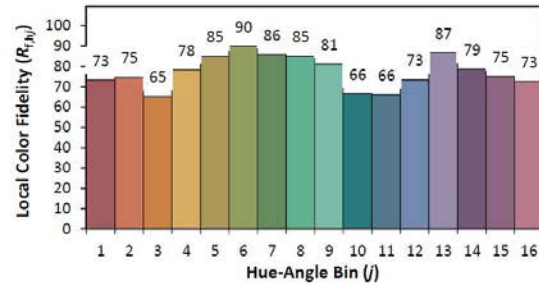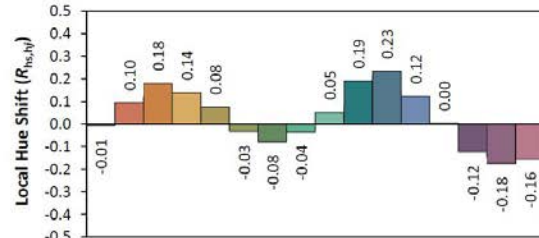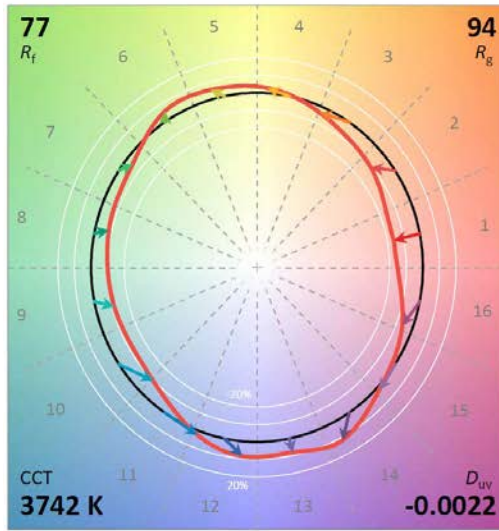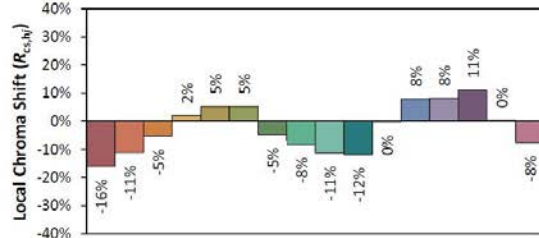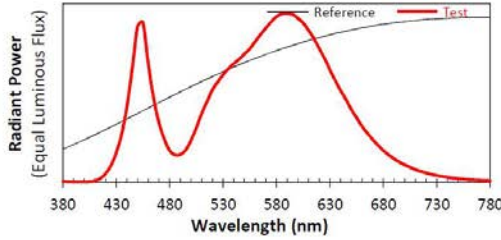

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x	0.3907	CIE 13.3-1995 (CRI) R_a 75 R_g -20
y	0.3782	
u'	0.2313	
v'	0.5037	

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.



3.1.3 Model Number: HCO2UKAP1503CG, 5000K

Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
120.07	60	1.249	149.48	0.997

Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
22108.05	147.9	5106


Chromaticity Coordinate

Duv	x	y	u'	v'
+0.00225	0.3425	0.3540	0.2088	0.4855

Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
73.6	-30	75	93	-18

Spectral Distribution

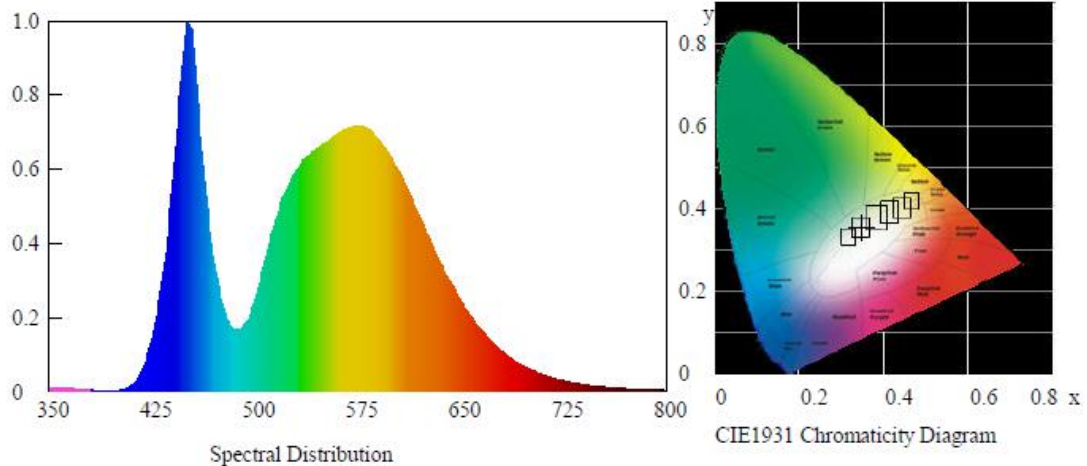









7/4 Step Quadrangle

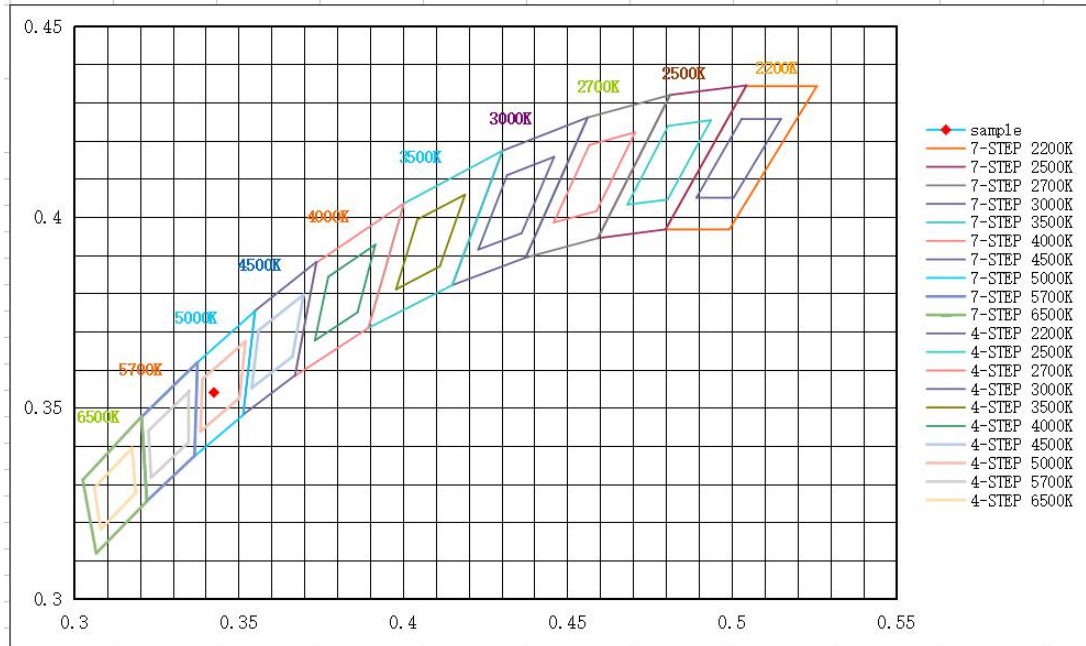



ANSI/IES TM-30-18 Color Rendition Report

Source: BL240816002-9 Manufacturer: P.Q.L., Inc.
 Date: 2024-09-06 Model: HCO2UKAP1503CG, 5000K

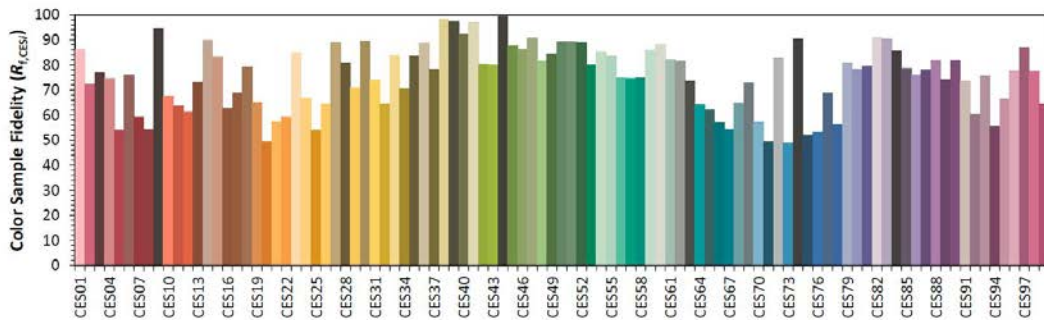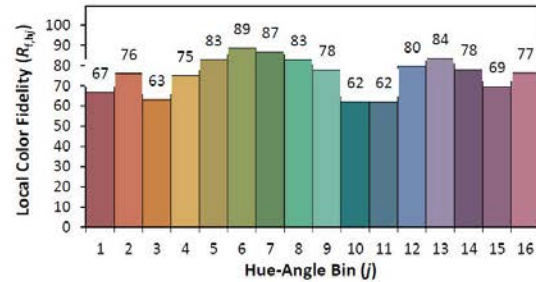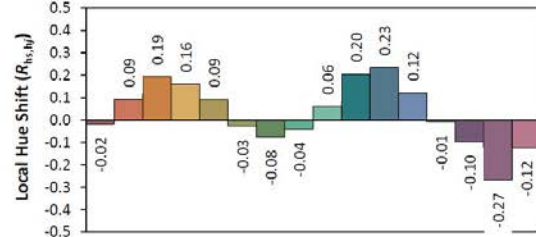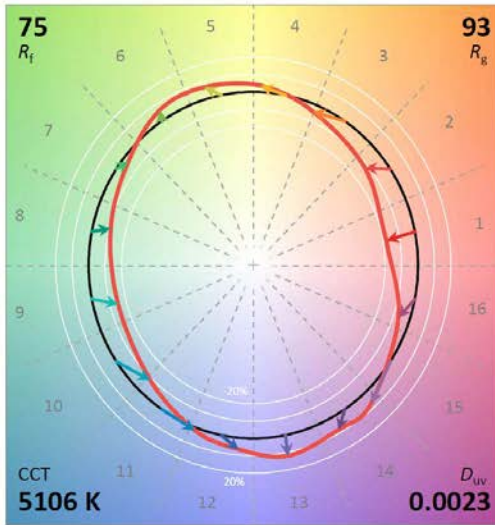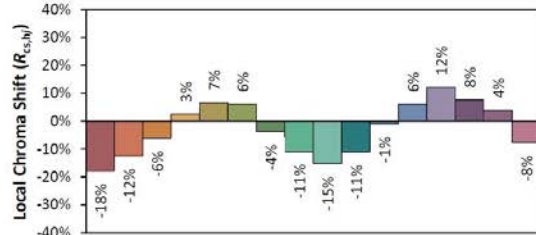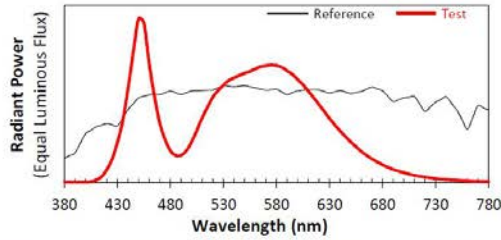

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x	0.3425	CIE 13.3-1995 (CRI) R_a 74 R_g -30
y	0.3540	
u'	0.2088	
v'	0.4855	

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.



3.1.4 Model Number: HCO2XKAP1503CG, 3000K

Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
120.06	60	1.252	149.81	0.997

Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
21347.96	142.5	2894


Chromaticity Coordinate

Duv	x	y	u'	v'
-0.00287	0.4403	0.3980	0.2554	0.5195

Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
72.4	-29	74	96	-16

Spectral Distribution

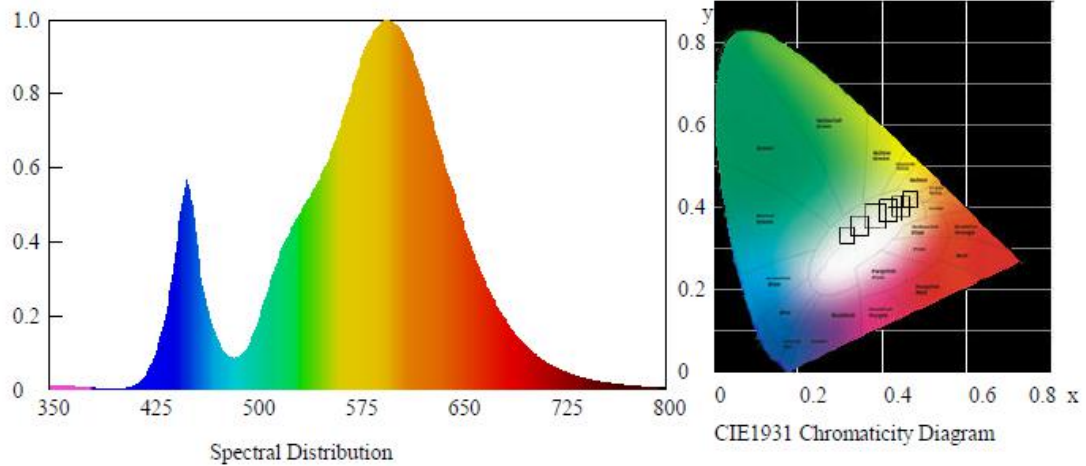









7/4 Step Quadrangle

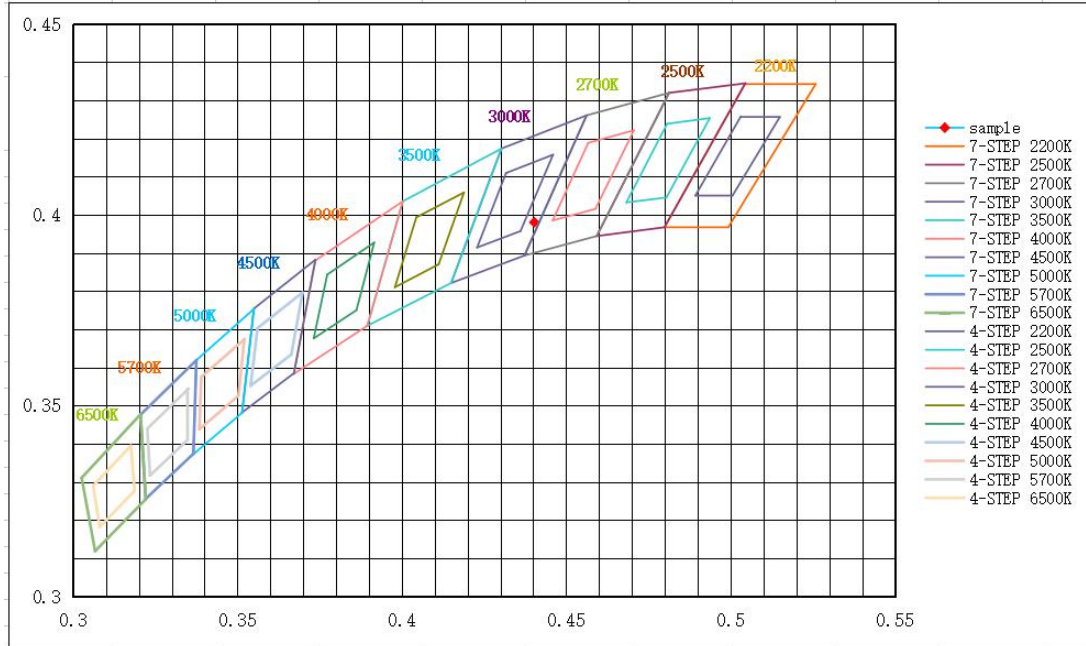



ANSI/IES TM-30-18 Color Rendition Report

Source:	BL240816002-9	Manufacturer:	P.Q.L., Inc.
Date:	2024-09-06	Model:	HCO2XKAP1503CG, 3000K

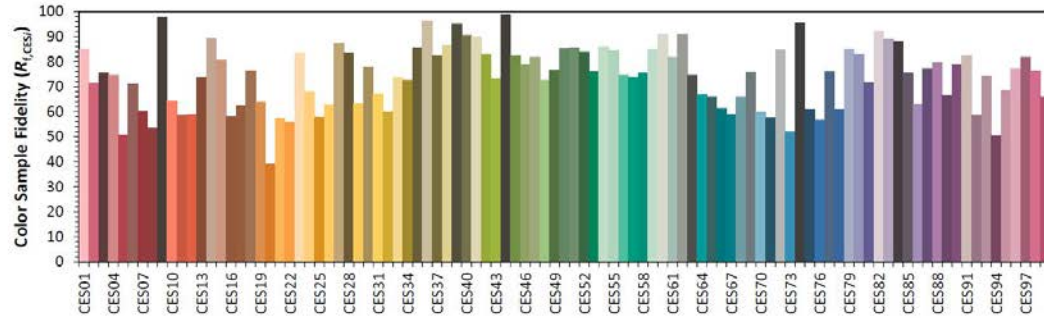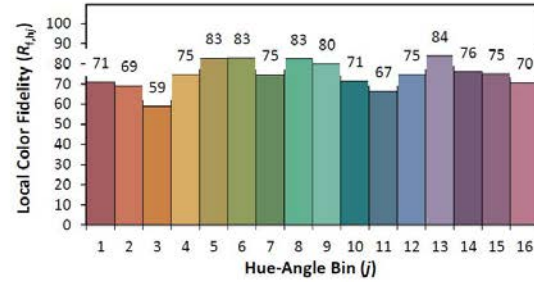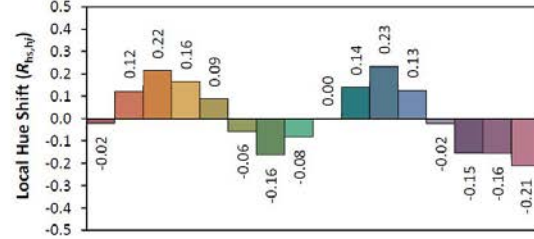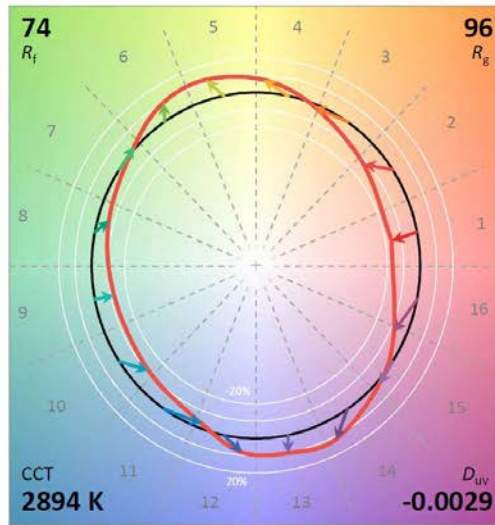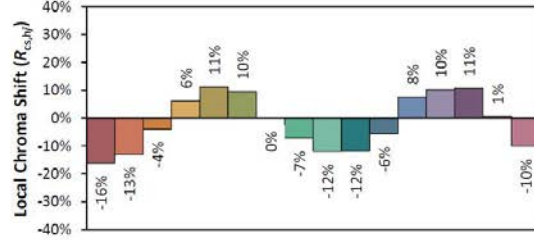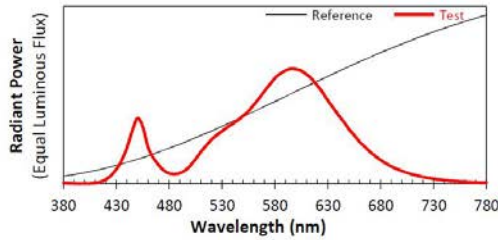

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x	0.4403	CIE 13.3-1995 (CRI)	
y	0.3979		
u'	0.2554		
v'	0.5194		
		R_a	72
		R_g	-29

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.



3.1.5 Model Number: HCO2HKAP1503CG, 3000K

Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
277.09	60	0.542	149.65	0.996

Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	CCT (K)
21444.51	143.3	2916


Chromaticity Coordinate

Duv	x	y	u'	v'
-0.00318	0.4383	0.3966	0.2547	0.5186

Color Rendering


CRI	R9	Rf	Rg	Rcs,h1(%)
72.3	-28	75	94	-16

Spectral Distribution

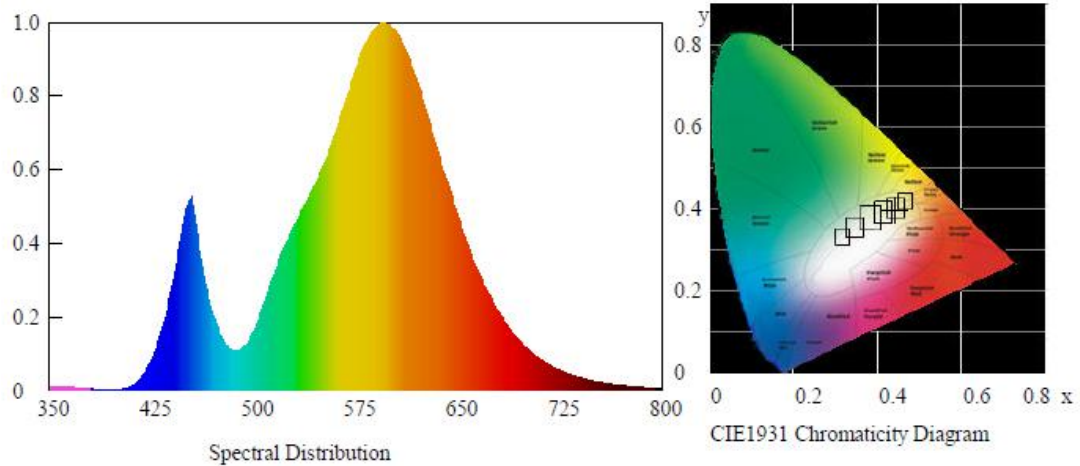









7/4 Step Quadrangle

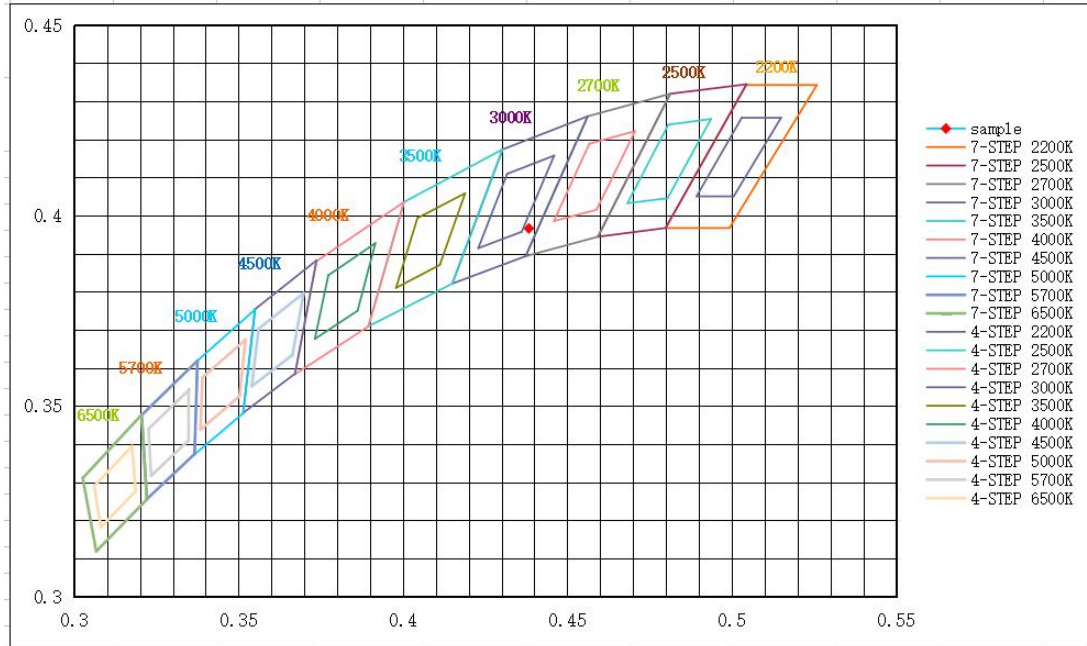



ANSI/IES TM-30-18 Color Rendition Report

Source: BL240816002-9 Manufacturer: P.Q.L., Inc.
 Date: 2024-09-06 Model: HCO2HKAP1503CG, 3000K

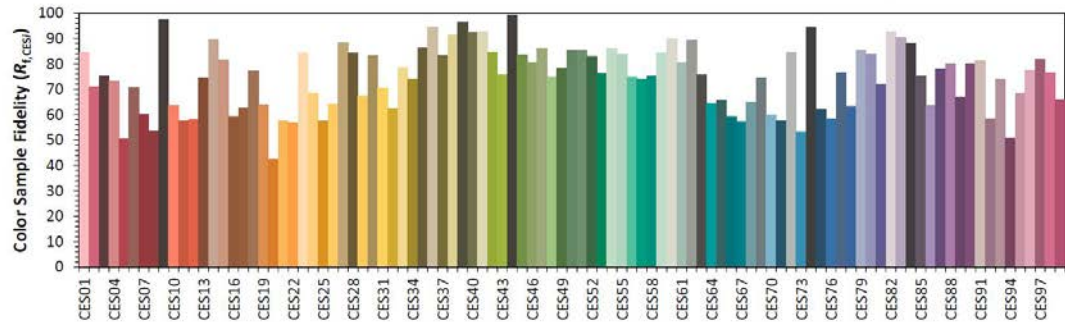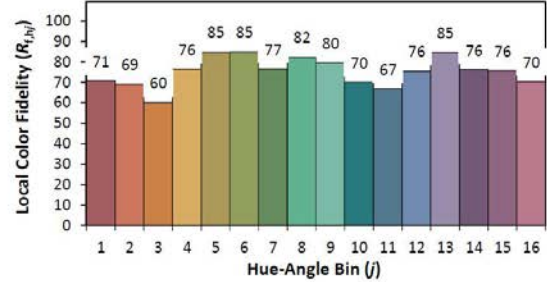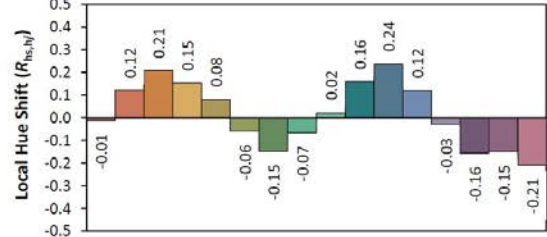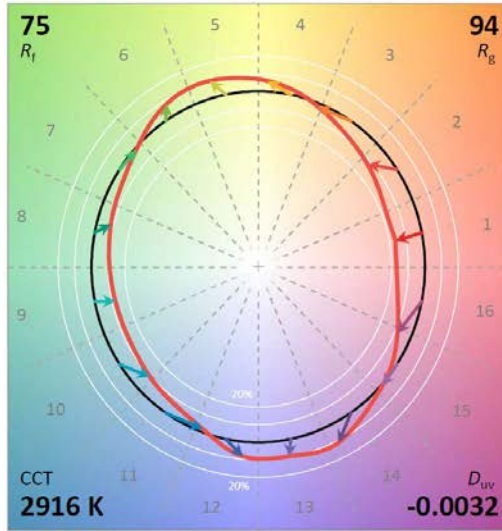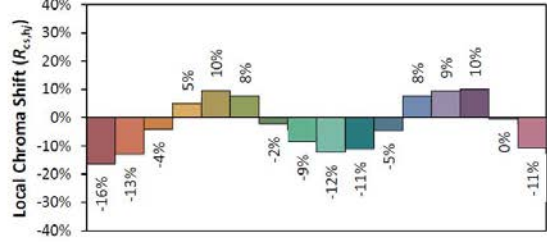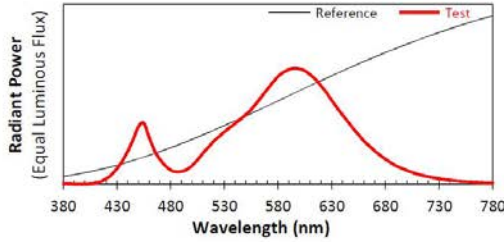

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x 0.4383
 y 0.3966
 u' 0.2547
 v' 0.5186

CIE 13.3-1995 (CRI)
 R_a 72
 R_g -28

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.



3.2 Goniophotometer System (Total operating time for luminous intensity distribution: 1.0 hour)

3.2.1 Model Number: HCO2UKAP1503CG, 3000K

Electrical data

Input Voltage(V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
120.15	60	1.2500	149.74	0.9971

Photometric data

Luminous Flux (lm)	Efficacy (lm/W)	Zonal Lumen in 20-50°(%lm)
21212.75	141.66	64.97

**Zonal Flux Diagram**



Zonal flux distribution table

$\gamma(^{\circ})$	Average I(cd)	Zonal F(lm)	Sum F(lm)	Eff Flux(%)	Eff Sum(%)
0.0	12681.140	0.000	0	0.00%	0.00%
5.0	12657.922	302.921	302.921	0.00%	1.43%
10.0	12532.009	901.123	1204.044	0.00%	5.68%
15.0	12274.333	1471.495	2675.54	0.00%	12.61%
20.0	11874.153	1990.174	4665.714	0.00%	21.99%
25.0	11274.769	2427.895	7093.609	0.00%	33.44%
30.0	10350.808	2736.735	9830.344	0.00%	46.34%
35.0	8722.489	2808.676	12639.02	0.00%	59.58%
40.0	6463.374	2533.646	15172.667	0.00%	71.53%
45.0	3974.309	1932.622	17105.288	0.00%	80.64%
50.0	2660.477	1340.656	18445.944	0.00%	86.96%
55.0	1765.955	962.454	19408.397	0.00%	91.49%
60.0	1159.527	676.217	20084.614	0.00%	94.68%
65.0	746.579	463.378	20547.992	0.00%	96.87%
70.0	440.401	300.551	20848.543	0.00%	98.28%
75.0	237.225	177.120	21025.664	0.00%	99.12%
80.0	106.347	91.930	21117.594	0.00%	99.55%
85.0	27.549	36.383	21153.977	0.00%	99.72%
90.0	2.026	8.098	21162.075	0.00%	99.76%
95.0	1.754	1.035	21163.11	0.00%	99.77%
100.0	1.917	0.998	21164.108	0.00%	99.77%
105.0	2.108	1.077	21165.185	0.00%	99.78%
110.0	2.665	1.248	21166.432	0.00%	99.78%
115.0	3.359	1.525	21167.957	0.00%	99.79%
120.0	4.474	1.904	21169.861	0.00%	99.80%
125.0	6.241	2.477	21172.338	0.00%	99.81%
130.0	8.267	3.155	21175.493	0.00%	99.82%
135.0	10.661	3.825	21179.318	0.00%	99.84%
140.0	13.271	4.431	21183.749	0.00%	99.86%
145.0	15.977	4.880	21188.629	0.00%	99.89%
150.0	18.778	5.118	21193.747	0.00%	99.91%
155.0	21.280	5.069	21198.816	0.00%	99.93%
160.0	23.130	4.658	21203.474	0.00%	99.96%
165.0	24.217	3.902	21207.376	0.00%	99.97%
170.0	24.911	2.914	21210.29	0.00%	99.99%
175.0	26.080	1.824	21212.114	0.00%	100.00%
180.0	27.298	0.638	21212.752	0.00%	100.00%



Luminous Intensity Distribution Diagram

Light Distribution Curve [Unit:cd]

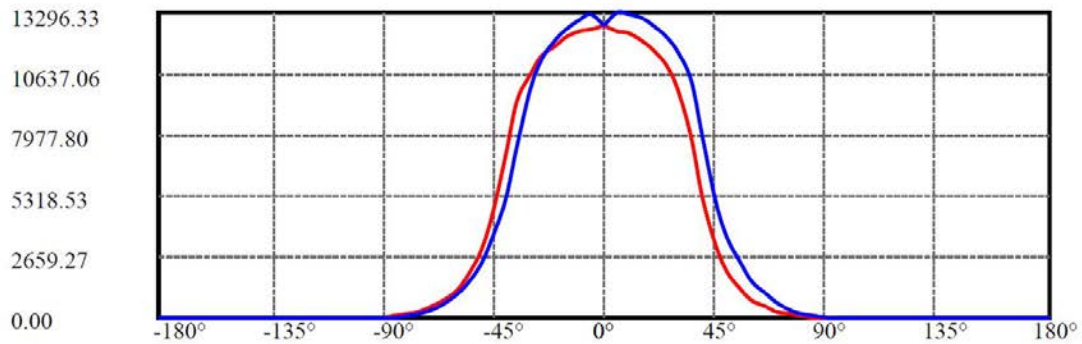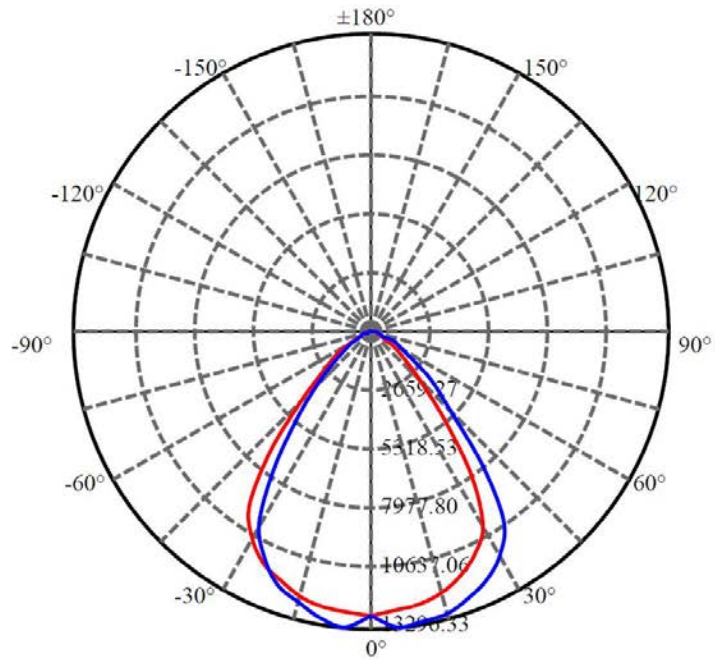

C0/C180: —

C90/C270: —

Field angle(10%Imax):C0/180Left:59.4 Right:54.7


:C90/270Left:57.1 Right:63.1

Beam Angle(50%Imax):C0/180Left:41.3 Right:37.9

:C90/270Left:37.4 Right:42.6



Lux distance Curve

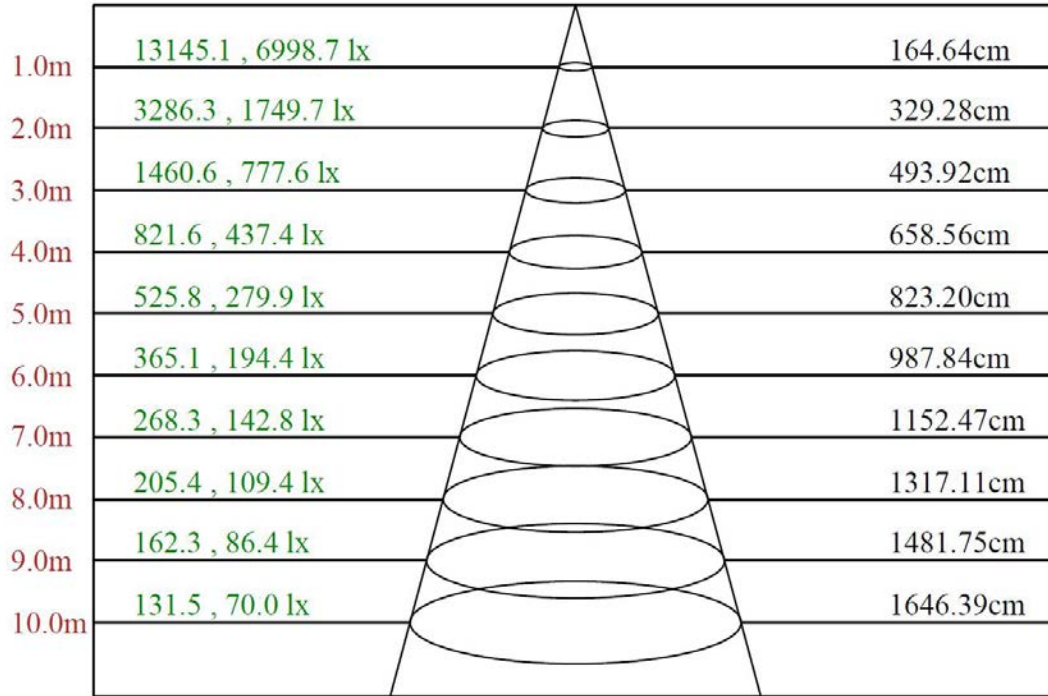

Max , Ave Beam angle of C90 plane 78.92



UGR Glare

Illumination assessment according UGR											
Rf of Ceiling	70	70	50	50	30	70	70	50	50	30	
Rf of Wall	50	30	50	30	30	50	30	50	30	30	
Rf of Floor	20	20	20	20	20	20	20	20	20	20	
Room dimensions		Viewed crosswise					Viewed endwise				
X	Y										
2H	2H	22.07	23.34	22.43	23.66	23.98	23.07	24.34	23.43	24.66	24.98
	3H	22.54	23.67	22.93	24.01	24.36	24.01	25.14	24.40	25.48	25.83
	4H	22.61	23.66	23.01	24.02	24.39	24.26	25.30	24.66	25.66	26.03
	6H	22.62	23.58	23.03	23.96	24.36	24.39	25.36	24.81	25.73	26.14
	8H	22.56	23.49	22.98	23.87	24.28	24.39	25.32	24.81	25.70	26.11
	12H	22.50	23.38	22.93	23.78	24.20	24.37	25.25	24.80	25.64	26.06
4H	2H	22.36	23.40	22.76	23.76	24.13	23.23	24.28	23.63	24.64	25.01
	3H	22.94	23.81	23.36	24.20	24.62	24.20	25.07	24.63	25.47	25.89
	4H	23.09	23.85	23.53	24.27	24.72	24.49	25.25	24.93	25.67	26.12
	6H	23.08	23.74	23.55	24.20	24.65	24.61	25.28	25.08	25.73	26.18
	8H	23.05	23.67	23.53	24.13	24.60	24.64	25.26	25.13	25.72	26.20
	12H	23.01	23.58	23.50	24.03	24.55	24.65	25.23	25.14	25.68	26.20
8H	4H	23.06	23.68	23.55	24.14	24.62	24.42	25.04	24.90	25.49	25.97
	6H	23.06	23.58	23.57	24.05	24.57	24.54	25.05	25.04	25.53	26.04
	8H	23.08	23.53	23.61	24.05	24.55	24.62	25.06	25.15	25.58	26.08
	12H	23.04	23.40	23.58	23.92	24.44	24.63	24.99	25.17	25.51	26.03
12H	4H	23.03	23.60	23.52	24.06	24.58	24.38	24.95	24.87	25.41	25.92
	6H	23.07	23.51	23.60	24.03	24.53	24.54	24.98	25.07	25.50	26.00
	8H	23.05	23.42	23.59	23.93	24.46	24.58	24.94	25.12	25.46	25.98
Variation with the observer position at spacings:											
S = 1.0H	1.3/-2.0					1.5/-2.4					
S = 1.5H	2.9/-3.5					3.1/-4.1					
S = 2.0H	5.4/-4.9					5.4/-5.3					
Standard tables:	BK1					BK1					
Uncorrected UGR	8.9					7.4					

UGR calculation is based on CIE Publ. 117 ,S/H = 1

**Luminous Intensity Distribution Data**

C/γ(°)	0.0	5.0	10.0	15.0	20.0	25.0	30.0	35.0	40.0
0.0	12681.14	12476.12	12386.92	12064.93	11664.61	10974.94	9941.52	7870.32	5189.95
22.5	12681.14	12476.12	12299.90	12101.91	11701.60	11120.71	10087.29	8159.68	5235.64
45.0	12681.14	12441.31	12354.29	12128.02	11779.92	11175.10	10220.00	8494.73	5448.85
67.5	12681.14	12415.20	12373.87	12145.43	11812.56	11264.30	10357.06	8605.69	5642.48
90.0	12681.14	13296.33	13189.73	13048.31	12724.14	12228.10	11553.66	10324.43	7831.16
112.5	12681.14	12891.67	12806.82	12671.93	12354.29	11888.70	11181.63	9956.75	7702.80
135.0	12681.14	12737.20	12680.63	12480.47	12151.95	11666.79	10905.32	9741.36	7491.77
157.5	12681.14	12628.42	12545.74	12371.69	11995.31	11527.55	10781.31	9589.07	7134.96
180.0	12681.14	12565.32	12460.89	12252.03	11843.01	11373.08	10596.38	9419.37	7019.65
202.5	12681.14	12500.05	12395.62	12141.08	11764.69	11201.21	10448.44	9210.51	6786.86
225.0	12681.14	12426.08	12299.90	12054.05	11642.86	11072.84	10337.48	9051.69	6549.72
247.5	12681.14	12413.03	12258.56	11951.80	11579.76	10987.99	10169.96	8932.03	6388.72
270.0	12681.14	13248.47	12974.34	12567.50	12051.88	11222.96	9913.24	7467.83	5107.28
292.5	12681.14	12845.98	12630.59	12262.91	11727.71	10946.66	9704.38	7524.40	5068.12
315.0	12681.14	12643.64	12456.54	12101.91	11614.57	10857.46	9665.21	7567.91	5270.45
337.5	12681.14	12521.81	12397.80	12045.35	11577.59	10887.92	9750.06	7644.06	9545.56
360.0	12681.14	12476.12	12386.92	12064.93	11664.61	10974.94	9941.52	7870.32	5189.95
C/γ(°)	45.0	50.0	55.0	60.0	65.0	70.0	75.0	80.0	85.0
0.0	3117.67	1965.46	1221.40	781.70	491.04	282.18	145.98	58.74	4.79
22.5	3424.00	2344.02	1478.77	957.93	602.21	341.14	173.62	67.44	5.66
45.0	3563.67	2557.45	1700.90	1083.24	674.23	377.91	193.63	78.32	6.09
67.5	3596.96	2280.27	1471.81	970.33	625.93	362.89	178.84	72.67	7.83
90.0	5005.03	3486.44	2411.68	1578.42	1075.85	630.50	351.58	168.39	58.96
112.5	5157.32	3266.70	2111.44	1423.95	906.37	559.57	313.29	152.51	52.43
135.0	4837.50	3240.59	2250.68	1493.57	1011.01	597.86	333.52	154.91	50.91
157.5	4535.09	3147.04	2176.71	1471.81	992.30	589.59	335.70	160.13	54.83
180.0	4456.77	2857.68	1830.79	1186.80	759.51	484.73	275.65	137.06	48.08
202.5	4371.92	2981.69	2054.88	1363.03	875.04	533.68	302.63	141.63	48.95
225.0	4226.15	2899.02	2076.63	1408.72	895.05	533.90	287.18	132.93	42.86
247.5	4086.91	2609.66	1693.72	1121.54	732.10	446.44	244.32	118.14	37.64
270.0	3442.27	2348.37	1495.96	950.53	602.00	344.40	174.27	70.27	6.53
292.5	3287.81	2143.64	1367.82	882.43	545.43	318.73	163.39	64.62	5.44
315.0	3210.14	2153.65	1400.23	905.28	563.49	316.99	156.86	61.57	5.00
337.5	3269.75	2285.93	1511.84	973.16	593.73	325.91	165.13	62.22	4.79
360.0	3117.67	1965.46	1221.40	781.70	491.04	282.18	145.98	58.74	4.79
C/γ(°)	90.0	95.0	100.0	105.0	110.0	115.0	120.0	125.0	130.0
0.0	1.74	1.96	1.96	1.96	2.83	3.70	5.00	6.96	9.36
22.5	1.52	1.74	1.96	2.39	3.05	3.70	5.00	6.74	8.92
45.0	1.74	1.74	2.18	2.39	2.83	3.70	4.79	6.96	9.14
67.5	1.74	1.74	1.96	2.39	2.61	3.48	4.79	6.53	8.70
90.0	2.61	1.74	1.96	1.74	2.39	3.05	3.70	5.44	6.74
112.5	2.39	1.52	1.74	2.18	2.39	2.83	3.48	5.22	6.96
135.0	2.61	1.74	1.52	1.74	2.39	2.61	3.48	5.22	7.18
157.5	2.61	1.96	1.74	1.96	2.18	2.83	3.70	5.00	6.74
180.0	2.39	1.52	1.52	1.74	2.39	2.83	3.70	5.22	7.18
202.5	2.18	1.74	1.74	1.52	2.39	2.61	3.70	5.44	6.74
225.0	1.96	1.74	1.74	2.18	2.39	3.05	3.92	5.66	7.40
247.5	1.96	1.74	1.96	1.96	2.61	3.05	4.35	5.66	7.83
270.0	1.52	1.96	2.39	2.39	3.26	4.35	5.87	8.05	10.44
292.5	1.96	1.74	2.18	2.39	3.05	4.13	5.66	7.40	10.23
315.0	1.74	1.96	1.96	2.39	2.83	3.92	5.44	7.40	9.36
337.5	1.74	1.52	2.18	2.39	3.05	3.92	5.00	6.96	9.36
360.0	1.74	1.96	1.96	1.96	2.83	3.70	5.00	6.96	9.36



C/γ(°)	135.0	140.0	145.0	150.0	155.0	160.0	165.0	170.0	175.0
0.0	11.75	14.36	16.97	19.58	21.54	23.50	24.59	24.80	26.76
22.5	11.53	14.14	16.32	19.36	21.76	23.06	24.15	25.02	26.33
45.0	11.31	13.71	16.54	19.36	21.76	23.50	24.37	25.02	26.33
67.5	11.10	13.71	16.75	19.58	21.97	23.50	24.59	24.80	26.54
90.0	9.36	11.97	14.79	18.28	21.10	23.28	24.37	25.46	25.67
112.5	9.36	11.53	14.58	17.62	20.23	22.41	23.71	24.59	25.24
135.0	9.36	11.53	13.92	17.19	19.80	22.19	23.28	24.15	24.80
157.5	8.92	11.75	14.36	16.75	19.36	21.54	23.06	23.93	24.80
180.0	9.14	11.97	14.36	16.97	19.36	21.76	22.84	23.93	24.80
202.5	9.36	12.18	14.58	17.19	19.80	21.54	22.84	24.15	24.80
225.0	9.57	12.40	14.58	17.41	20.23	22.19	23.50	24.37	25.02
247.5	10.01	12.62	15.23	17.84	20.89	22.63	23.93	24.59	25.02
270.0	13.05	16.10	19.36	22.41	25.02	26.54	27.20	27.63	29.59
292.5	12.84	15.23	18.49	20.89	23.28	24.80	25.67	25.89	27.63
315.0	12.18	14.36	17.62	20.02	22.63	24.15	25.24	25.24	26.98
337.5	11.75	14.79	17.19	20.02	21.76	23.50	24.15	25.02	26.98
360.0	11.75	14.36	16.97	19.58	21.54	23.50	24.59	24.80	26.76
C/γ(°)	180.0								
0.0	27.30								
22.5	27.30								
45.0	27.30								
67.5	27.30								
90.0	27.30								
112.5	27.30								
135.0	27.30								
157.5	27.30								
180.0	27.30								
202.5	27.30								
225.0	27.30								
247.5	27.30								
270.0	27.30								
292.5	27.30								
315.0	27.30								
337.5	27.30								
360.0	27.30								



4 Additional Test

Electrical data

Model Number	CCT(K)	Test Voltage (V)	Frequency (Hz)	Power Factor	THD(%)
HCO2UKAP1503CG	3000	120	60	0.998	1.9
		277	60	0.940	10.1
	4000	277	60	0.941	9.8
	5000	277	60	0.940	9.6
HCO2XKAP1503CG	3000	120	60	0.998	1.2
		277	60	0.971	7.5
		347	60	0.942	10.7
HCO2HKAP1503CG	3000	200	60	0.999	3.9
		277	60	0.999	4.3
		347	60	0.975	8.2
		480	60	0.962	10.2


5 Data reporting for white-tunable submissions

(HCO2UKAP1503CG)

ANSI CCT Quadrangle (omit any outside product range) / Worst-Case Value	Actual CCT (K)	Power Consumption (W)	Lumen Output (lm)	Input Control Signal Applied
3000K	2906	149.78	21208.44	0%
4000K	3742	146.58	23628.99	50%
5000K	5106	149.48	22108.05	100%
Lowest Efficacy	2906	149.78	21208.44	0%
Maximum Power	2906	149.78	21208.44	0%



Photo Document

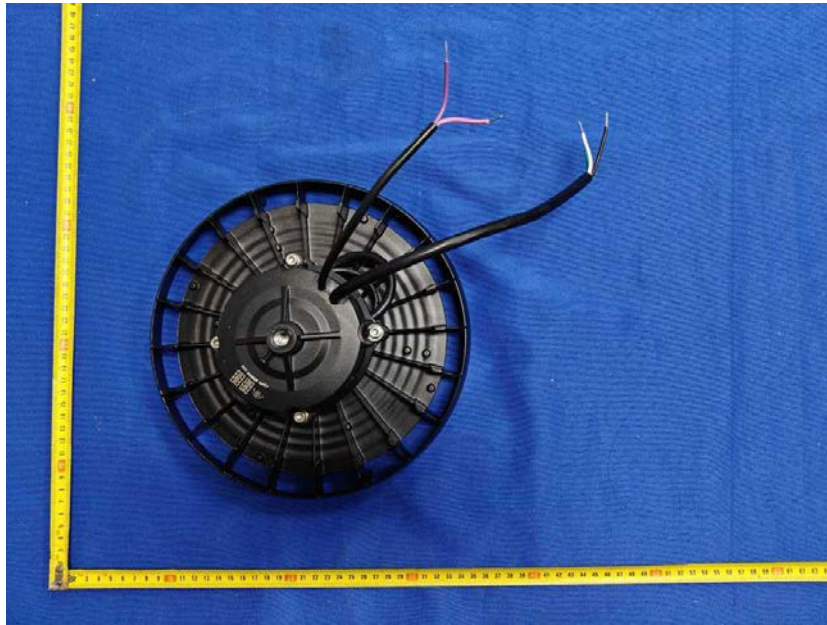

End of test report